











**DEMOLITION GENERAL NOTES**


- CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS PRIOR TO BEGINNING WORK. THE CONTRACTOR SHALL NOTIFY THE ARCHITECT OF ANY DISCREPANCIES BETWEEN THE DOCUMENTS AND FIELD CONDITIONS PRIOR TO PROCEEDING WITH THE WORK. IF ANY QUESTIONS ARISE AS TO THE REMOVAL OF ANY MATERIAL, NOTIFY THE ARCHITECT BEFORE PROCEEDING.
- GENERAL: DEMOLISH AND REMOVE EXISTING CONSTRUCTION ONLY TO THE EXTENT REQUIRED BY NEW CONSTRUCTION AND AS INDICATED. USE METHODS REQUIRED TO COMPLETE THE WORK WITHIN LIMITATIONS OF GOVERNING REGULATIONS AND AS FOLLOWS:
  - NEATLY CUT OPENINGS AND HOLES PLUMB, SQUARE AND TRUE TO DIMENSIONS REQUIRED. USE CUTTING METHODS LEAST LIKELY TO DAMAGE CONSTRUCTION TO REMAIN OR ADJOINING CONSTRUCTION. USE HAND TOOLS OR SMALL POWER TOOLS DESIGNED FOR SAWING OR GRINDING, NOT HAMMERING AND CHOPPING. TEMPORARILY COVER OPENINGS TO REMAIN.
  - CUT OR DRILL FROM THE EXPOSED OR FINISHED SIDE INTO CONCEALED SURFACES TO AVOID MARRING EXISTING FINISHED SURFACES.
  - DO NOT USE CUTTING TORCHES UNTIL WORK AREA IS CLEARED OF FLAMMABLE MATERIALS. AT CONCEALED SPACES, SUCH AS DUCT AND PIPE INTERIORS, VERIFY CONDITION AND CONTENTS OF HIDDEN SPACE BEFORE STARTING FLAME-CUTTING OPERATIONS. MAINTAIN PORTABLE FIRE-SUPPRESSION DEVICES DURING FLAME-CUTTING OPERATIONS.
  - MAINTAIN FIRE WATCH DURING AND FOR AT LEAST 1 HOUR AFTER FLAME-CUTTING OPERATIONS.
  - MAINTAIN ADEQUATE VENTILATION WHEN USING CUTTING TORCHES.
  - REMOVE DECAYED, VERMIN-INFESTED, OR OTHERWISE DANGEROUS OR UNSUITABLE MATERIALS AND PROMPTLY DISPOSE OF OFF-SITE.
  - DISPOSE OF DEMOLISHED ITEMS AND MATERIALS PROMPTLY. COMPLY WITH REQUIREMENTS IN SPECIFICATION SECTION 017419 "CONSTRUCTION WASTE MANAGEMENT AND DISPOSAL."
- REMOVED AND REINSTALLED ITEMS:
  - CLEAN AND REPAIR ITEMS TO FUNCTIONAL CONDITION ADEQUATE FOR INTENDED REUSE.
  - PROTECT ITEMS FROM DAMAGE DURING TRANSPORT AND STORAGE.
  - REINSTALL ITEMS IN LOCATIONS INDICATED. COMPLY WITH INSTALLATION REQUIREMENTS FOR NEW MATERIALS AND EQUIPMENT. PROVIDE CONNECTIONS, SUPPORTS, AND MISCELLANEOUS MATERIALS NECESSARY TO MAKE ITEM FUNCTIONAL FOR USE INDICATED.
- EXISTING ITEMS TO REMAIN: PROTECT CONSTRUCTION INDICATED TO REMAIN AGAINST DAMAGE AND SOILING DURING SELECTIVE DEMOLITION. WHEN PERMITTED BY ARCHITECT, ITEMS MAY BE REMOVED TO A SUITABLE, PROTECTED STORAGE LOCATION DURING SELECTIVE DEMOLITION AND CLEANED AND REINSTALLED IN THEIR ORIGINAL LOCATIONS AFTER SELECTIVE DEMOLITION OPERATIONS ARE COMPLETE.
- CONTRACTOR SHALL PROTECT ALL EXISTING ITEMS THAT ARE NOT SCHEDULED FOR REMOVAL FROM DAMAGE. CONTRACTOR SHALL BE RESPONSIBLE FOR PATCHING AND/OR REPAIRING ANY DAMAGE CAUSED TO THE ITEMS TO REMAIN.
- CONTRACTOR SHALL FURNISH ALL LABOR AND MATERIALS/EQUIPMENT AS REQUIRED TO COMPLETE DEMOLITION AND REMOVAL OF ALL ITEMS AS INDICATED.
- PROVIDE STRICT CONTROL OF JOB CLEANING AND PREVENT DUST AND DEBRIS FROM EMANATING FROM DEMOLITION/CONSTRUCTION AREA. KEEP AREA CLEAN.
- AT COMPLETION OF DEMOLITION WORK, THE CONSTRUCTION AREA(S) SHALL BE LEFT IN CLEAN CONDITION. ALL DEBRIS AND MISCELLANEOUS MATERIAL SHALL BE REMOVED.
- AT LOCATIONS SHOWN ON PLAN, REMOVE EXISTING CARPET, TILE, VCT AND SHEET VINYL, AS NOTED. REMOVE ALL EXISTING IRREGULAR MATERIALS WHICH CAUSE RISES OR DEPRESSIONS IN FLOORING SURFACE, SUCH AS FASTENERS, CARPET PADS, ETC.
- EXISTING FIRE EXTINGUISHERS TO REMAIN UNLESS NOTED OTHERWISE.
- EXISTING HOSE CABINETS, STROBES AND PULL STATIONS SHALL REMAIN IN PLACE U.N.O..
- REMOVE ALL EXISTING INTERIOR WALL FRAMING WHERE NOTED ON DEMOLITION PLAN. DO NOT REMOVE LOAD-BEARING POSTS OR BEAMS UNLESS NOTED OTHERWISE.
- REFER TO ELECTRICAL DRAWINGS FOR ELECTRICAL AND LIGHTING DEMOLITION NOTES.
- REFER TO MECHANICAL DRAWINGS FOR MECHANICAL DEMOLITION NOTES.
- REFER TO PLUMBING DRAWINGS FOR PLUMBING DEMOLITION NOTES.
- REFER TO IT DRAWINGS FOR IT DEMOLITION NOTES.

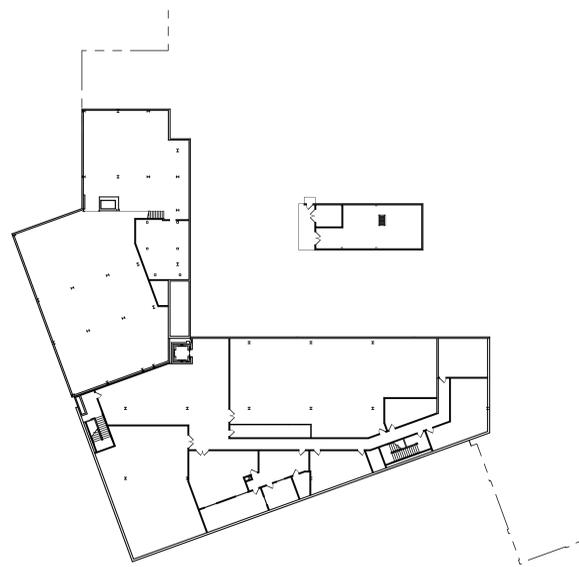


**NORTH BUILDING MEZZANINE FLOOR PLAN**  
SCALE: 1/32"=1'-0"

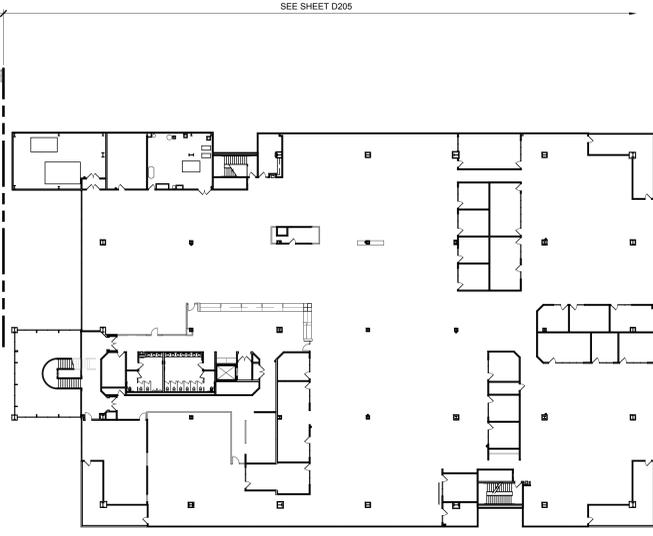

**SOUTH BUILDING SECOND FLOOR PLAN**  
SCALE: 1/32"=1'-0"

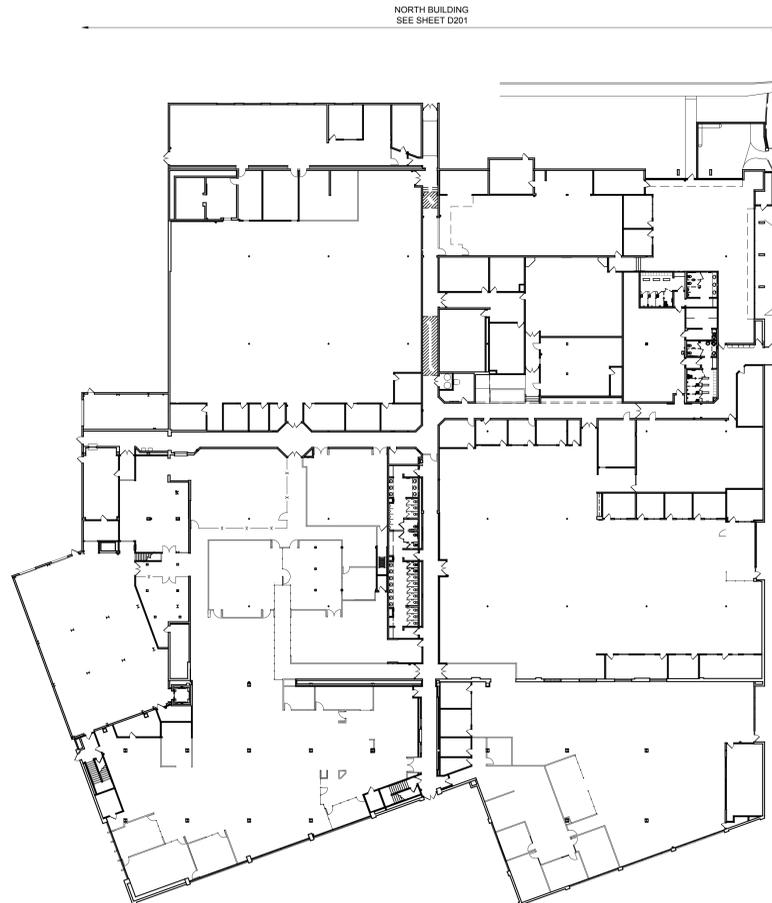

**NORTH BUILDING FIRST FLOOR PLAN**  
SCALE: 1/32"=1'-0"

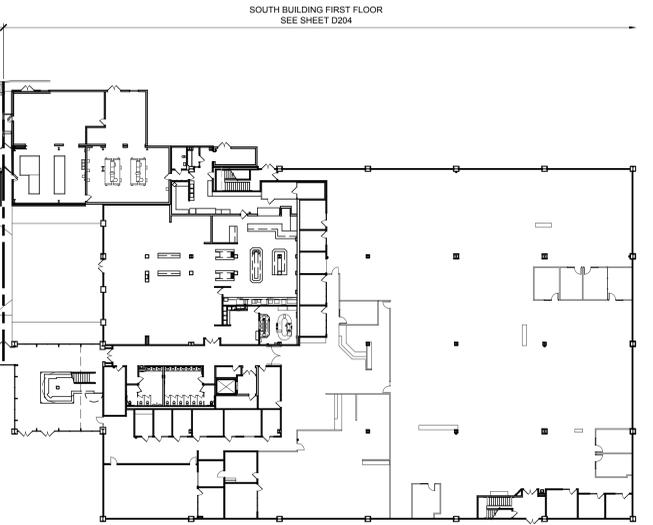

**SOUTH BUILDING FIRST FLOOR PLAN**  
SCALE: 1/32"=1'-0"



**OVERALL DEMO FLOOR PLANS**  
SCALE: 1/32"=1'-0"


**MONTEREY COUNTY GOVERNMENT CENTER**  
**SCHILLING PLACE - ADA UPGRADES**  
ALTERNATE No. 3  
MONTEREY COUNTY GOVERNMENT CENTER  
1441 SCHILLING PLACE  
SALINAS, CA 99901  
A.P.N. NO.: 177-181-024

JOB NO.  
**14105.1**  
PRINT DATE: 2.2.2016  
DRAWN BY: JTI  
CHECKED BY: PS  
SET ISSUED:

SHEET NAME:  
**NORTH-SOUTH COMBINED DEMO PLANS**

SHEET NO.:

**D200**

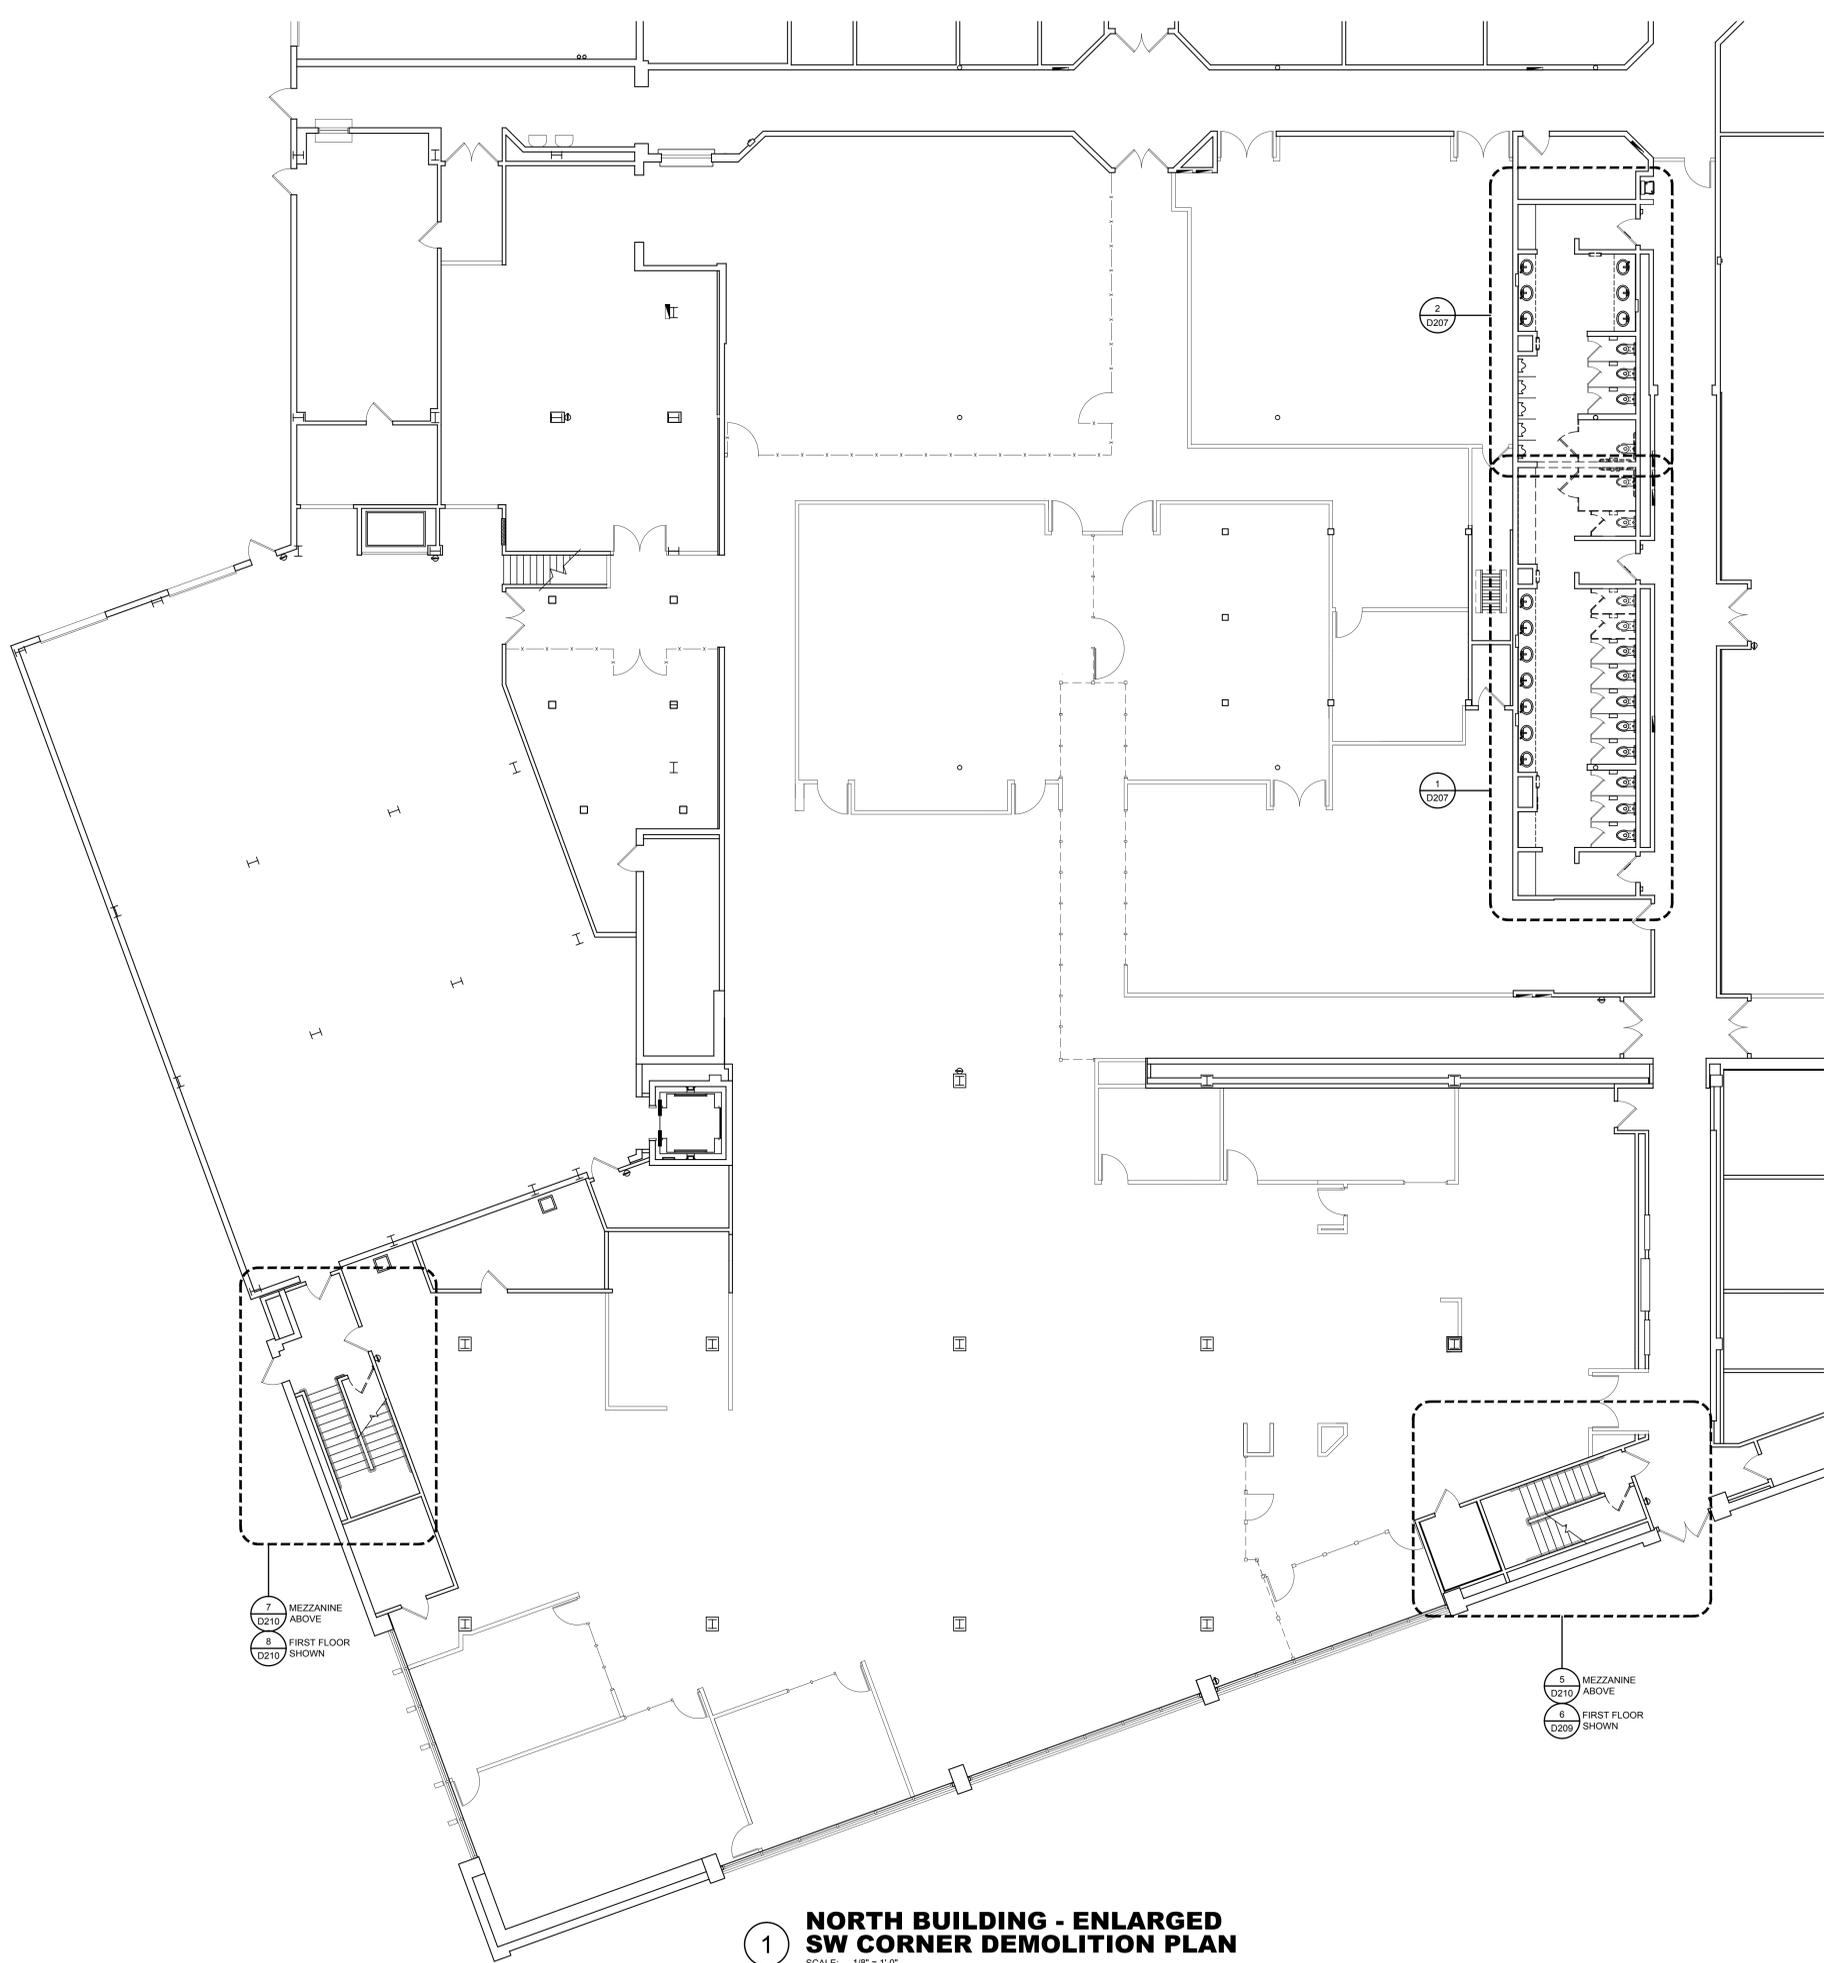



**1 NORTH BUILDING - ENLARGED SW CORNER DEMOLITION PLAN**  
SCALE: 1/8" = 1'-0"

**DEMOLITION GENERAL NOTES**

1. SEE SHEET D200 FOR GENERAL NOTES APPLICABLE TO ALL DEMOLITION SHEETS.

**LEGEND**

- EXISTING WALL TO REMAIN INTACT
- - - EXISTING WALL TO BE DEMOLISHED.
- EXISTING WINDOW TO REMAIN INTACT
- - - EXISTING WINDOW TO BE DEMOLISHED.
- EXISTING DOOR TO REMAIN INTACT
- - - EXISTING DOOR TO BE REMOVED & SAVED FOR POTENTIAL REUSE.
- - - EXISTING ITEM TO BE DEMOLISHED.

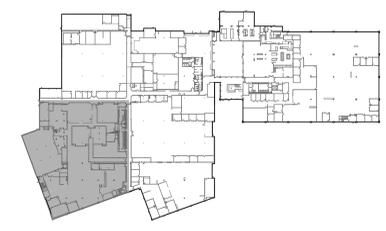

**KEY PLAN**  
SCALE: N.T.S.

**50**  
**WR&D**  
**WALD RUHNKE & DOST ARCHITECTS LLP**  
2340 GARDEN ROAD, SUITE 100  
MONTEREY, CALIFORNIA 93940  
PHONE: 831.649.4642  
FAX: 831.649.3530  
WWW.WRDARCH.COM

THE USE OF THE PLANS AND SPECIFICATIONS IS RESTRICTED TO THE ORIGINAL SITE FOR WHICH THEY WERE PREPARED, AND PUBLICATION HEREIN IS EXPRESSLY LIMITED TO SUCH USE. NO REPRODUCTION OR TRANSMISSION OF ANY METHOD OR IN WHOLE OR IN PART IS PERMITTED WITHOUT THE WRITTEN CONSENT AND VISUAL CONTACT WITH THE ARCHITECT. SPECIFICATIONS REMAIN WITH THE ARCHITECT AND VISUAL CONTACT WITH THEM CONSTITUTES PRIMA FACIE EVIDENCE OF THE ACCEPTANCE OF THESE RESTRICTIONS.

**MONTEREY COUNTY GOVERNMENT CENTER  
SCHILLING PLACE - ADA UPGRADES**  
ALTERNATE No. 3  
MONTEREY COUNTY GOVERNMENT CENTER  
1441 SCHILLING PLACE  
SALINAS, CA 93901  
A.P.N. NO.: 177-181-024

JOB NO.  
**14105.1**  
PRINT DATE: 2.2.2016  
PLOT DATE: 2.2.2016  
DRAWN BY: JTI  
CHECKED BY: PS  
SET ISSUED:

SHEET NAME:  
**NORTH BLD'G.  
SW CORNER  
DEMO PLAN**

SHEET NO.:

**D201**



**DEMOLITION GENERAL NOTES**

1. SEE SHEET D200 FOR GENERAL NOTES APPLICABLE TO ALL DEMOLITION SHEETS.

THE USE OF THE PLANS AND SPECIFICATIONS IS RESTRICTED TO THE ORIGINAL SITE FOR WHICH THEY WERE PREPARED, AND PUBLICATION HEREOF IS EXPRESSLY LIMITED TO SUCH USE. NO REPRODUCTION OR TRANSMISSION BY ANY METHOD OR IN WHOLE OR IN PART IS PERMITTED WITHOUT THE WRITTEN CONSENT AND VISUAL CONTACT WITH THEM CONSTITUTES PRIMA FACIE EVIDENCE OF THE ACCEPTANCE OF THESE RESTRICTIONS.

**LEGEND**

EXISTING WALL TO REMAIN INTACT	EXISTING WALL TO BE DEMOLISHED.
EXISTING WINDOW TO REMAIN INTACT	EXISTING DOOR TO BE REMOVED & SAVED FOR POTENTIAL REUSE.
EXISTING DOOR TO REMAIN INTACT	EXISTING ITEM TO BE DEMOLISHED.

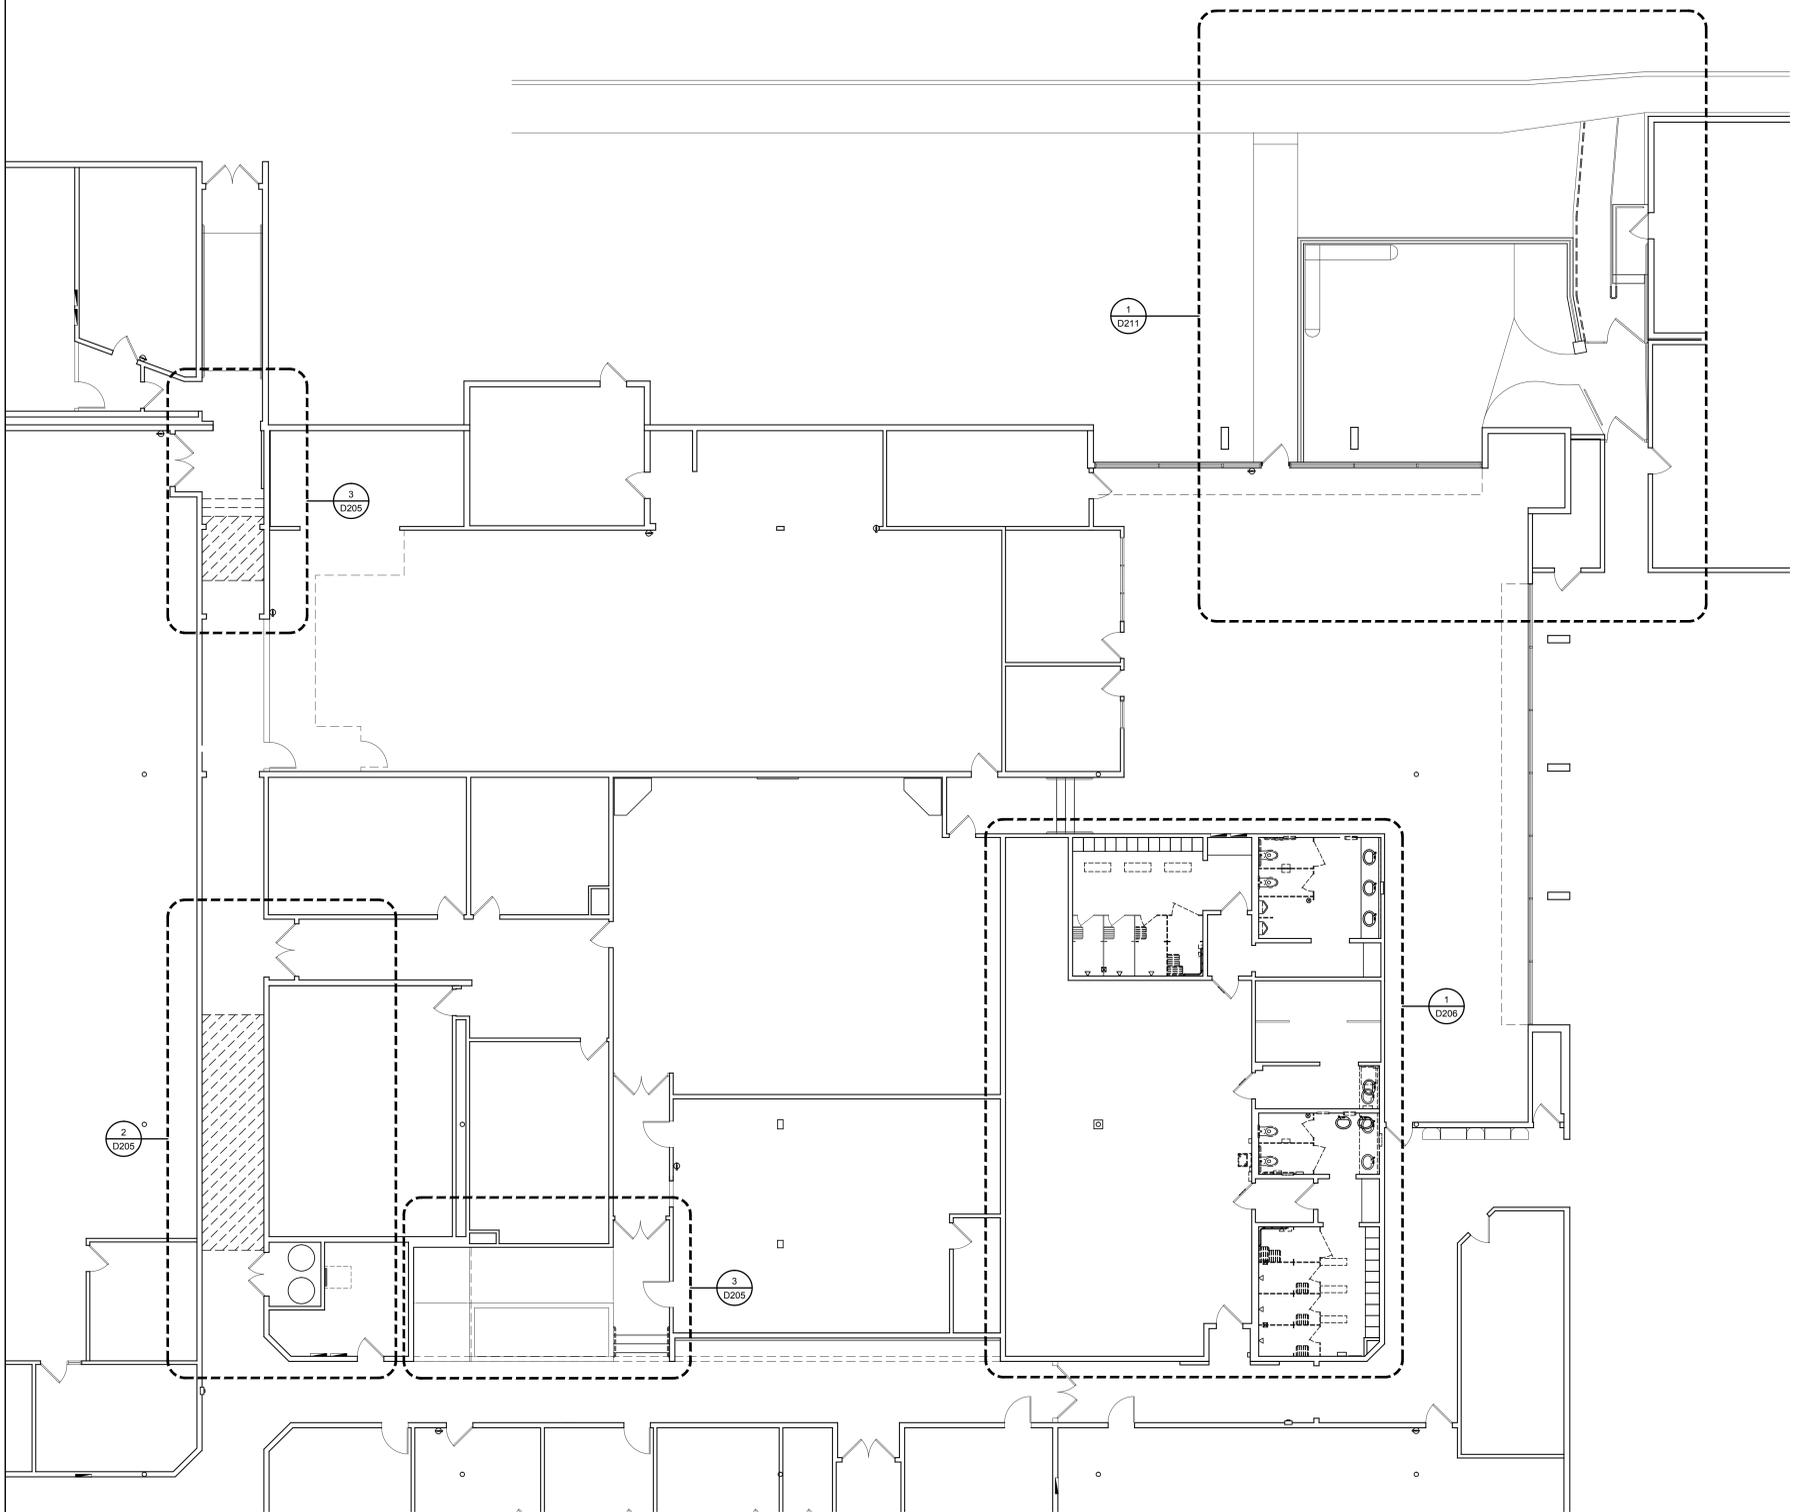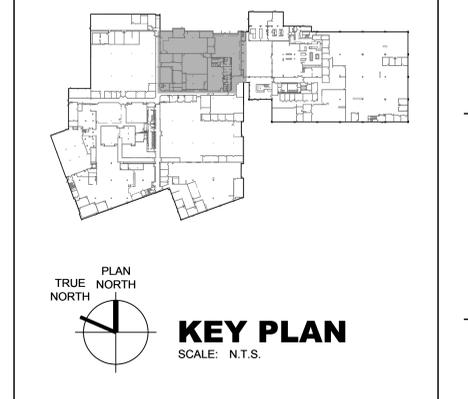

**1 NORTH BUILDING - ENLARGED NE CORNER DEMOLITION PLAN**  
 SCALE: 1/8" = 1'-0"

**MONTEREY COUNTY GOVERNMENT CENTER**  
**SCHILLING PLACE - ADA UPGRADES**  
 ALTERNATE No. 3  
 MONTEREY COUNTY GOVERNMENT CENTER  
 1441 SCHILLING PLACE  
 SALINAS, CA 93901  
 APN. NO.: 177-181-024

JOB NO.  
**14105.1**  
 PRINT DATE: 2.2.2016  
 DRAWN BY: JTI  
 CHECKED BY: PS  
 SET ISSUED:

SHEET NAME:  
**NORTH BLD'G.  
 NE CORNER  
 DEMO PLAN**

SHEET NO:

**D202**

**DEMOLITION GENERAL NOTES**

1. SEE SHEET D200 FOR GENERAL NOTES APPLICABLE TO ALL DEMOLITION SHEETS.

**LEGEND**

	EXISTING WALL TO REMAIN INTACT		EXISTING WALL TO BE DEMOLISHED.
	EXISTING WINDOW TO REMAIN INTACT		EXISTING DOOR TO BE REMOVED & SAVED FOR POTENTIAL REUSE.
	EXISTING DOOR TO REMAIN INTACT		EXISTING ITEM TO BE DEMOLISHED.



**WALD RUHNKE & DOST ARCHITECTS LLP**

2340 GARDEN ROAD, SUITE 100


MONTEREY, CALIFORNIA 93940

PHONE: 831.649.4642

FAX: 831.649.3530

WWW.WRDARCH.COM

THE USE OF THE PLANS AND SPECIFICATIONS IS RESTRICTED TO THE ORIGINAL SITE FOR WHICH THEY WERE PREPARED, AND PUBLICATION HEREOF IS EXPRESSLY LIMITED TO SUCH USE. REUSE, REPRODUCTION OR PUBLICATION BY ANY METHOD IN WHICHEVER OR IN PART IS PROHIBITED. TITLE TO THE PLANS AND SPECIFICATIONS REMAINS WITH THE ARCHITECT AND VISUAL CONTACT WITH THEM CONSTITUTES PRIMA FACIE EVIDENCE OF THE ACCEPTANCE OF THESE RESTRICTIONS.

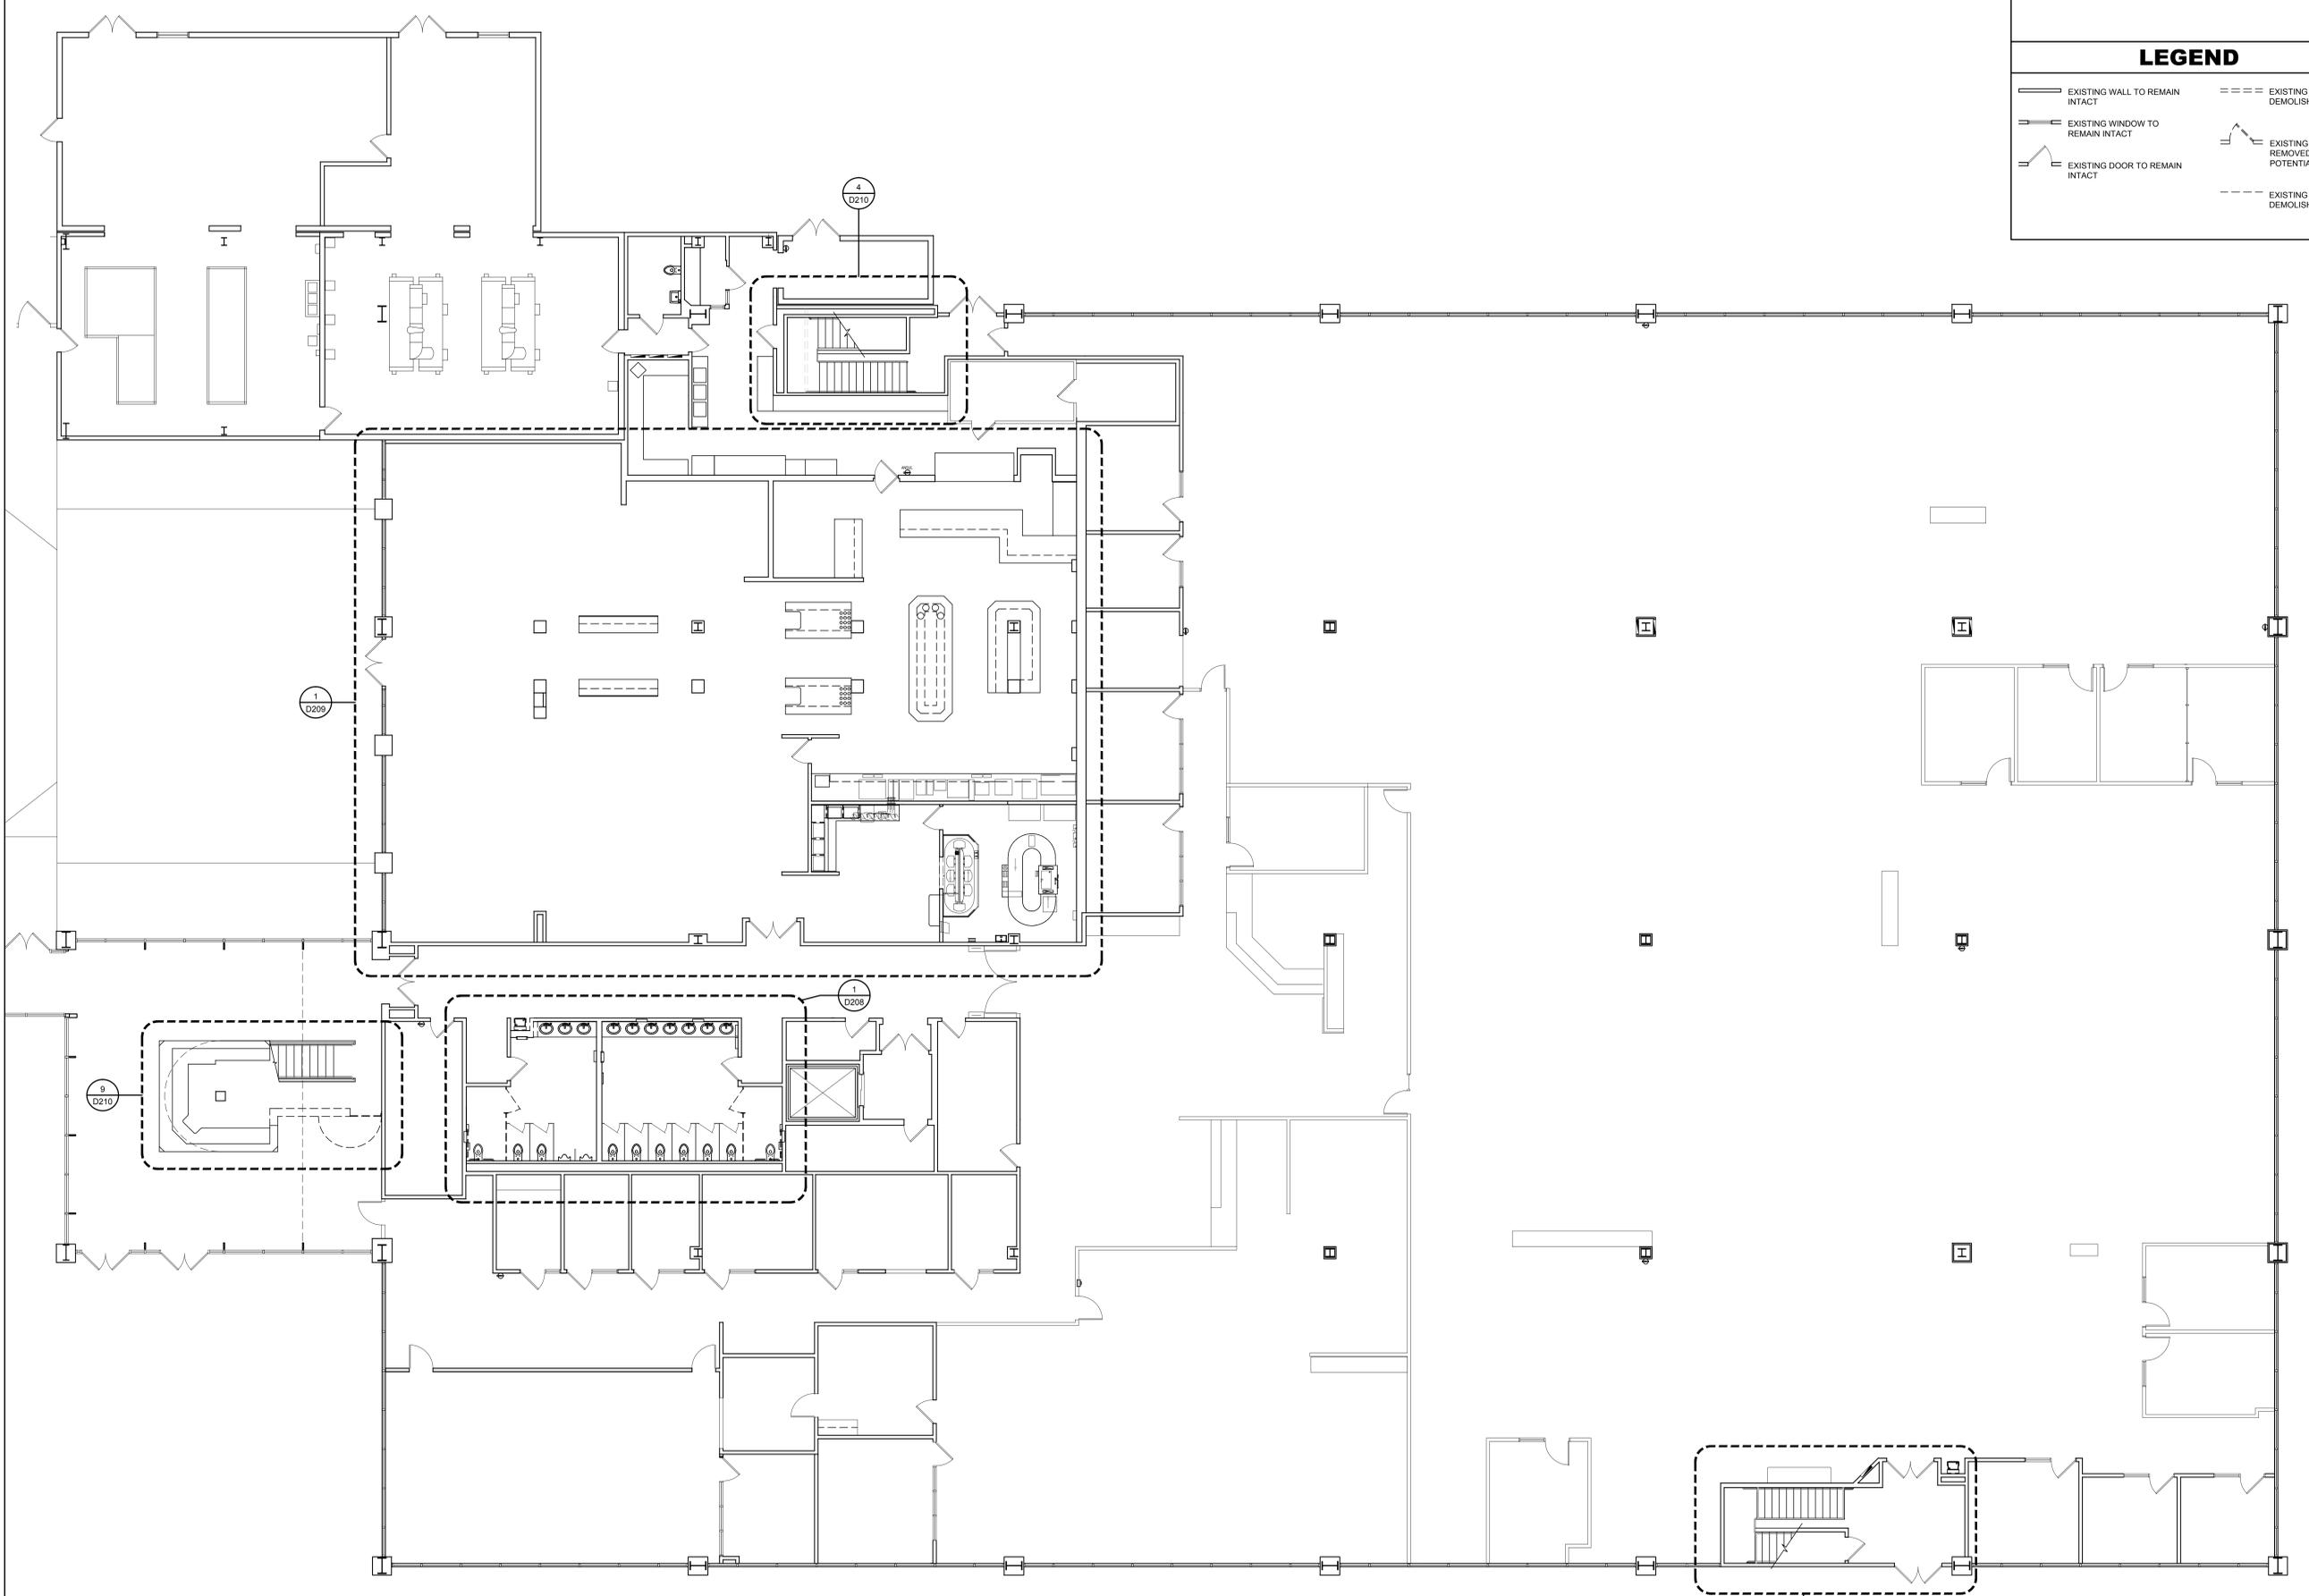

**1 SOUTH BUILDING FIRST FLOOR DEMOLITION PLAN**  
SCALE: 1/8" = 1'-0"

**MONTEREY COUNTY GOVERNMENT CENTER  
SCHILLING PLACE - ADA UPGRADES**  
ALTERNATE No. 3  
MONTEREY COUNTY GOVERNMENT CENTER  
1441 SCHILLING PLACE  
SALINAS, CA 98901  
APN. NO.: 177-181-024

JOB NO. 14105.1  
PRINT DATE: 2.2.2016  
DRAWN BY: JTI  
CHECKED BY: PS  
SET ISSUED:

SHEET NAME:  
**SOUTH BLD'G.  
FIRST FLOOR  
DEMO PLAN**

SHEET NO.:

**D203**

# DEMOLITION GENERAL NOTES


1. SEE SHEET D200 FOR GENERAL NOTES APPLICABLE TO ALL DEMOLITION SHEETS.

## LEGEND

- EXISTING WALL TO REMAIN INTACT
- EXISTING WINDOW TO REMAIN INTACT
- EXISTING DOOR TO REMAIN INTACT
- EXISTING WALL TO BE DEMOLISHED.
- EXISTING DOOR TO BE REMOVED & SAVED FOR POTENTIAL REUSE.
- EXISTING ITEM TO BE DEMOLISHED.

**50**  
**WR&D**  
**WALD RUHNKE & DOST ARCHITECTS LLP**  
2340 GARDEN ROAD, SUITE 100  
MONTEREY, CALIFORNIA 93940  
PHONE: 831.649.4642  
FAX: 831.649.3530  
WWW.WRDARCH.COM

THE USE OF THE PLANS AND SPECIFICATIONS IS RESTRICTED TO THE ORIGINAL SITE FOR WHICH THEY WERE PREPARED, AND PUBLICATION HEREIN IS EXPRESSLY LIMITED TO SUCH USE. REUSE, REPRODUCTION OR PUBLICATION BY ANY METHOD IN WHICHEVER OR IN PART IS PROHIBITED. TITLE TO THE PLANS AND SPECIFICATIONS REMAINS WITH THE ARCHITECT AND VISUAL CONTACT WITH THEM CONSTITUTES PRIMA FACIE EVIDENCE OF THE ACCEPTANCE OF THESE RESTRICTIONS.

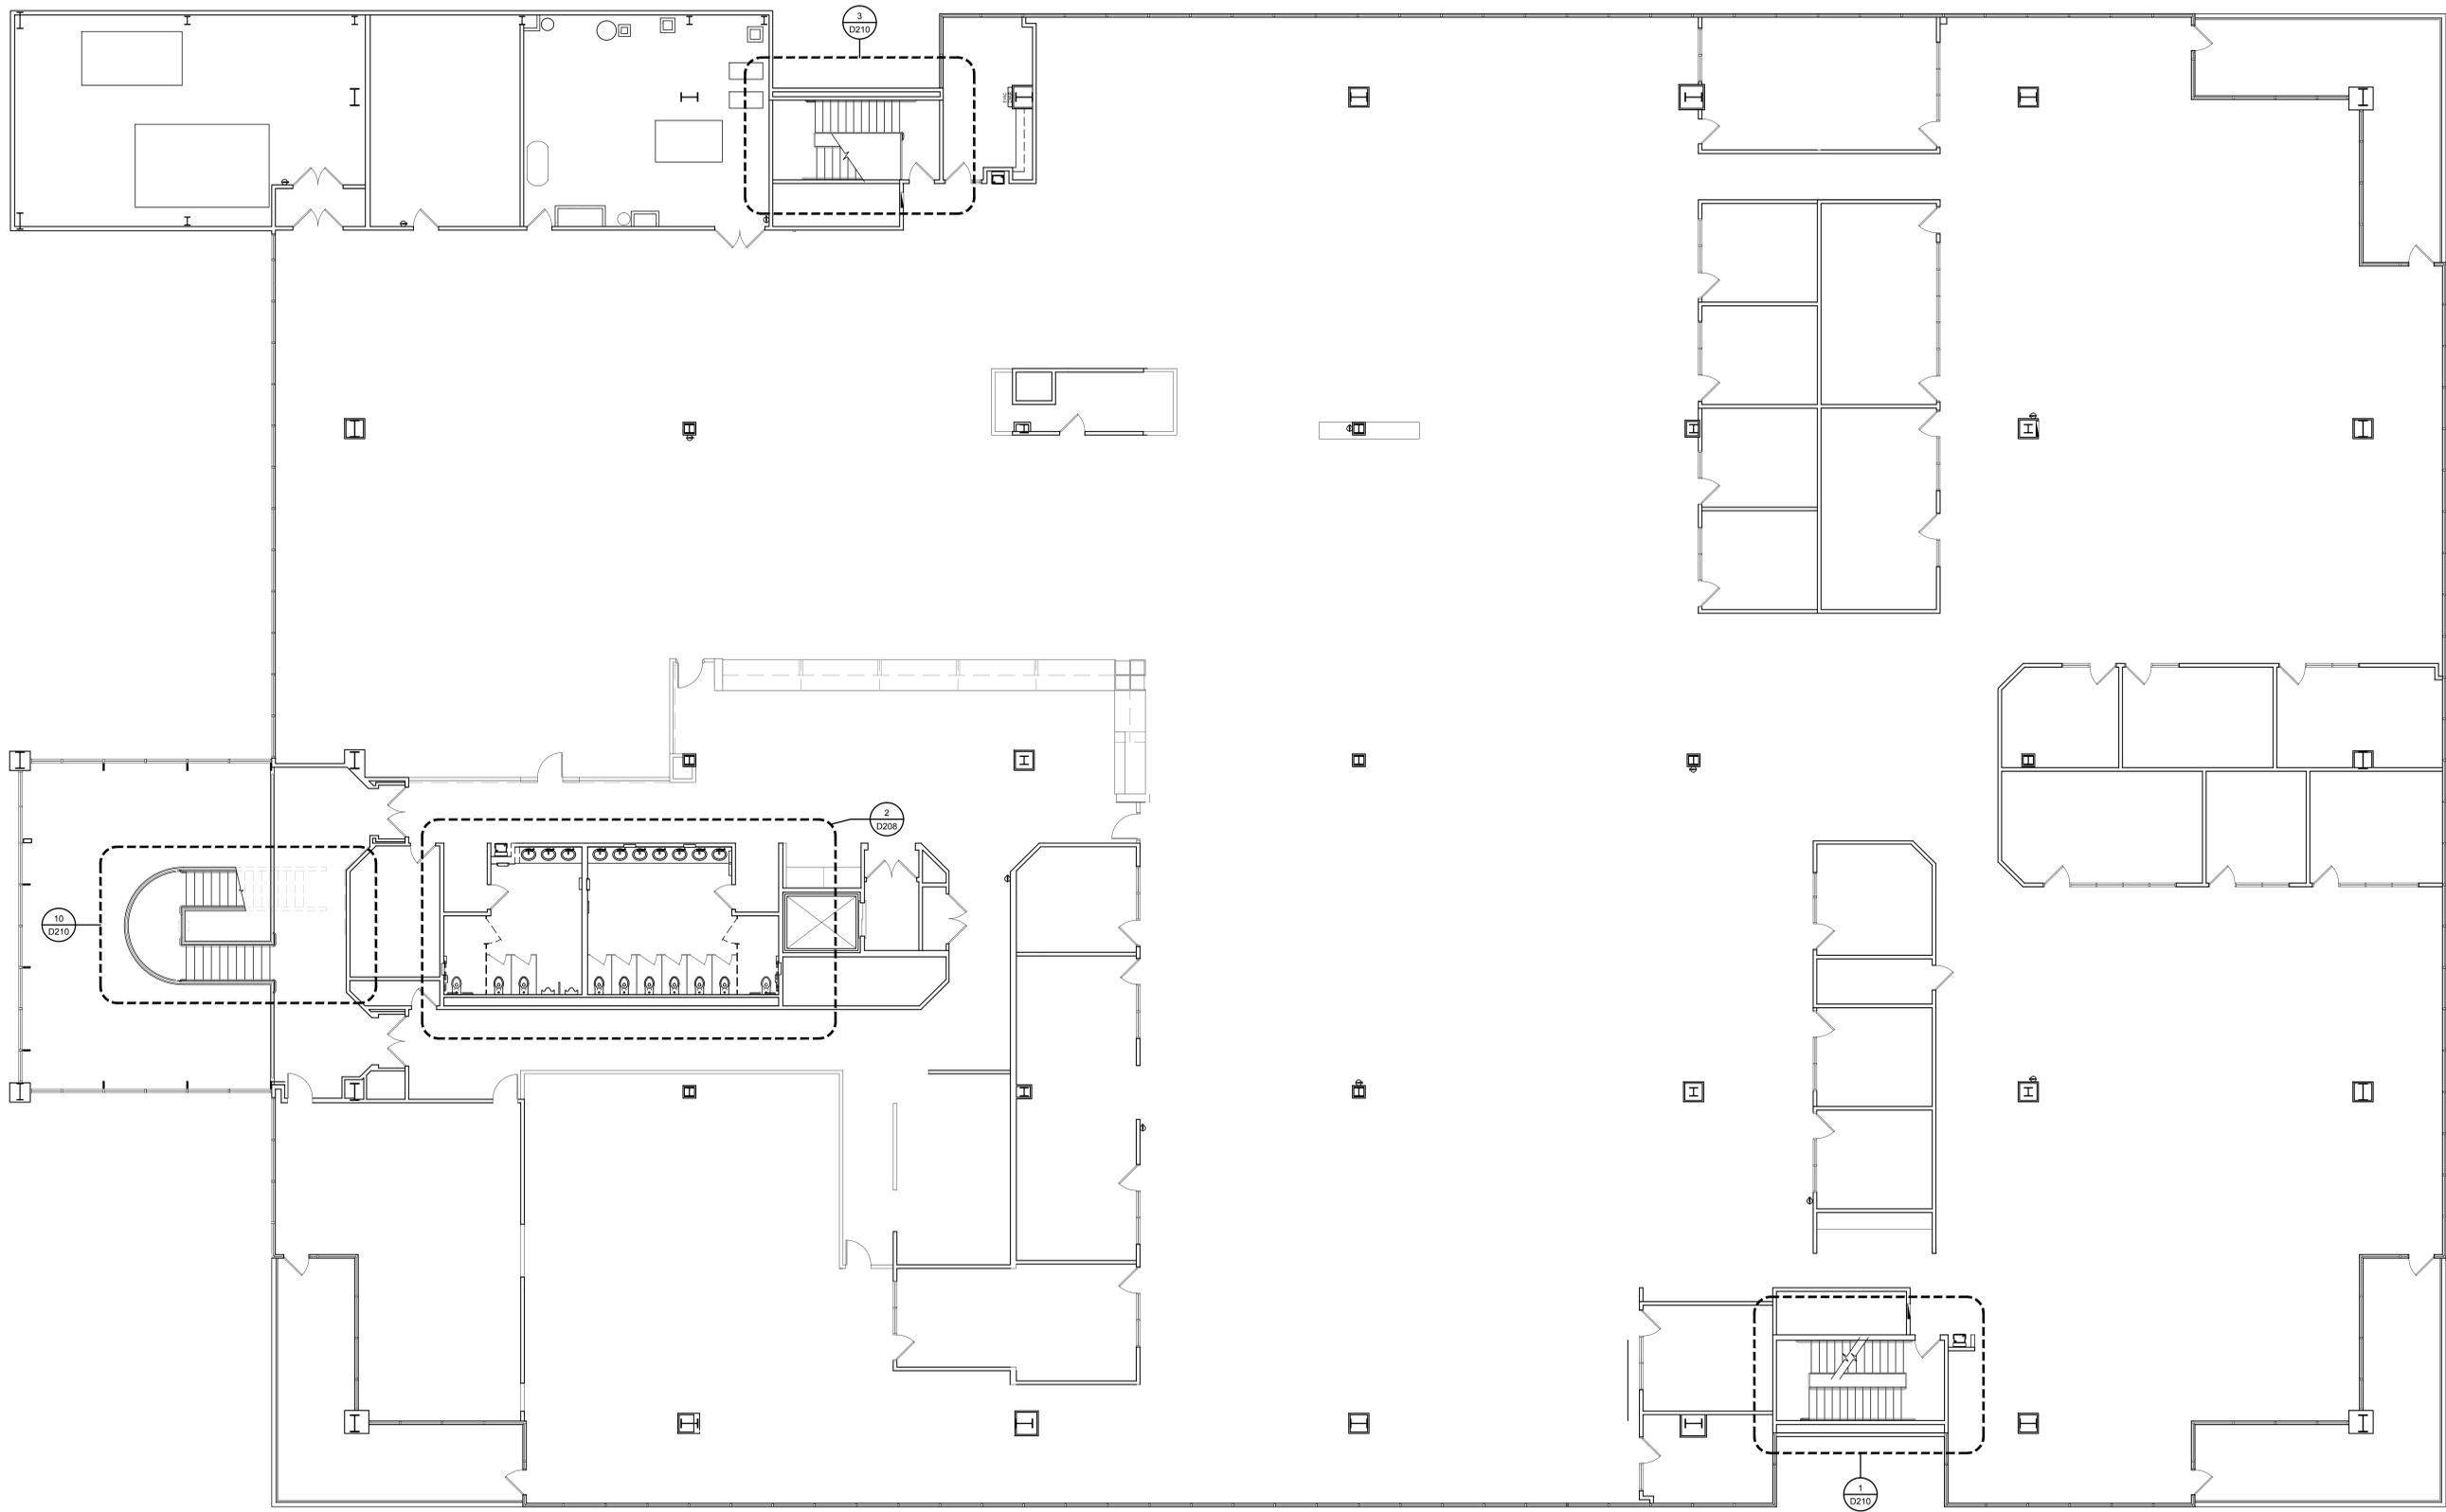

**1 SOUTH BUILDING SECOND FLOOR DEMOLITION PLAN**  
SCALE: 1/8" = 1'-0"

**MONTEREY COUNTY GOVERNMENT CENTER  
SCHILLING PLACE - ADA UPGRADES**  
ALTERNATE No. 3  
APN. NO.: 177-181-024

MONTEREY COUNTY GOVERNMENT CENTER  
1441 SCHILLING PLACE  
SALINAS, CA 98901

JOB NO. 14105.1  
PRINT DATE: 2.2.2016  
DRAWN BY:  
CHECKED BY:  
SET ISSUED:

SHEET NAME:  
**SOUTH BLD'G.  
SECOND FLR.  
DEMO PLAN**

SHEET NO.:

**D204**

**DEMOLITION GENERAL NOTES**

1. SEE SHEET D200 FOR GENERAL NOTES APPLICABLE TO ALL DEMOLITION SHEETS.

**50**



**WALD RUHNKE & DOST ARCHITECTS LLP**

2340 GARDEN ROAD, SUITE 100  
 MONTEREY, CALIFORNIA 93940  
 PHONE: 831.649.4642  
 FAX: 831.649.3530  
 WWW.WRDARCH.COM

THE USE OF THE PLANS AND SPECIFICATIONS IS RESTRICTED TO THE ORIGINAL SITE FOR WHICH THEY WERE PREPARED, AND PUBLICATION HEREOF IS EXPRESSLY LIMITED TO SUCH USE. REUSE, REPRODUCTION OR REPLICATION BY ANY METHOD OR IN WHICHEVER MANNER IS PROHIBITED. TITLE TO THE PLANS AND SPECIFICATIONS REMAINS WITH THE ARCHITECT AND VISUAL CONTACT WITH THEM CONSTITUTES PRIMA FACIE EVIDENCE OF THE ACCEPTANCE OF THESE RESTRICTIONS.

**DEMOLITION NOTES**

THE DEMOLITION NOTES THAT FOLLOW APPLY TO THE DRAWING(S) ON THIS SHEET ONLY. REFER TO FOLLOWING SHEETS FOR NOTES THAT ARE APPLICABLE TO THOSE DRAWINGS.

- D01 REMOVE EXISTING HANDRAILS.
- D02 REWORK EXISTING RAMP TO ACCOMMODATE NEW RAMP SLOPE. SEE SHEET A205.
- D03 REMOVE PORTION OF EXISTING RAISED ACCESS FLOORING.
- D04 REMOVE AND RELOCATE EXISTING RAISED ACCESS STEPS. REFER TO NEW FLOOR PLAN FOR NEW LOCATION.


**KEY NOTES**

THE KEY NOTES THAT FOLLOW APPLY TO THE DRAWING(S) ON THIS SHEET ONLY. REFER TO FOLLOWING SHEETS FOR NOTES THAT ARE APPLICABLE TO THOSE DRAWINGS.


- 1 EXISTING RAISED FLOOR TO REMAIN.
- 2 EXISTING RAMP TO REMAIN.
- 3 EXISTING LANDING TO REMAIN.
- 4 EXISTING PLANTER BOX TO REMAIN.
- 5 EXISTING STEPS TO REMAIN.
- 6 EXISTING UTILITY ROOM (WATER HEATERS) SHOWN FOR REFERENCE ONLY. NO WORK TO OCCUR.

**LEGEND**


- |                                  |  |
|----------------------------------|--|
| EXISTING WALL TO REMAIN INTACT   | EXISTING WALL TO BE DEMOLISHED.                          |
| EXISTING WINDOW TO REMAIN INTACT | EXISTING DOOR TO BE REMOVED & SAVED FOR POTENTIAL REUSE. |
| EXISTING DOOR TO REMAIN INTACT   | EXISTING ITEM TO BE DEMOLISHED.                          |

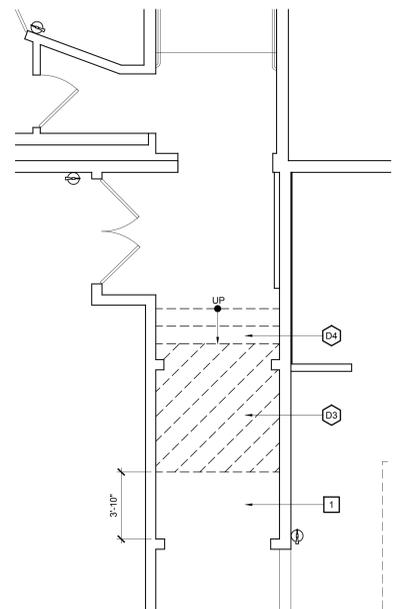

**3 NORTH BUILDING RAISED ACCESS STAIRWAY**  
 SCALE: 1/4" = 1'-0"

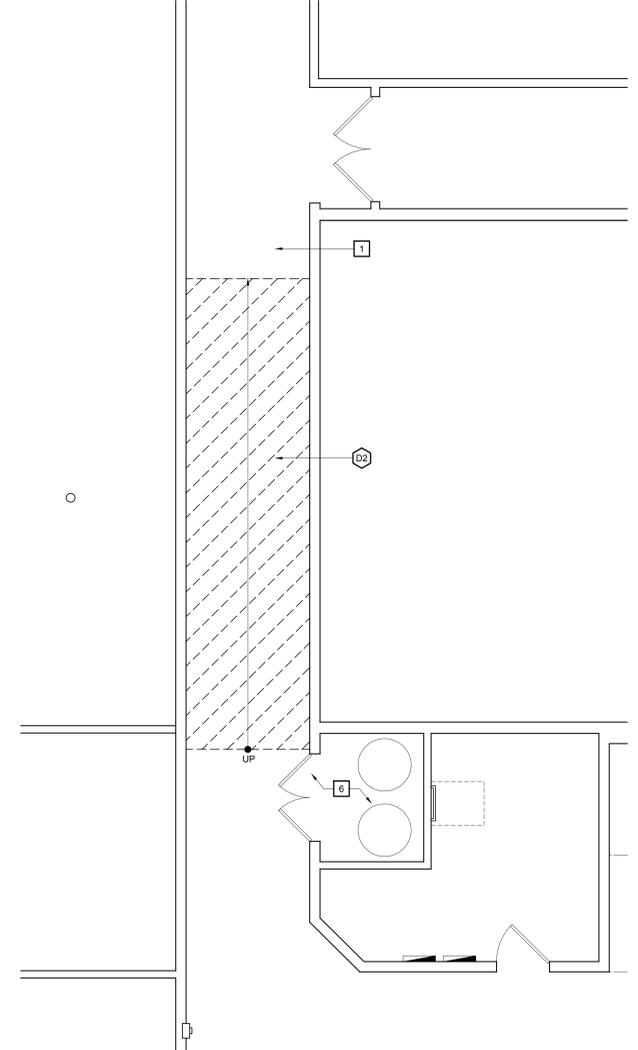

**2 NORTH BUILDING NORTH HALLWAY RAMP**  
 SCALE: 1/4" = 1'-0"

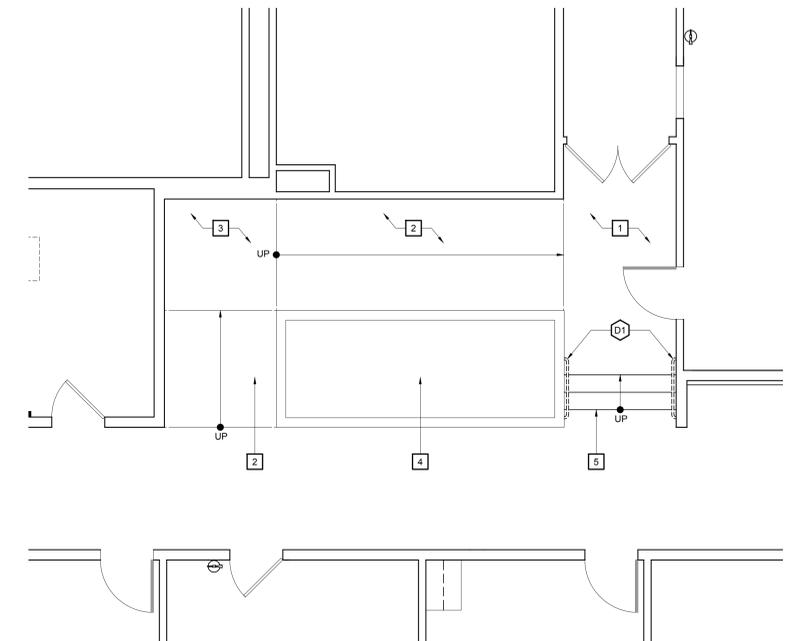

**1 NORTH BUILDING - CENTRAL RAMP AND RAILS DEMOLITION PLAN**  
 SCALE: 1/4" = 1'-0"

MONTEREY COUNTY GOVERNMENT CENTER  
 SCHILLING PLACE - ADA UPGRADES  
 ALTERNATE No. 3  
 APN. NO.: 177-181-024

MONTEREY COUNTY GOVERNMENT CENTER  
 1441 SCHILLING PLACE  
 SALINAS, CA 93901

JOB NO.  
**14105.1**

PRINT DATE:  
 PLOT DATE: 2.2.2016

DRAWN BY:  
 CHECKED BY:  
 SET ISSUED:

SHEET NAME:  
**NORTH BLD'G.  
 RAMP, RAILS,  
 STAIRS DEMO**

SHEET NO.:  
**D205**

**DEMOLITION GENERAL NOTES**

- SEE SHEET D200 FOR GENERAL NOTES APPLICABLE TO ALL DEMOLITION SHEETS.
- SEE PROPOSED FLOOR PLANS FOR NOTES REGARDING PATCHING AND REPAIR OF EXISTING FLOOR AND WALL TILE AND OTHER EXISTING FINISHES.

**DEMOLITION NOTES**

THE DEMOLITION NOTES THAT FOLLOW APPLY TO THE DRAWING(S) ON THIS SHEET ONLY. REFER TO FOLLOWING SHEETS FOR NOTES THAT ARE APPLICABLE TO THOSE DRAWINGS.

- D1 REMOVE COUNTERTOP / BACKSPASH AND STORE FOR RE-USE.
- D2 REMOVE EXISTING PAPER TOWEL DISPENSER.
- D3 REMOVE EXISTING PAPER TOWEL DISPENSER AND STORE FOR RE-USE. REFER TO PROPOSED FLOOR PLAN AND INTERIOR ELEVATION FOR NEW LOCATION AND MOUNTING HEIGHT.
- D4 REMOVE EXISTING SHOWER CONTROLS, SHOWER HEAD / SPRAY UNIT, AND VERTICAL BAR.
- D5 REMOVE EXISTING MIRROR.
- D6 REMOVE SANITARY NAPKIN/TAMPON DISPENSER AND STORE FOR RE-USE. REFER TO PROPOSED FLOOR PLAN AND INTERIOR ELEVATION FOR NEW LOCATION AND MOUNTING HEIGHT.
- D7 REMOVE EXISTING COUNTERTOP.
- D8 REMOVE EXISTING URINAL PARTITION AND STORE FOR RE-USE. REFER TO PROPOSED FLOOR PLAN AND INTERIOR ELEVATION FOR NEW LOCATION AND MOUNTING HEIGHT.
- D9 REMOVE EXISTING TOILET AND STORE FOR RE-USE (AS REQUIRED, TWO TOTAL WILL BE REQUIRED TO BE RE-USED). REFER TO PROPOSED FLOOR PLAN AND INTERIOR ELEVATION FOR NEW LOCATION AND MOUNTING HEIGHT.
- D10 REMOVE EXISTING TOILET PARTITION.
- D11 REMOVE EXISTING GRAB BAR.
- D12 REMOVE EXISTING TOILET SEAT COVER DISPENSER AND STORE FOR RE-USE. REFER TO PROPOSED FLOOR PLAN AND INTERIOR ELEVATION FOR NEW LOCATION AND MOUNTING HEIGHT.
- D13 REMOVE TOILET TISSUE DISPENSER, AND STORE FOR RE-USE. REFER TO PROPOSED FLOOR PLAN AND INTERIOR ELEVATION FOR NEW LOCATION AND MOUNTING HEIGHT.
- D14 REMOVE SYRINGE STORAGE DISPENSER AND STORE FOR RE-USE. REFER TO PROPOSED FLOOR PLAN AND INTERIOR ELEVATION FOR NEW LOCATION AND MOUNTING HEIGHT.
- D15 REMOVE EXISTING SANITARY NAPKIN/TAMPON DISPOSAL CONTAINER AND STORE FOR RE-USE. REFER TO PROPOSED FLOOR PLAN AND INTERIOR ELEVATION FOR NEW LOCATION AND MOUNTING HEIGHT.
- D16 REMOVE EXISTING ACCESSIBLE DOOR SIGNAGE.
- D17 REMOVE EXISTING SHOWER PARTITION AND SEAT.
- D18 REMOVE EXISTING BENCH.
- D19 REMOVE EXISTING HAND DRYER.
- D20 REMOVE EXISTING URINAL AND STORE FOR RE-USE (AS REQUIRED, ONE TOTAL WILL BE REQUIRED FOR RE-USE). REFER TO PROPOSED FLOOR PLAN AND INTERIOR ELEVATION FOR NEW LOCATION AND MOUNTING HEIGHT.
- D21 REMOVE EXISTING SINK, FAUCET, AND SOAP DISPENSER AND STORE FOR RE-USE. REFER TO PROPOSED FLOOR PLAN AND INTERIOR ELEVATION FOR NEW LOCATION AND MOUNTING HEIGHT.
- D22 REMOVE EXISTING SINK, FAUCET / LEVER AND SOAP DISPENSER.
- D23 REMOVE EXISTING COUNTERTOP MOUNTED SOAP DISPENSER AND STORE FOR RE-USE. REFER TO PROPOSED FLOOR PLAN FOR NEW LOCATION.
- D24 REMOVE EXISTING WALL MOUNTED SOAP DISPENSER AND STORE FOR RE-USE. REFER TO PROPOSED FLOOR PLAN AND INTERIOR ELEVATION FOR NEW LOCATION AND MOUNTING HEIGHT.
- D25 REMOVE EXISTING WALL MOUNTED HAND SANITIZER DISPENSER AND STORE FOR RE-USE. REFER TO PROPOSED FLOOR PLAN AND INTERIOR ELEVATION FOR NEW LOCATION AND MOUNTING HEIGHT.
- D26 REMOVE EXISTING WATER FOUNTAIN.
- D27 REMOVE THERMOSTAT CONTROLS AND STORE FOR RE-USE. REFER TO PROPOSED FLOOR PLAN AND INTERIOR ELEVATION FOR NEW LOCATION AND MOUNTING HEIGHT.


**KEY NOTES**

THE KEY NOTES THAT FOLLOW APPLY TO THE DRAWING(S) ON THIS SHEET ONLY. REFER TO FOLLOWING SHEETS FOR NOTES THAT ARE APPLICABLE TO THOSE DRAWINGS.


- 1 EXISTING DRAIN TO REMAIN.
- 2 EXISTING SHOWER CONTROLS & SHOWER HEAD / SPRAY UNIT TO REMAIN.
- 3 EXISTING SOAP DISPENSER TO REMAIN.
- 4 EXISTING LOCKERS TO REMAIN.
- 5 EXISTING MIRROR TO REMAIN.
- 6 EXISTING CABINET TO REMAIN.
- 7 EXISTING GRAB BAR TO REMAIN.
- 8 EXISTING SHOWER PARTITION AND SEATS TO REMAIN.
- 9 EXISTING WALL MOUNTED WASTE RECEPTACLE TO REMAIN.
- 10 EXISTING RECESSED TOILET SEAT COVER DISPENSER TO REMAIN.
- 11 EXISTING RECESSED PAPER TOWEL DISPENSER TO REMAIN.
- 12 EXISTING COUNTER, SINK, FAUCET AND SOAP DISPENSER TO REMAIN.
- 13 EXISTING UIC REFRIGERATOR TO BE RELOCATED, SEE FLOOR PLAN.
- 14 EXISTING HAIR DRYER TO REMAIN.

**LEGEND**


- EXISTING WALL TO REMAIN INTACT
- - - EXISTING ITEM TO BE DEMOLISHED.
- EXISTING DOOR TO REMAIN INTACT

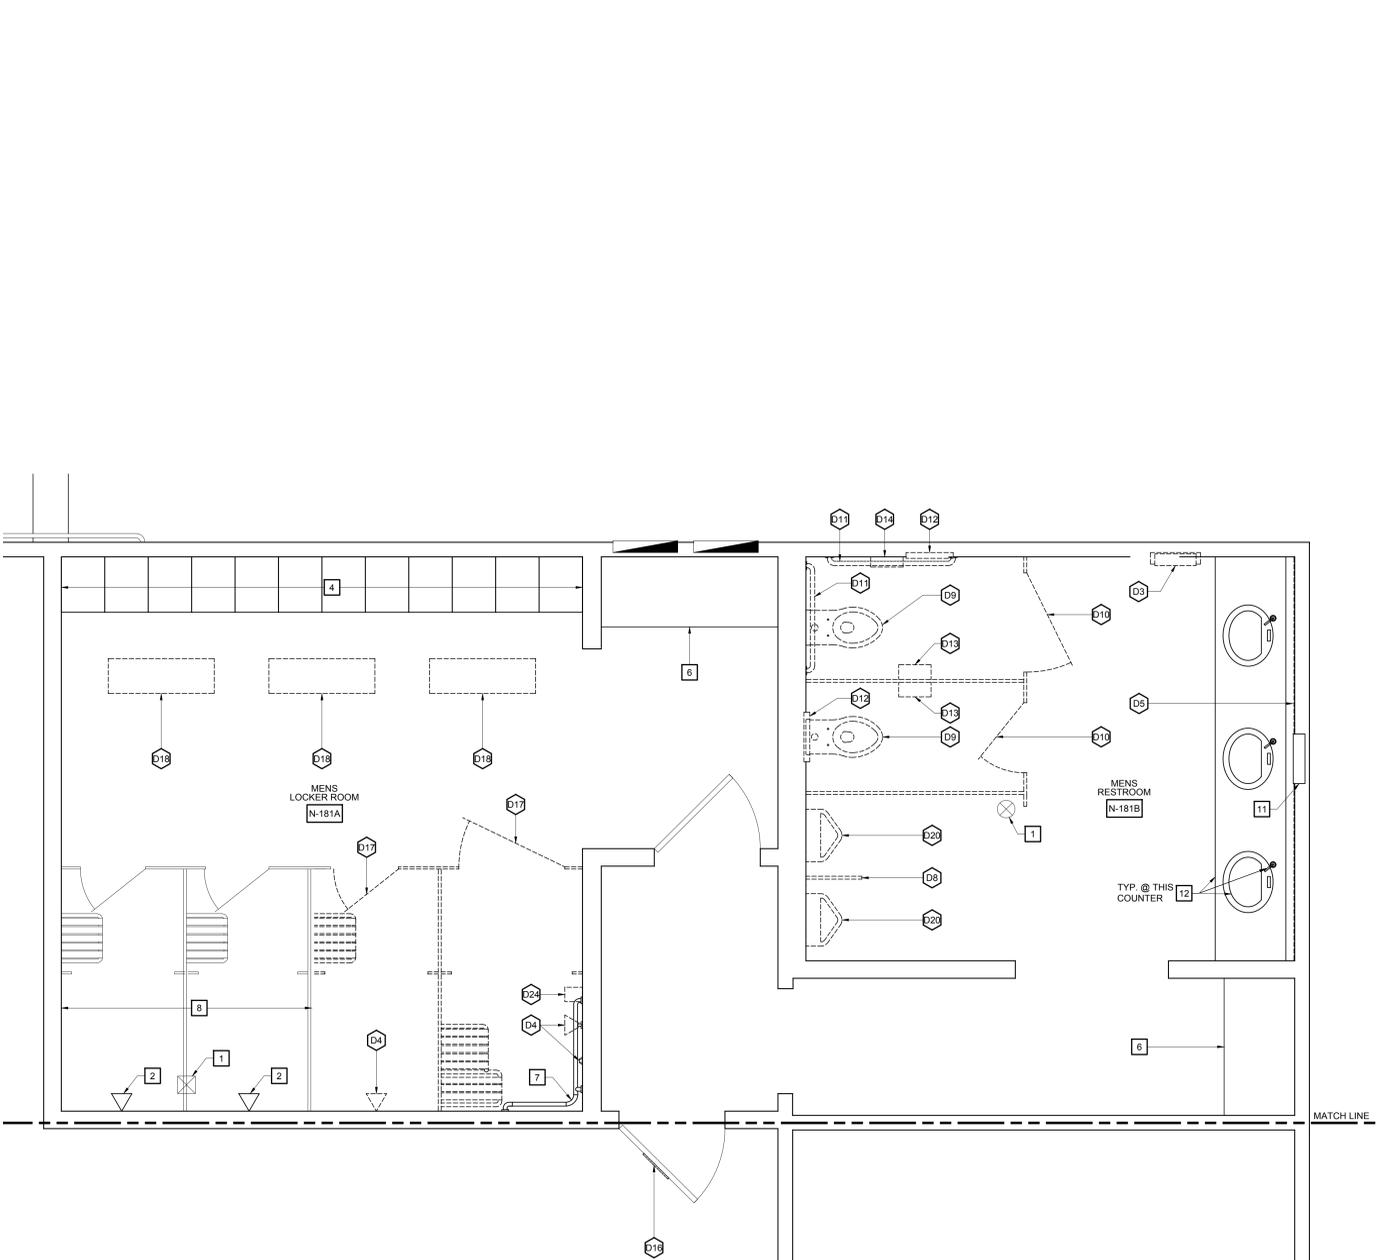


**2 NORTH BUILDING - FITNESS CENTER MENS RESTROOM DEMOLITION PLAN**  
SCALE: 1/2" = 1'-0"

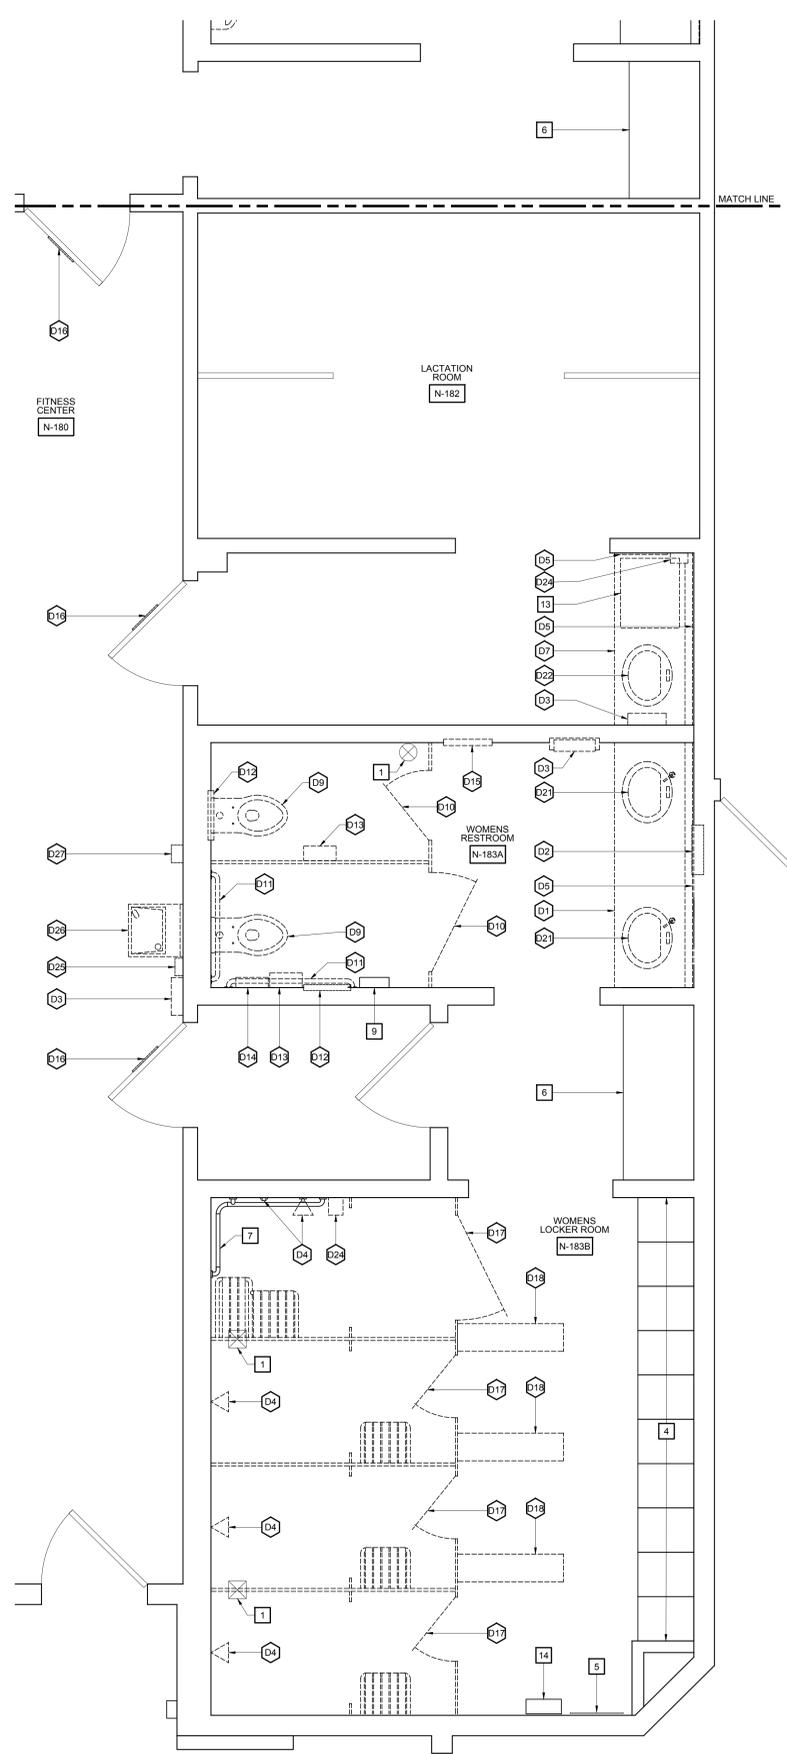

**1 NORTH BUILDING - FITNESS CENTER WOMENS RESTROOM DEMOLITION PLAN**  
SCALE: 1/2" = 1'-0"

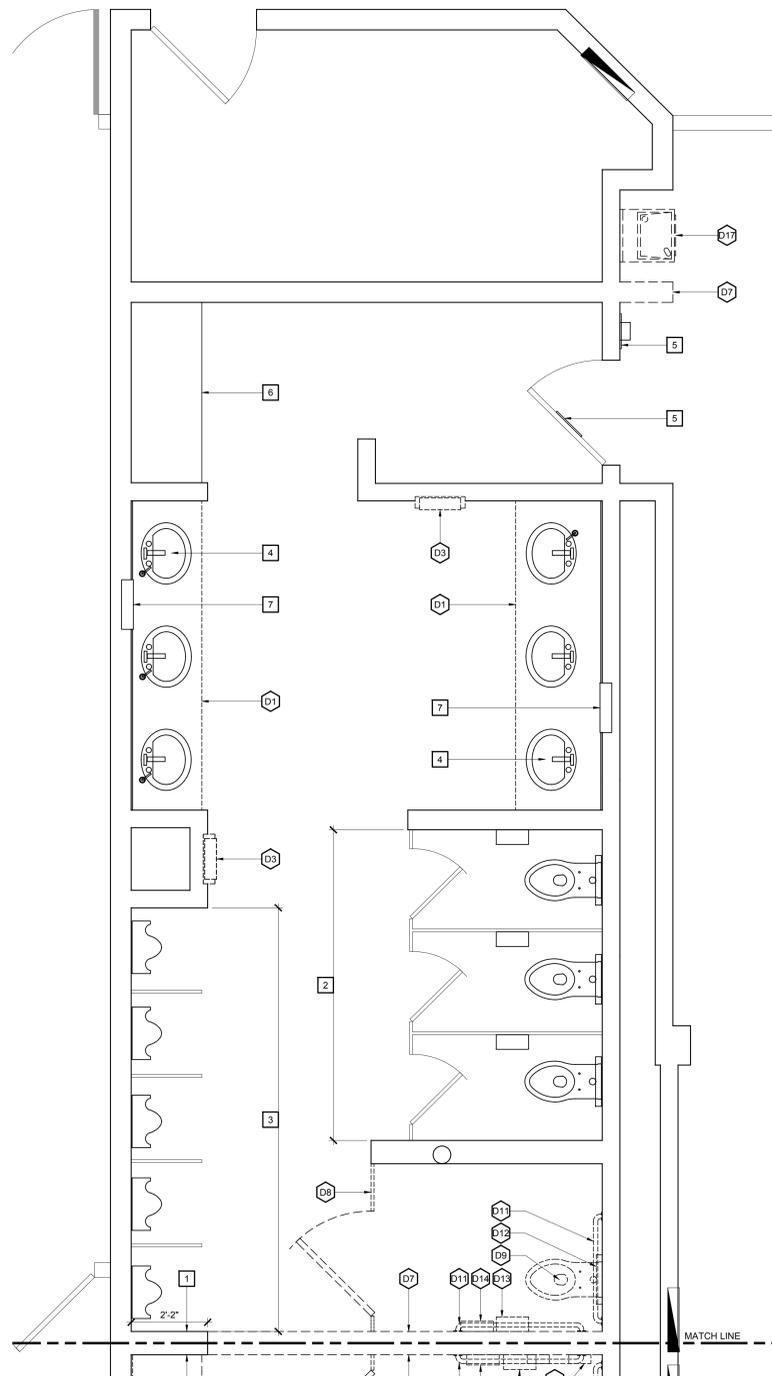

**2 NORTH BUILDING - MENS RESTROOMS DEMOLITION PLAN**  
SCALE: 1/2" = 1'-0"

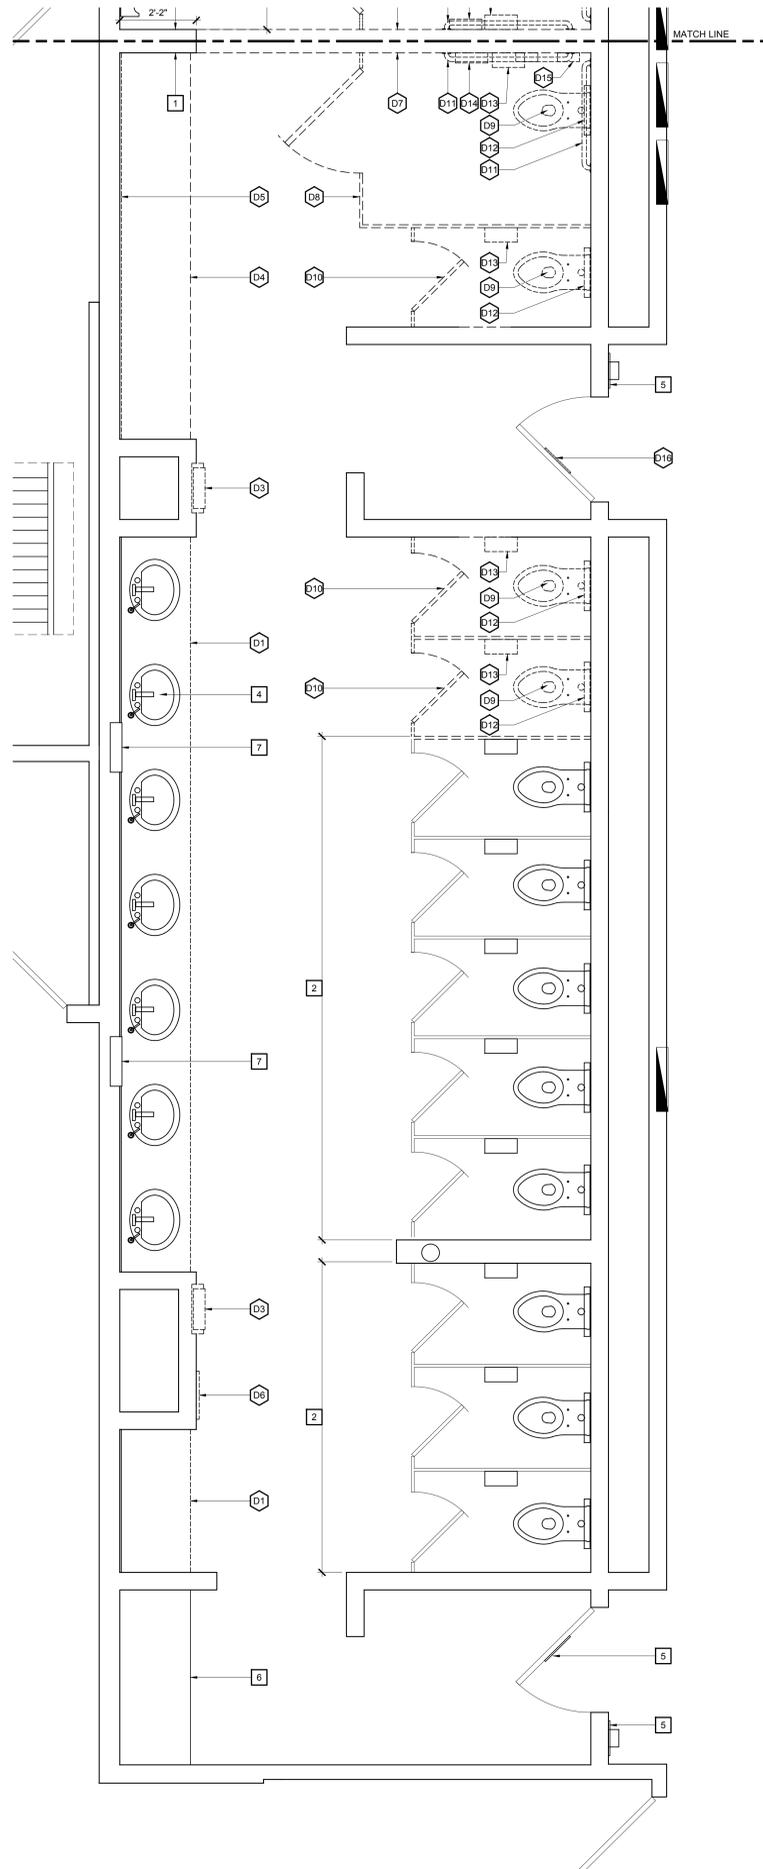

**1 NORTH BUILDING - WOMENS RESTROOMS DEMOLITION PLAN**  
SCALE: 1/2" = 1'-0"

**DEMOLITION GENERAL NOTES**

- SEE SHEET D200 FOR GENERAL NOTES APPLICABLE TO ALL DEMOLITION SHEETS.
- SEE PROPOSED FLOOR PLANS FOR NOTES REGARDING PATCHING AND REPAIR OF EXISTING FLOOR AND WALL TILE AND OTHER EXISTING FINISHES.


**DEMOLITION NOTES**

- THE DEMOLITION NOTES THAT FOLLOW APPLY TO THE DRAWING(S) ON THIS SHEET ONLY. REFER TO FOLLOWING SHEETS FOR NOTES THAT ARE APPLICABLE TO THOSE DRAWINGS:
- D1 LOWER COUNTERTOP w/SUPPORT BRACKETS TO ACCESSIBLE HEIGHT, +34" MAX. CBC 11B-308.3.2.
  - D2 NOT USED.
  - D3 LOWER PAPER TOWEL DISPENSER TO ACCESSIBLE HEIGHT, +40" MAX. CBC 11B-603.5.
  - D4 REMOVE EXISTING COUNTERTOP AND STORE FOR POTENTIAL MODIFICATIONS AND REMOUNTING. SEE FLOOR PLAN FOR ANY NEW WORK TO OCCUR.
  - D5 REMOVE EXISTING MIRROR AND STORE FOR POTENTIAL MODIFICATION OR RE-USE AND REMOUNTING. SEE FLOOR PLAN FOR ANY NEW WORK TO OCCUR.
  - D6 LOWER SANITARY NAPKIN/TAMPON DISPENSER TO ACCESSIBLE HEIGHT, +40" MAX. CBC 11B-603.5.
  - D7 REMOVE PORTION OF EXISTING WALL.
  - D8 REMOVE EXISTING TOILET PARTITION. IF FEASIBLE, RELOCATE AND RE-USE.
  - D9 REMOVE AND RELOCATE EXISTING TOILET. SEE FLOOR PLAN.
  - D10 REMOVE EXISTING TOILET PARTITION. IF FEASIBLE RELOCATE AND RE-USE.
  - D11 REMOVE EXISTING GRAB BAR.
  - D12 REMOVE AND RELOCATE EXISTING TOILET SEAT COVER DISPENSER.
  - D13 REMOVE AND RELOCATE EXISTING TOILET TISSUE DISPENSER.
  - D14 REMOVE AND RELOCATE EXISTING SYRINGE DISPOSAL CONTAINER.
  - D15 REMOVE AND RELOCATE EXISTING SANITARY NAPKIN/TAMPON DISPOSAL CONTAINER.
  - D16 LOWER ACCESSIBLE DOOR SIGNAGE TO +60" MAX. CBC 11B-703.2.6.
  - D17 REMOVE EXISTING DRINKING FOUNTAIN. SEE FLOOR PLAN FOR NEW WORK.

**KEY NOTES**

- THE KEY NOTES THAT FOLLOW APPLY TO THE DRAWING(S) ON THIS SHEET ONLY. REFER TO FOLLOWING SHEETS FOR NOTES THAT ARE APPLICABLE TO THOSE DRAWINGS.
- 1 PORTION OF EXISTING WALL TO REMAIN.
  - 2 EXISTING TOILET STALLS TO REMAIN.
  - 3 EXISTING URINALS TO REMAIN.
  - 4 EXISTING SINKS TO REMAIN (LOWER WITH COUNTERTOP).
  - 5 EXISTING ACCESSIBLE SIGNAGE TO REMAIN EXCEPT WHERE NOTED OTHERWISE.
  - 6 EXISTING CABINET TO REMAIN.
  - 7 EXISTING PAPER TOWEL DISPENSER TO REMAIN.

**LEGEND**

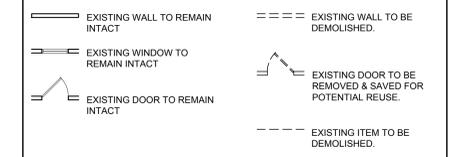

**50**  
**WR&D**  
**WALD RUHNKE & DOST ARCHITECTS LLP**  
2340 GARDEN ROAD, SUITE 100  
MONTEREY, CALIFORNIA 93940  
PHONE: 831.649.4642  
FAX: 831.649.3530  
WWW.WRDARCH.COM

**MONTEREY COUNTY GOVERNMENT CENTER**  
**SCHILLING PLACE - ADA UPGRADES**  
ALTERNATE No. 3  
AP.N. NO.: 177-181-024

MONTEREY COUNTY GOVERNMENT CENTER  
1441 SCHILLING PLACE  
SALINAS, CA 98901

JOB NO.  
**14105.1**

PRINT DATE:  
PLOT DATE: 2.2.2016  
DRAWN BY:  
CHECKED BY:  
SET ISSUED:

SHEET NAME:  
**NORTH BLD'G.  
RESTROOMS  
DEMO PLAN**

SHEET NO.:  
**D207**

# DEMOLITION GENERAL NOTES

1. SEE SHEET D200 FOR GENERAL NOTES APPLICABLE TO ALL DEMOLITION SHEETS.

## DEMOLITION NOTES

THE DEMOLITION NOTES THAT FOLLOW APPLY TO THE DRAWING(S) ON THIS SHEET ONLY. REFER TO FOLLOWING SHEETS FOR NOTES THAT ARE APPLICABLE TO THOSE DRAWINGS.

- D01 REMOVE PORTION OF COUNTERTOP AND MODIFY MIRROR TO ACCOMMODATE NEW WORK. SEE FLOOR PLAN.
- D02 LOWER PAPER TOWEL DISPENSER TO ACCESSIBLE HEIGHT, +40" MAX. CBC 11B-603.5. CBC 11B-603.5.
- D03 LOWER SANITARY NAPKIN/TAMPON DISPENSER TO ACCESSIBLE HEIGHT, +40" MAX. CBC 11B-603.5.
- D04 RELOCATE EXISTING TOILET PARTITION, IF FEASIBLE. SWITCH MENS AND WOMENS ACCESSIBLE STALL PARTITIONS AND DOORS TO ACHIEVE OPPOSITE DOOR SWING. SEE FLOOR PLAN FOR WORK TO OCCUR.
- D05 RELOCATE AND RESWING EXISTING TOILET PARTITION DOOR. SEE NOTE D4. SEE FLOOR PLAN FOR WORK TO OCCUR.
- D06 REMOVE EXISTING TOILET.
- D07 REMOVE EXISTING GRAB BAR.
- D08 REMOVE EXISTING TOILET SEAT COVER DISPENSER.
- D09 REMOVE TOILET TISSUE DISPENSER.
- D10 REMOVE AND RELOCATE SYRINGE DISPOSAL CONTAINER.
- D11 REMOVE PORTION OF WALL TO ACCOMMODATE NEW WORK. RELOCATE ANY PLUMBING CONNECTION AFFECTED.
- D12 RELOCATE EXISTING URINAL PARTITION. SEE FLOOR PLAN FOR WORK TO OCCUR.
- D13 REMOVE DRINKING FOUNTAIN. IF FEASIBLE, RE-USE PLUMBING FOR NEW WORK.

## KEY NOTES

THE KEY NOTES THAT FOLLOW APPLY TO THE DRAWING(S) ON THIS SHEET ONLY. REFER TO FOLLOWING SHEETS FOR NOTES THAT ARE APPLICABLE TO THOSE DRAWINGS.

- 1 EXISTING COUNTER TO REMAIN.
- 2 EXISTING SINKS TO REMAIN.
- 3 EXISTING TOILET STALLS TO REMAIN.
- 4 EXISTING URINALS TO REMAIN.
- 5 EXISTING URINAL PARTITION TO REMAIN.
- 6 EXISTING PAPER TOWEL DISPENSER TO REMAIN.
- 7 EXISTING SANITARY NAPKIN DISPOSAL CONTAINER TO REMAIN.
- 8 EXISTING MIRROR TO REMAIN.

## LEGEND

- EXISTING WALL TO REMAIN INTACT
- EXISTING WALL TO BE DEMOLISHED.
- EXISTING WINDOW TO REMAIN INTACT
- EXISTING WINDOW TO BE REMOVED & SAVED FOR POTENTIAL REUSE.
- EXISTING DOOR TO REMAIN INTACT
- EXISTING DOOR TO BE REMOVED & SAVED FOR POTENTIAL REUSE.
- EXISTING ITEM TO BE DEMOLISHED.

**50**

**WR&D**

**WALD RUHNKE & DOST ARCHITECTS LLP**

2340 GARDEN ROAD, SUITE 100  
MONTEREY, CALIFORNIA 93940  
PHONE: 831.649.4642  
FAX: 831.649.3530  
WWW.WRDARCH.COM

**MONTEREY COUNTY GOVERNMENT CENTER**  
**SCHILLING PLACE - ADA UPGRADES**

ALTERNATE No. 3

MONTEREY COUNTY GOVERNMENT CENTER  
1441 SCHILLING PLACE  
SALINAS, CA 98901

APN. NO.: 177-181-024

JOB NO.  
**14105.1**


PRINT DATE:  
PLOT DATE: 2.2.2016

DRAWN BY:  
CHECKED BY:  
SET ISSUED:


SHEET NAME:  
**SOUTH BLD'G.  
RESTROOMS  
DEMO PLAN**

SHEET NO.:  
**D208**

14105-1-0208

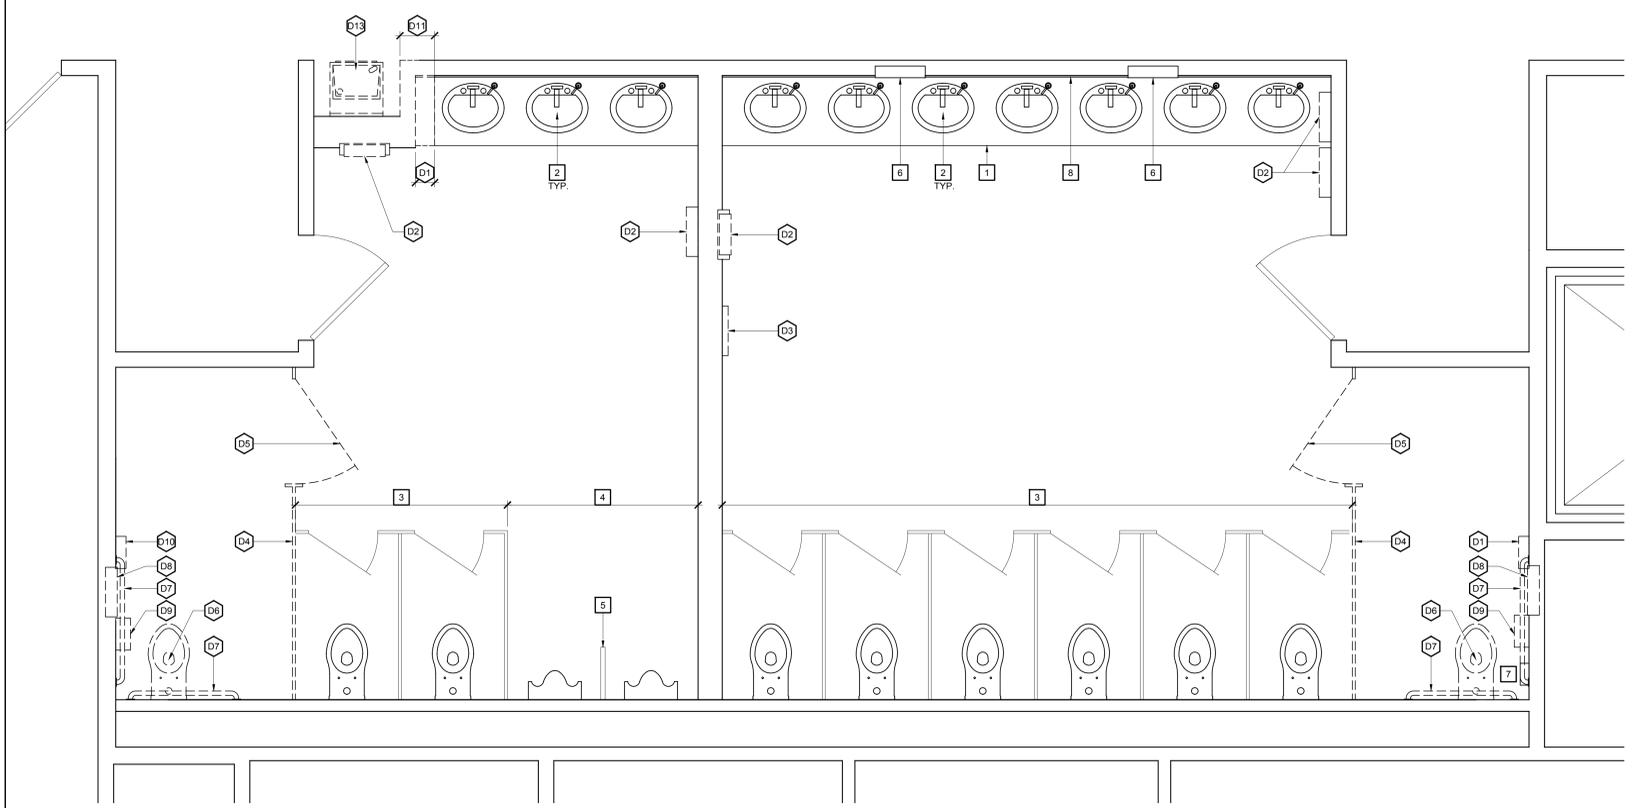

**1 SOUTH BUILDING - FIRST FLOOR RESTROOMS DEMOLITION PLAN**  
SCALE: 1/4" = 1'-0"

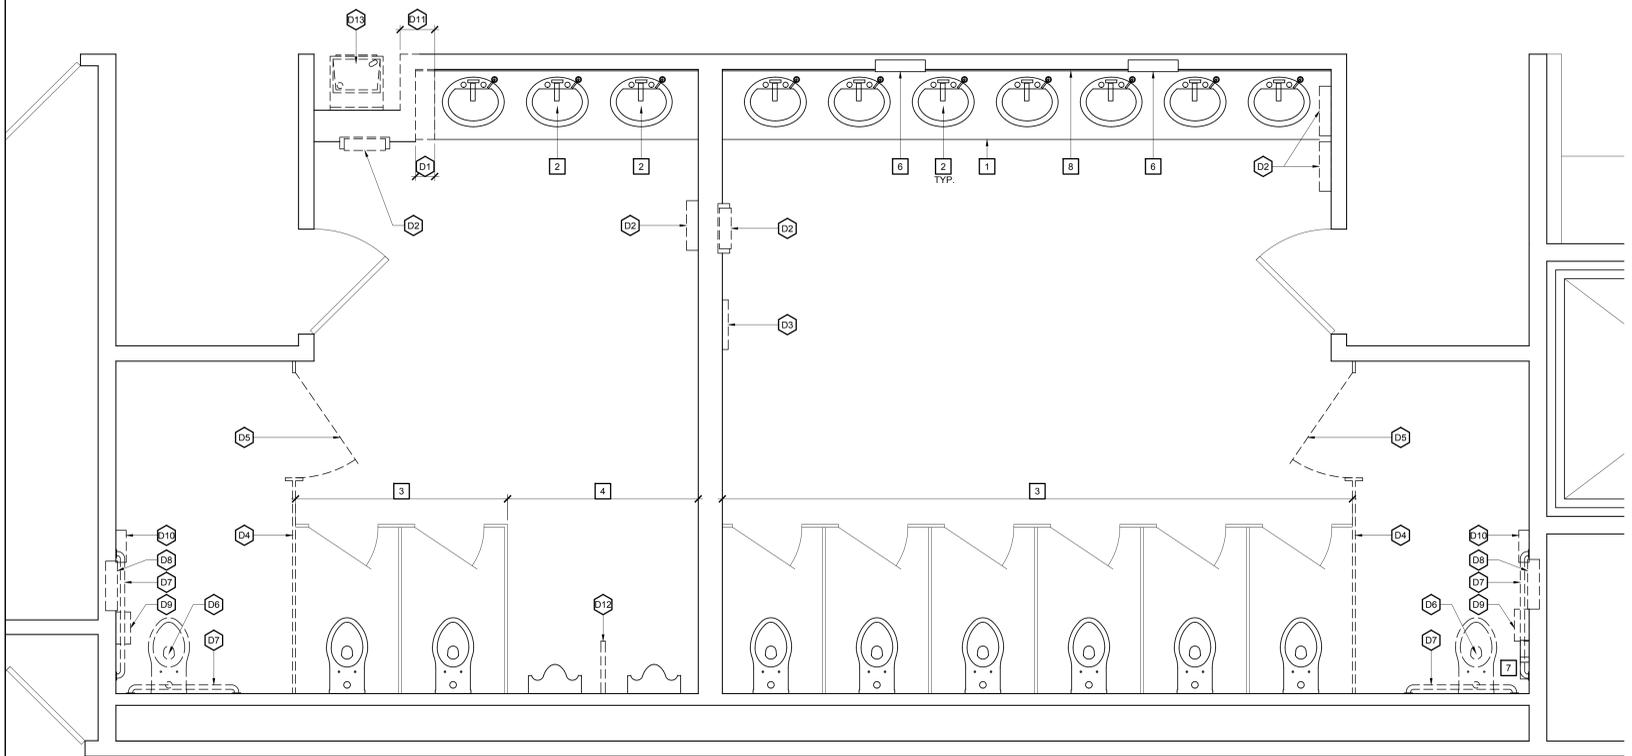

**2 SOUTH BUILDING - SECOND FLOOR RESTROOMS DEMOLITION PLAN**  
SCALE: 1/4" = 1'-0"



**DEMOLITION GENERAL NOTES**

1. SEE SHEET D200 FOR GENERAL NOTES APPLICABLE TO ALL DEMOLITION SHEETS.

**DEMOLITION NOTES**

THE DEMOLITION NOTES THAT FOLLOW APPLY TO THE DRAWING(S) ON THIS SHEET ONLY. REFER TO FOLLOWING SHEETS FOR NOTES THAT ARE APPLICABLE TO THOSE DRAWINGS:

- D1 CAREFULLY CUT, REMOVE AND SALVAGE COUNTER, LOW WALL IN ITS ENTIRETY. EXISTING SOLID SURFACE & PANELS FROM SALVAGED COUNTER TO BE MODIFIED.
- D2 REMOVE GATE AND JAMB. PATCH WALL.
- D3 END OF WOOD HANDRAIL TO BE MODIFIED TO ACCOMMODATE NEW WORK. SEE STAIRS PLAN.
- D4 END OF RAIL TO BE MODIFIED TO ACCOMMODATE NEW WORK. SEE STAIR PLANS.
- D5 REMOVE DOOR IN ITS ENTIRETY.
- D6 REMOVE DRINKING FOUNTAIN, IF FEASIBLE, RE-USE PLUMBING FOR NEW WORK.
- D7 REMOVE PORTION OF WALL TO ACCOMMODATE NEW WORK.

THE USE OF THE PLANS AND SPECIFICATIONS IS RESTRICTED TO THE ORIGINAL SITE FOR WHICH THEY WERE PREPARED, AND PUBLICATION HEREOF IS EXPRESSLY LIMITED TO SUCH USE. REUSE, REPRODUCTION OR REPRODUCTION IN ANY MANNER IN WHOLE OR IN PART IS PROHIBITED. TITLE TO THE PLANS AND SPECIFICATIONS REMAINS WITH THE ARCHITECT AND VISUAL CONTACT WITH THEM CONSTITUTES PRIMA FACIE EVIDENCE OF THE ACCEPTANCE OF THESE RESTRICTIONS.

**KEY NOTES**

THE KEY NOTES THAT FOLLOW APPLY TO THE DRAWING(S) ON THIS SHEET ONLY. REFER TO FOLLOWING SHEETS FOR NOTES THAT ARE APPLICABLE TO THOSE DRAWINGS.

- 1 NO WORK TO OCCUR AT THIS LEVEL.
- 2 PROTECT (E) CABINET AND FLOORING TO REMAIN FROM ANY DAMAGE DURING REMOVAL. PATCH AND REPAIR (E) AREAS TO MATCH (E) FINISH.

**LEGEND**

EXISTING WALL TO REMAIN INTACT	EXISTING WALL TO BE DEMOLISHED.
EXISTING WINDOW TO REMAIN INTACT	EXISTING DOOR TO BE REMOVED & SAVED FOR POTENTIAL REUSE.
EXISTING DOOR TO REMAIN INTACT	EXISTING ITEM TO BE DEMOLISHED.

MONTEREY COUNTY GOVERNMENT CENTER  
 SCHILLING PLACE - ADA UPGRADES  
 ALTERNATE No. 3  
 APN. NO.: 177-181-024


MONTEREY COUNTY GOVERNMENT CENTER  
 1441 SCHILLING PLACE  
 SALINAS, CA 93901

JOB NO.  
 14105.1  
 PRINT DATE:  
 PLOT DATE: 2.2.2016  
 DRAWN BY:  
 CHECKED BY:  
 SET ISSUED:


SHEET NAME:  
 NORTH-SOUTH STAIRS-RAILS DEMO PLANS

SHEET NO.:  
**D210**


14105-10210

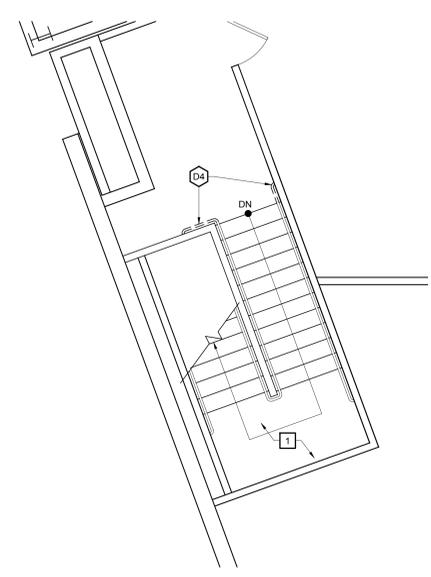


**7 NORTH BUILDING NORTH STAIRWAY (MEZZ.)**  
 SCALE: 1/4" = 1'-0"

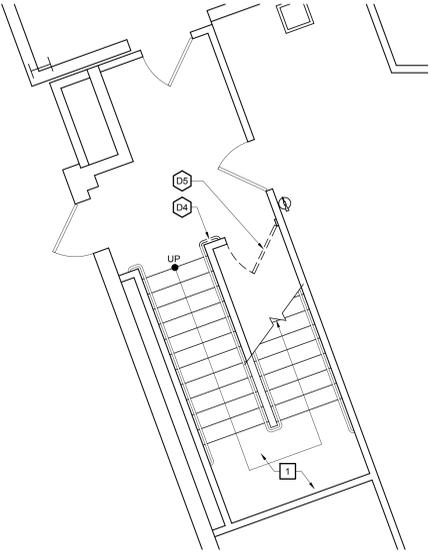


**8 NORTH BUILDING FIRST FLOOR - NORTH STAIRWAY**  
 SCALE: 1/4" = 1'-0"

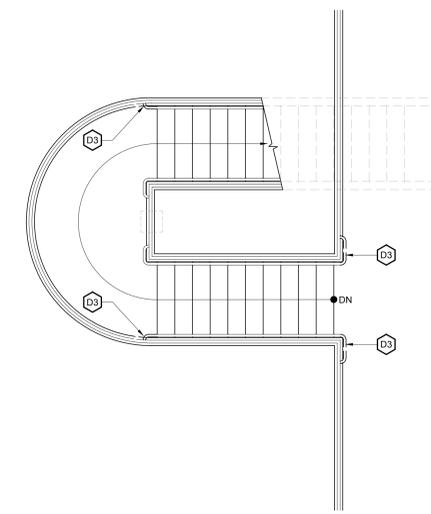


**10 LOBBY STAIRWAY SECOND FLOOR**  
 SCALE: 1/4" = 1'-0"

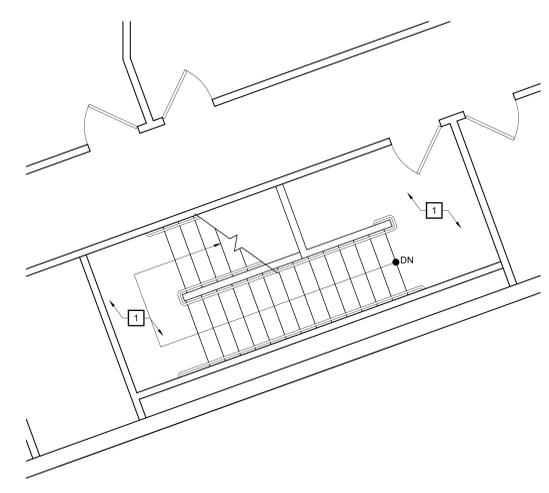


**5 NORTH BUILDING WEST STAIRWAY (MEZZ.)**  
 SCALE: 1/4" = 1'-0"

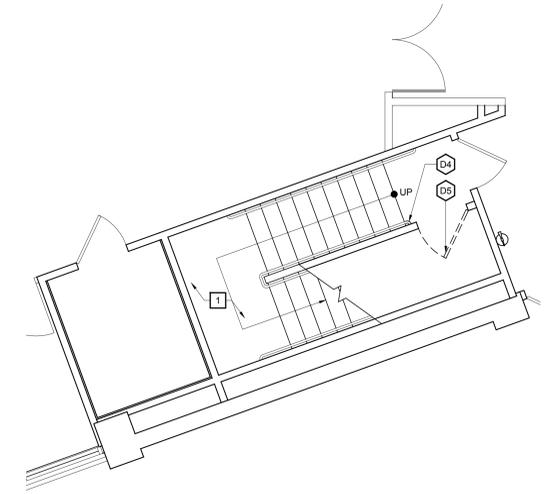


**6 NORTH BUILDING FIRST FLOOR - WEST STAIRWAY**  
 SCALE: 1/4" = 1'-0"

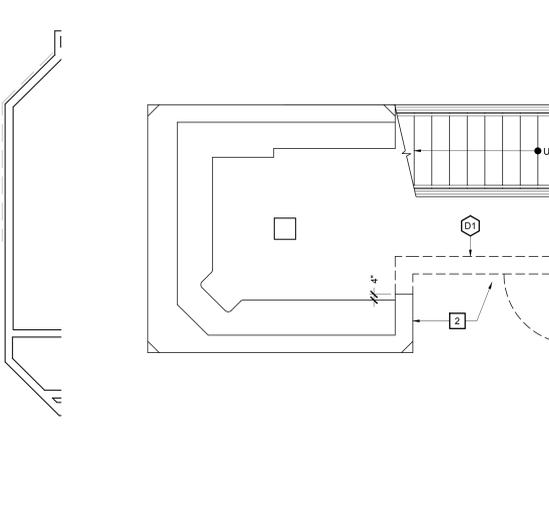


**9 SECURITY COUNTERS AND LOBBY STAIRWAY - FIRST FLOOR**  
 SCALE: 1/4" = 1'-0"

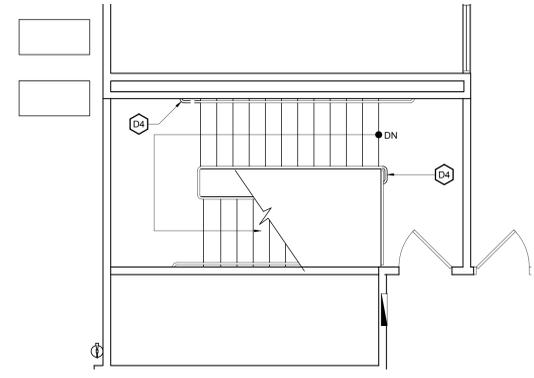


**3 SOUTH BUILDING SECOND FLOOR - EAST STAIRWAY**  
 SCALE: 1/4" = 1'-0"

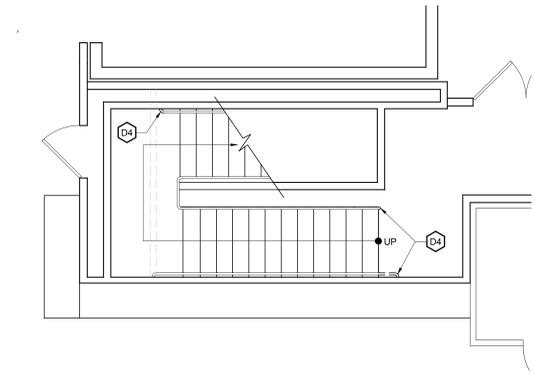


**4 SOUTH BUILDING SECOND FLOOR - EAST STAIRWAY**  
 SCALE: 1/4" = 1'-0"

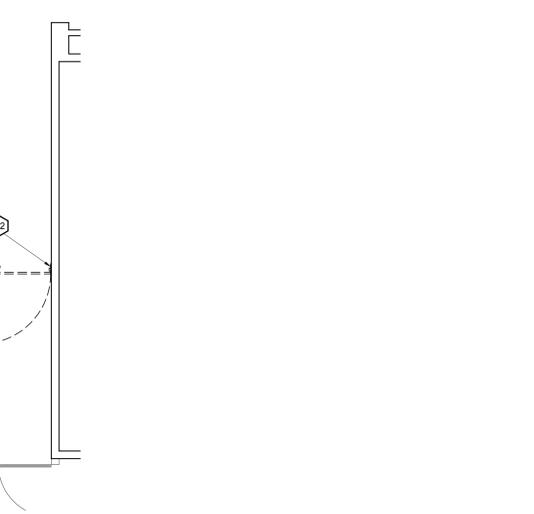

**2 SOUTH BUILDING FIRST FLOOR - WEST STAIRWAY**  
 SCALE: 1/4" = 1'-0"

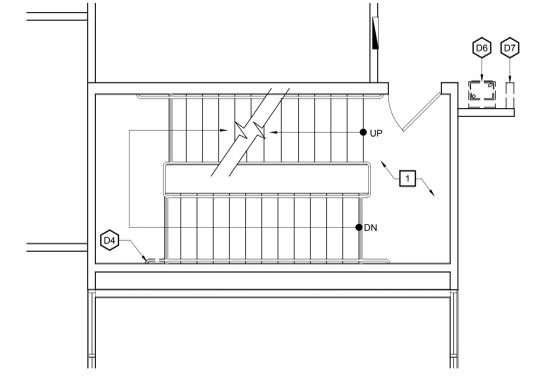

**1 SOUTH BUILDING SECOND FLOOR - WEST STAIRWAY**  
 SCALE: 1/4" = 1'-0"

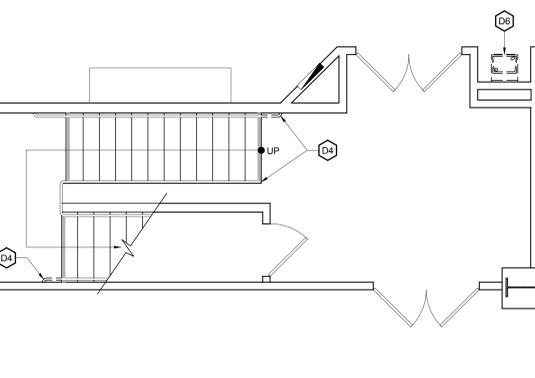

**2 SOUTH BUILDING FIRST FLOOR - WEST STAIRWAY**  
 SCALE: 1/4" = 1'-0"

# DEMOLITION GENERAL NOTES

1. SEE SHEET D200 FOR GENERAL NOTES APPLICABLE TO ALL DEMOLITION SHEETS.

## DEMOLITION NOTES

THE DEMOLITION NOTES THAT FOLLOW APPLY TO THE DRAWING(S) ON THIS SHEET ONLY. REFER TO FOLLOWING SHEETS FOR NOTES THAT ARE APPLICABLE TO THOSE DRAWINGS.

- Ⓛ01 HANDRAIL TO BE MODIFIED TO ACCOMMODATE NEW WORK. SEE SHEET A211.
- Ⓛ02 END OF HANDRAIL TO BE MODIFIED TO ACCOMMODATE NEW WORK. SEE SHEET A211.


## KEY NOTES

THE KEY NOTES THAT FOLLOW APPLY TO THE DRAWING(S) ON THIS SHEET ONLY. REFER TO FOLLOWING SHEETS FOR NOTES THAT ARE APPLICABLE TO THOSE DRAWINGS.

- 1 EXISTING WALL MOUNTED HANDRAIL TO REMAIN.
- 2 EXISTING HANDRAIL TO REMAIN.
- 3 EXISTING METAL GATE AND BARRIER TO REMAIN.
- 4 EXISTING PATIO ENCLOSURE TO REMAIN.
- 5 EXISTING PUBLIC SIDEWALK.
- 6 EXISTING CURB AND GUTTER.
- 7 EXISTING PUBLIC STREET.

## LEGEND

- EXISTING WALL TO REMAIN INTACT
- EXISTING WINDOW TO REMAIN INTACT
- EXISTING DOOR TO REMAIN INTACT
- - - EXISTING ITEM TO BE DEMOLISHED OR MODIFIED.

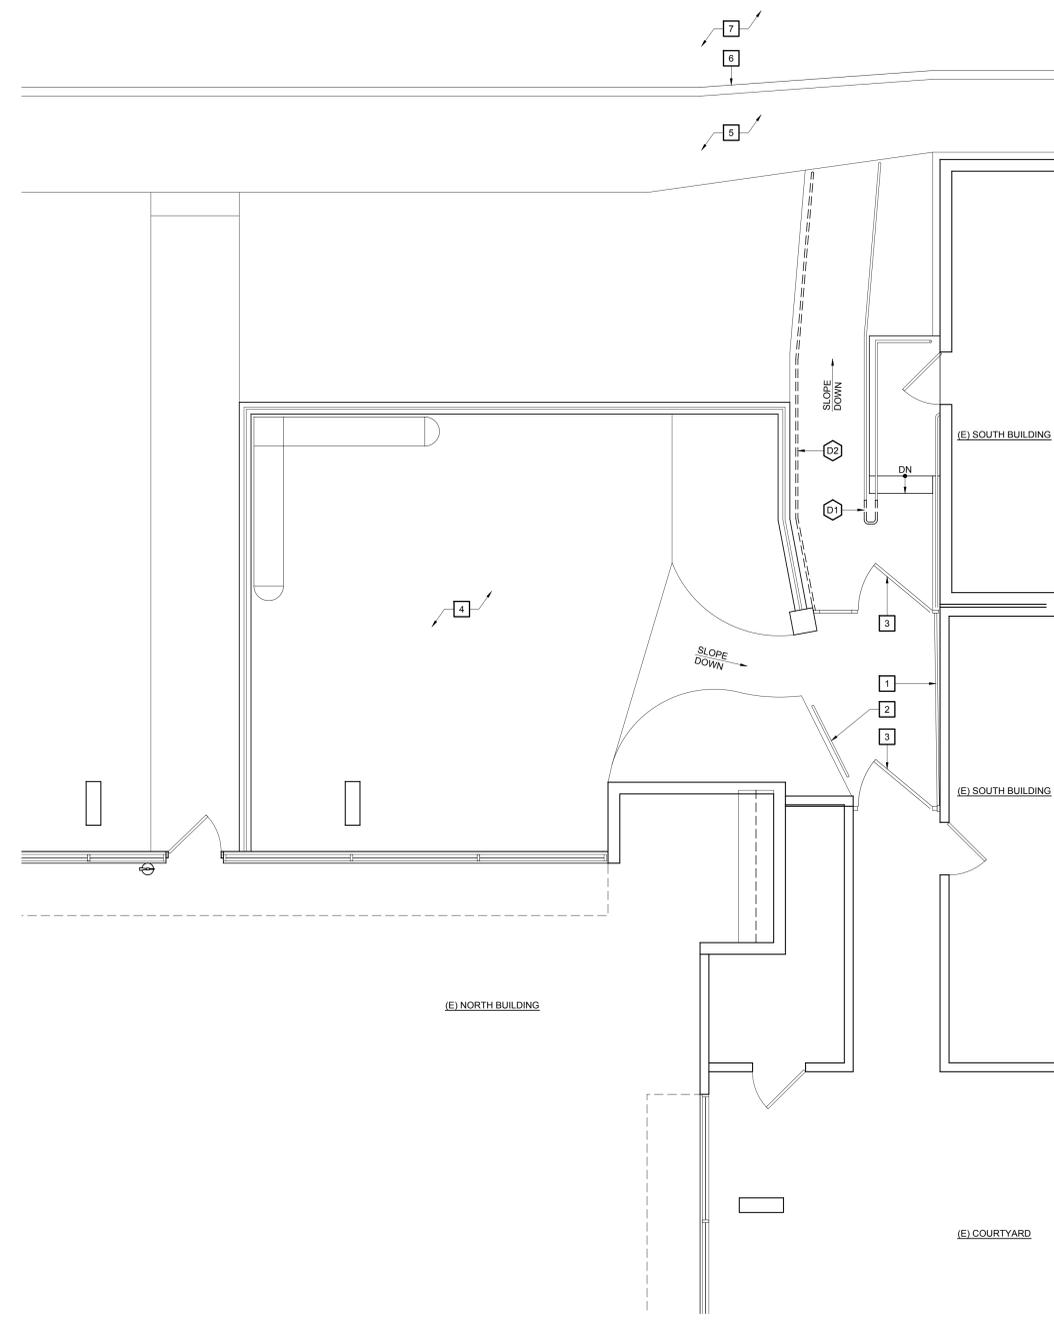

**1 PATIO RAILS DEMOLITION PLAN**  
 SCALE: 1/4" = 1'-0"

**50**

**WR&D**

**WALD RUHNKE & DOST ARCHITECTS LLP**

2340 GARDEN ROAD, SUITE 100  
 MONTEREY, CALIFORNIA 93940  
 PHONE: 831.649.4642  
 FAX: 831.649.3530  
 WWW.WRDARCH.COM

THE USE OF THE PLANS AND SPECIFICATIONS IS RESTRICTED TO THE ORIGINAL SITE FOR WHICH THEY WERE PREPARED, AND PUBLICATION HEREOF IS EXPRESSLY LIMITED TO SUCH USE. REUSE, REPRODUCTION OR REPLICATION BY ANY METHOD OR IN WHOLE OR IN PART IS PROHIBITED. TITLE TO THE PLANS AND SPECIFICATIONS REMAINS WITH THE ARCHITECT AND VISUAL CONTACT WITH THEM CONSTITUTES PRIMA FACIE EVIDENCE OF THE ACCEPTANCE OF THESE RESTRICTIONS.

**MONTEREY COUNTY GOVERNMENT CENTER  
 SCHILLING PLACE - ADA UPGRADES**

ALTERNATE No. 3

MONTEREY COUNTY GOVERNMENT CENTER  
 1441 SCHILLING PLACE  
 SALINAS, CA 93901

AP.N. NO.: 177-181-024

JOB NO.  
**14105.1**

PRINT DATE:  
 2.2.2016

PLOT DATE:  
 2.2.2016

DRAWN BY:  
 -

CHECKED BY:  
 -

SET ISSUED:  
 -


SHEET NAME:  
**PATIO RAILS  
 DEMOLITION  
 PLAN**

SHEET NO.:  
**D211**


THE USE OF THE PLANS AND SPECIFICATIONS IS RESTRICTED TO THE ORIGINAL SITE FOR WHICH THEY WERE PREPARED, AND PUBLICATION HEREIN IS EXPRESSLY LIMITED TO SUCH USE. REUSE, REPRODUCTION OR RECREATION OF ANY METHOD OR IN WHOLE OR IN PART IS PROHIBITED. TITLE TO THE PLANS AND SPECIFICATIONS REMAINS WITH THE ARCHITECT AND VISUAL CONTACT WITH THEM CONSTITUTES PRIMA FACIE EVIDENCE OF THE ACCEPTANCE OF THESE RESTRICTIONS.

**GENERAL NOTES**


- ALL WALLS SHALL BE FINISHED WITH 5/8" TYPE 'X' GYPSUM WALLBOARD CONFORMING TO A.S.T.M. C36 AND CBC SECTION 2506. ALL GYPSUM WALLBOARD SHALL BE INSTALLED IN ACCORDANCE WITH THE PROVISION OF CBC SECTION 2508.
- CONTRACTOR SHALL SEAL ALL NEW GYPSUM WALLBOARD WITH PRIMER PRIOR TO APPLYING FINISH PAINT.
- ALL WALL FINISH MATERIALS SHALL COMPLY WITH CBC SECTION 803 AND HAVE A FLAME SPREAD INDEX NOT GREATER THAN THAT SPECIFIED IN TABLE 803.5 FOR THE GROUP AND LOCATION DESIGNATED. ALL INSULATION TO HAVE FLAME SPREAD RATING OF LESS THAN 25.
- FIRE BLOCKING SHALL BE PROVIDED AS REQUIRED AND IN ACCORDANCE WITH CBC SECTION 717.
- CONTRACTOR SHALL FIELD VERIFY AND COORDINATE (E) WALL TYPES/THICKNESS WITH (N) WALL TYPES, (N) WALL TYPES SHALL MATCH (E) WALL TYPES AND HAVE FINISHES THAT ALIGN AT INFILL LOCATIONS OR NOTED ON PLAN.
- REFER TO THE FLOOR PLAN, INTERIOR ELEVATIONS, DETAILS, MECHANICAL, PLUMBING & ELECTRICAL PLANS FOR WALL BACKING REQUIREMENTS & IN-WALL UTILITIES.
- PROVIDE 6" METAL STUDS AT ALL PLUMBING WALLS U.N.O. COORDINATE WITH RELATED SUB-CONTRACTORS.
- PROVIDE 1/2" MIN. SPACE BETWEEN ELECTRICAL BOXES AND GYP. BOARD. FILL GAP WITH ACOUSTIC SEALANT. DO NOT ALLOW OUTLETS ON EITHER SIDE OF PARTITION TO BE IN THE SAME CAVITY.
- REFER TO ELECTRICAL DRAWINGS FOR NEW POWER LOCATIONS.
- PATCH AND REPAIR DAMAGE TO WALLS FROM REMOVAL OF WALL MOUNTED SIGNAGE, BULLETIN BOARDS, GLASS DISPLAY CASES, WHITE BOARDS, PLASTIC FILE HOLDERS, PHONE BANKS, ETC.
- REPAIR DAMAGE TO EXISTING DOORS FROM REMOVAL OF DOOR MOUNTED SIGNAGE, BULLETIN BOARDS, GLASS DISPLAY CASES, WHITE BOARDS, PLASTIC FILE HOLDERS, ETC.
- REPAIR ANY DAMAGE TO WALLS FROM REMOVAL OF WALLCOVERING, WALL MURALS OR WAINSCOT. WALLS TO BE PREPPED AND PRIMED FOR FINISH. REFER TO FINISH SCHEDULE.
- ALL DIMENSIONS TO FINISHED SURFACE.

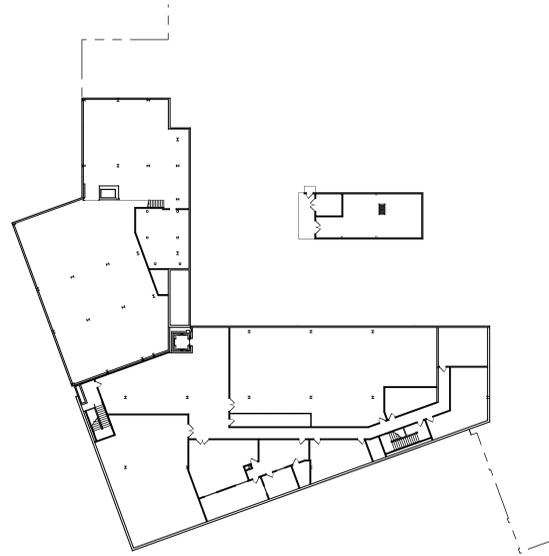

**NORTH BUILDING  
MEZZANINE FLOOR PLAN**  
SCALE: 1/32"=1'-0"

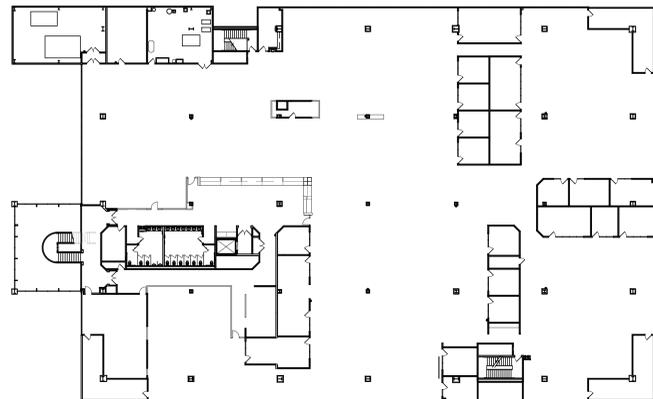

**SOUTH BUILDING  
SECOND FLOOR PLAN**  
SCALE: 1/32"=1'-0"

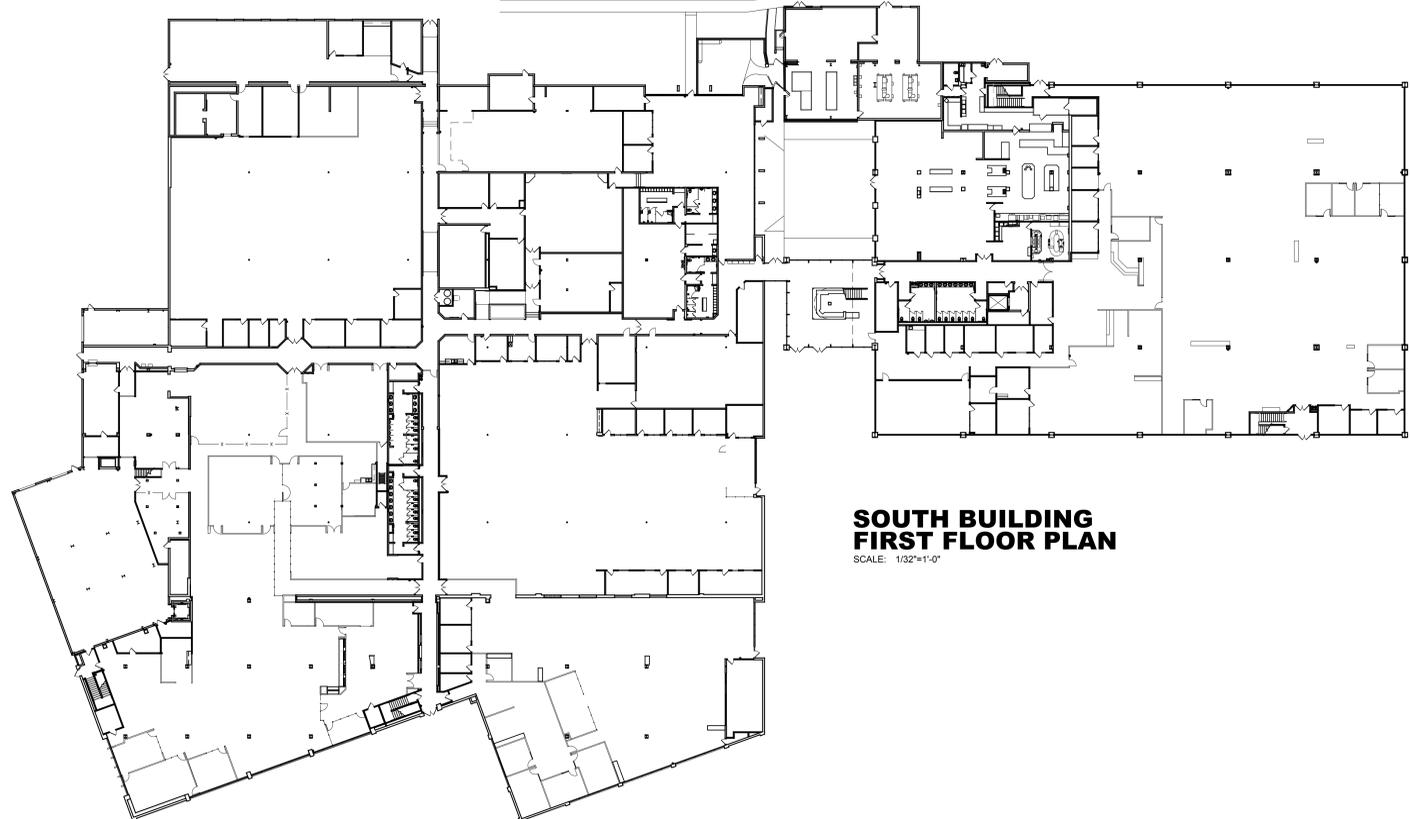

**SOUTH BUILDING  
FIRST FLOOR PLAN**  
SCALE: 1/32"=1'-0"

**NORTH BUILDING  
FIRST FLOOR PLAN**  
SCALE: 1/32"=1'-0"



**OVERALL COMBINED FLOOR PLANS**  
SCALE: 1/32"=1'-0"


**MONTEREY COUNTY GOVERNMENT CENTER  
SCHILLING PLACE - ADA UPGRADES**  
ALTERNATE No. 3  
MONTEREY COUNTY GOVERNMENT CENTER  
1441 SCHILLING PLACE  
SALINAS, CA 9801  
A.P.N. NO.: 177-181-024

JOB NO.  
**14105.1**  
PRINT DATE: 2.2.2016  
PLOT DATE: 2.2.2016  
DRAWN BY: JTI  
CHECKED BY: PS  
SET ISSUED:

SHEET NAME:  
**NORTH-SOUTH  
COMBINED  
FLOOR PLANS**

SHEET NO:

**A200**

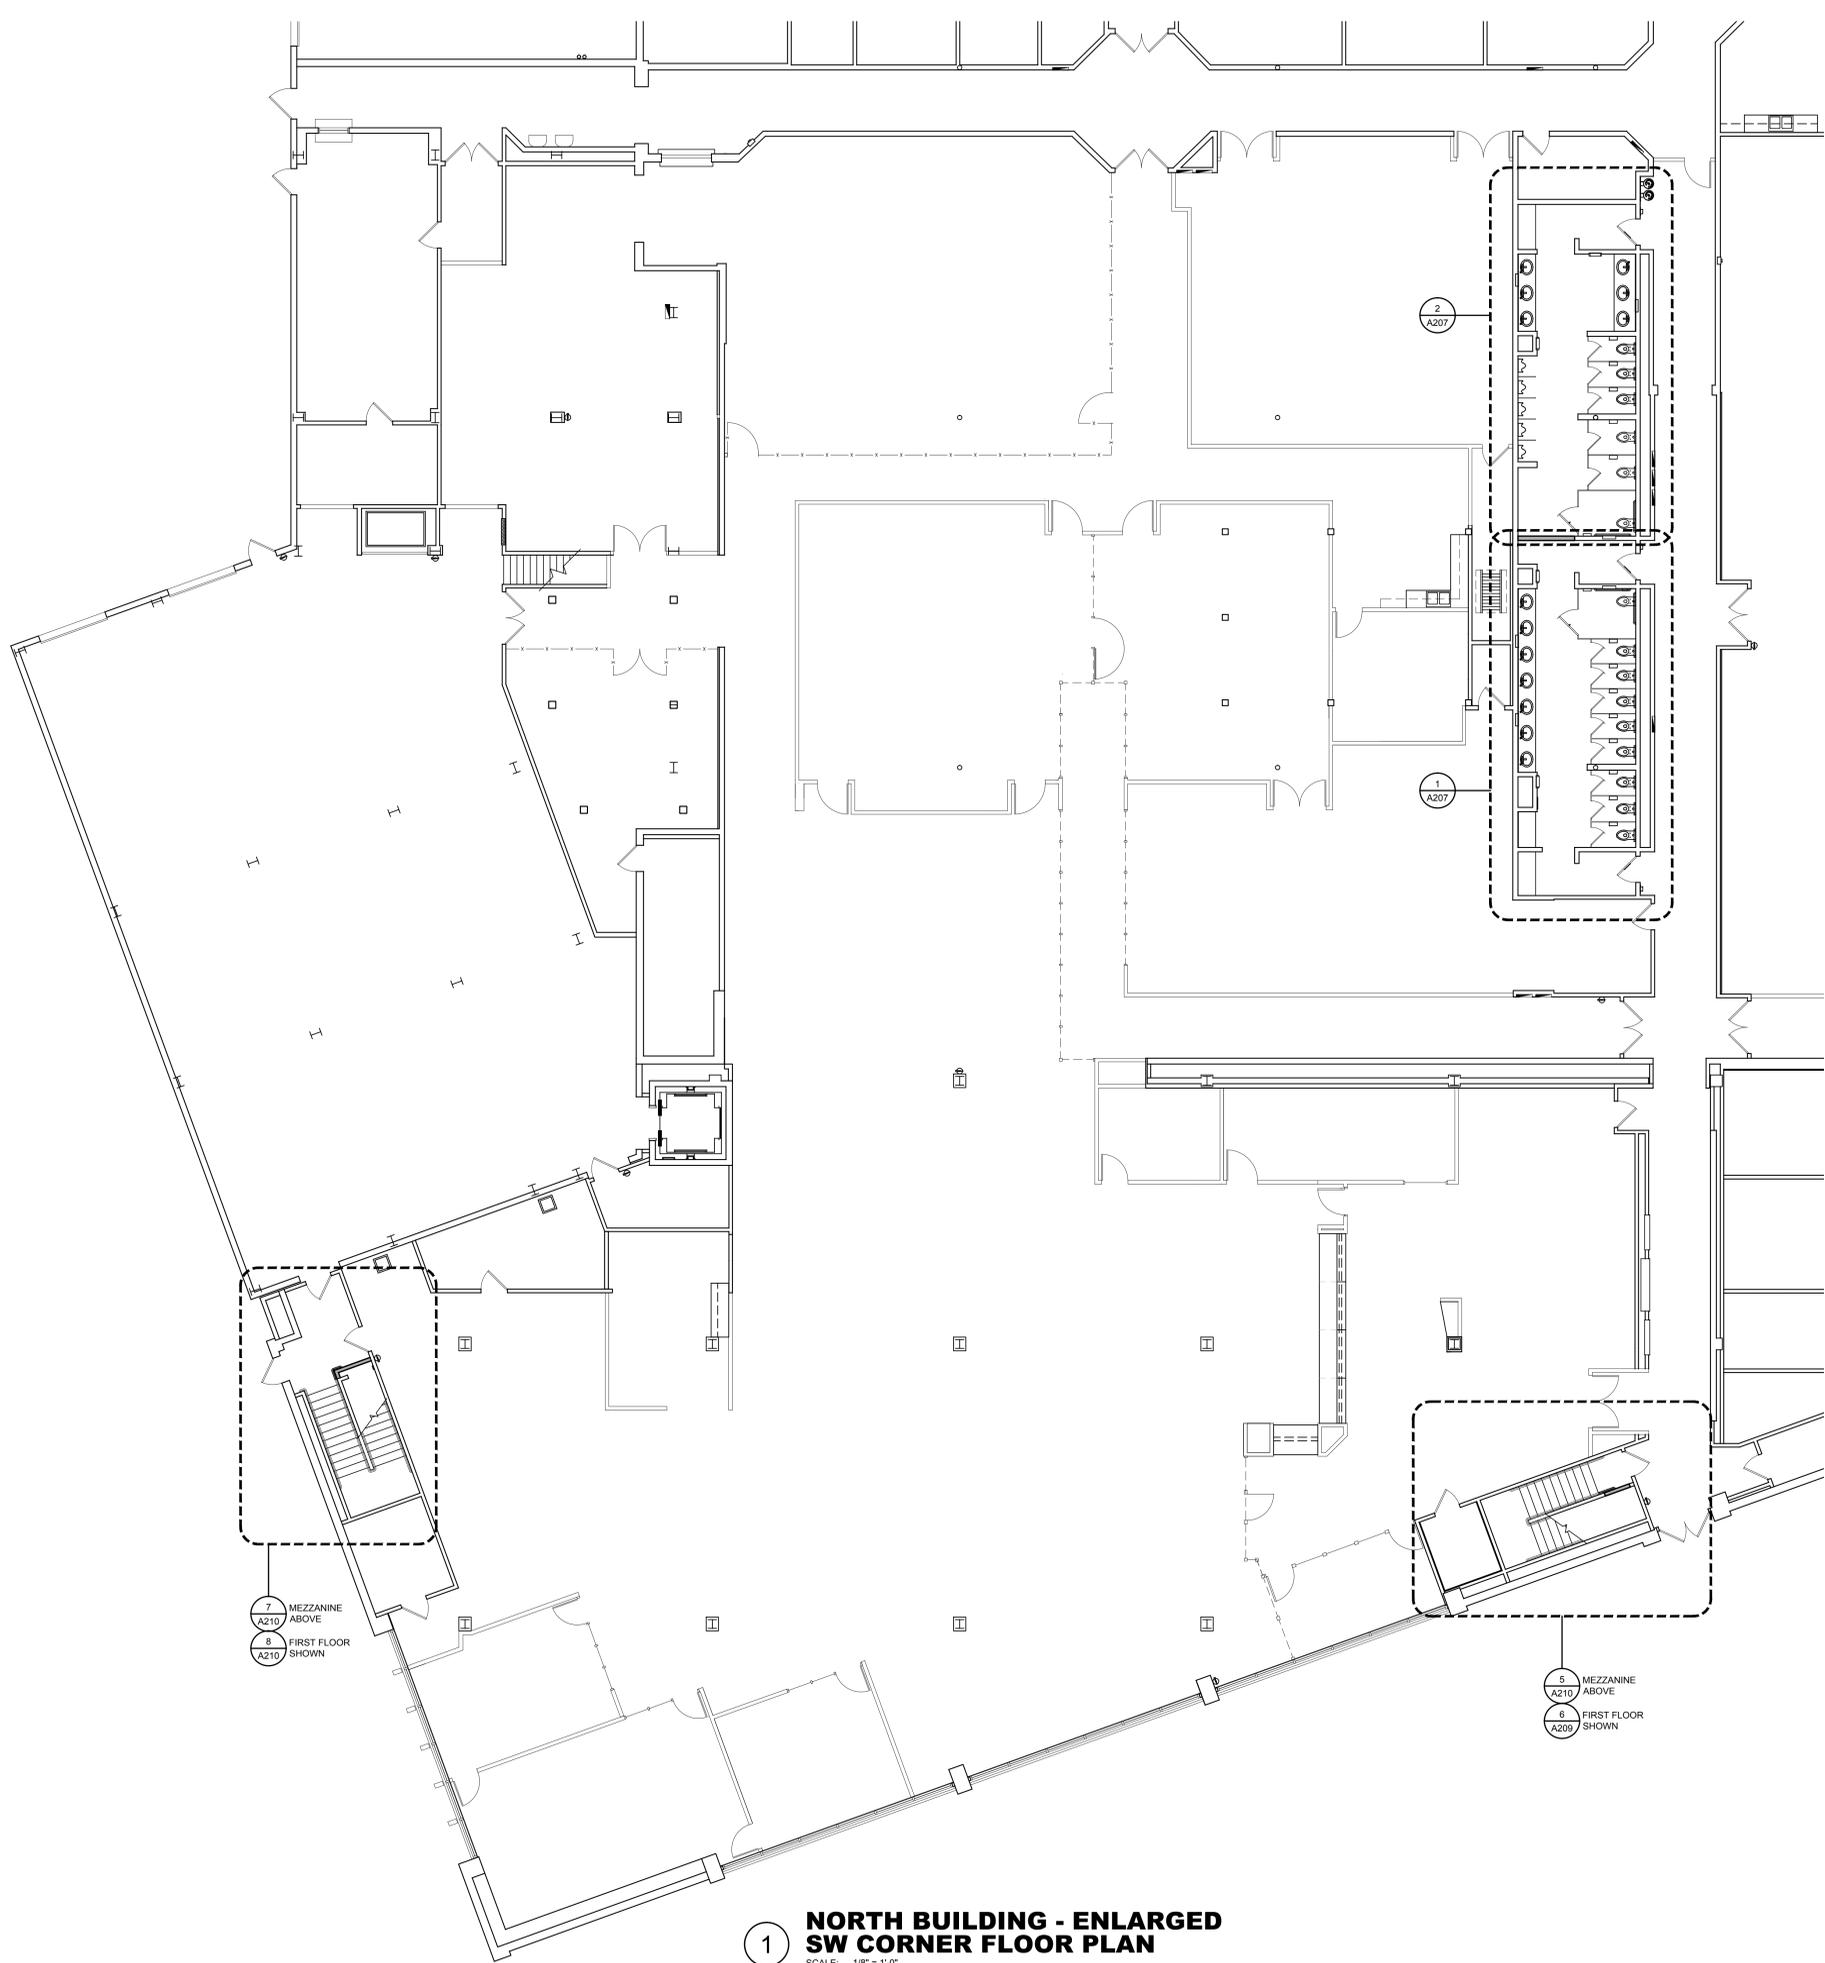



**1 NORTH BUILDING - ENLARGED SW CORNER FLOOR PLAN**  
SCALE: 1/8" = 1'-0"

**GENERAL NOTES**

1. SEE SHEET A200 FOR GENERAL NOTES APPLICABLE TO ALL FLOOR PLAN SHEETS.

**LEGEND**

- EXISTING WALL TO REMAIN
- WALL OR PORTION OF WALL
- EXISTING DOOR TO REMAIN
- NEW DOOR

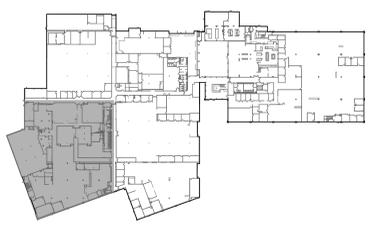

**KEY PLAN**  
SCALE: N.T.S.

**50**  
**WR&D**  
**WALD RUHNKE & DOST ARCHITECTS LLP**  
2340 GARDEN ROAD, SUITE 100  
MONTEREY, CALIFORNIA 93940  
PHONE: 831.649.4642  
FAX: 831.649.3530  
WWW.WRDARCH.COM

THE USE OF THE PLANS AND SPECIFICATIONS IS RESTRICTED TO THE ORIGINAL SITE FOR WHICH THEY WERE PREPARED, AND PUBLICATION HEREIN IS EXPRESSLY LIMITED TO SUCH USE. NO REPRODUCTION OR TRANSMISSION BY ANY METHOD IN WHICHEVER OR IN PART IS PROHIBITED. TITLE TO THE PLANS AND SPECIFICATIONS REMAINS WITH THE ARCHITECT AND VISUAL CONTACT WITH THEM CONSTITUTES PRIMA FACIE EVIDENCE OF THE ACCEPTANCE OF THESE RESTRICTIONS.

**MONTEREY COUNTY GOVERNMENT CENTER  
SCHILLING PLACE - ADA UPGRADES**  
ALTERNATE No. 3  
MONTEREY COUNTY GOVERNMENT CENTER  
1441 SCHILLING PLACE  
SALINAS, CA 93901  
AP.N. NO.: 177-181-024

JOB NO.  
**14105.1**  
PRINT DATE: 2.2.2016  
PLOT DATE: 2.2.2016  
DRAWN BY: JTI  
CHECKED BY: PS  
SET ISSUED:

SHEET NAME:  
**NORTH BLD'G.  
SW CORNER  
FLOOR PLAN**

SHEET NO.:

**A201**



THE USE OF THE PLANS AND SPECIFICATIONS IS RESTRICTED TO THE ORIGINAL SITE FOR WHICH THEY WERE PREPARED, AND PUBLICATION HEREIN IS EXPRESSLY LIMITED TO SUCH USE. NO REPRODUCTION OR REPRODUCTION BY ANY METHOD IN WHOLE OR IN PART IS PERMITTED. TITLE TO THE PLANS AND SPECIFICATIONS REMAINS WITH THE ARCHITECT AND VISUAL CONTACT WITH THEM CONSTITUTES PRIMA FACIE EVIDENCE OF THE ACCEPTANCE OF THESE RESTRICTIONS.

**GENERAL NOTES**

1. SEE SHEET A200 FOR GENERAL NOTES APPLICABLE TO ALL FLOOR PLAN SHEETS.


**LEGEND**

- EXISTING WALL TO REMAIN
- WALL OR PORTION OF WALL
- EXISTING DOOR TO REMAIN
- NEW DOOR

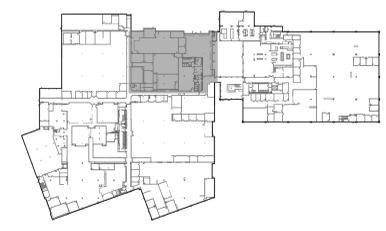

**KEY PLAN**

SCALE: N.T.S.

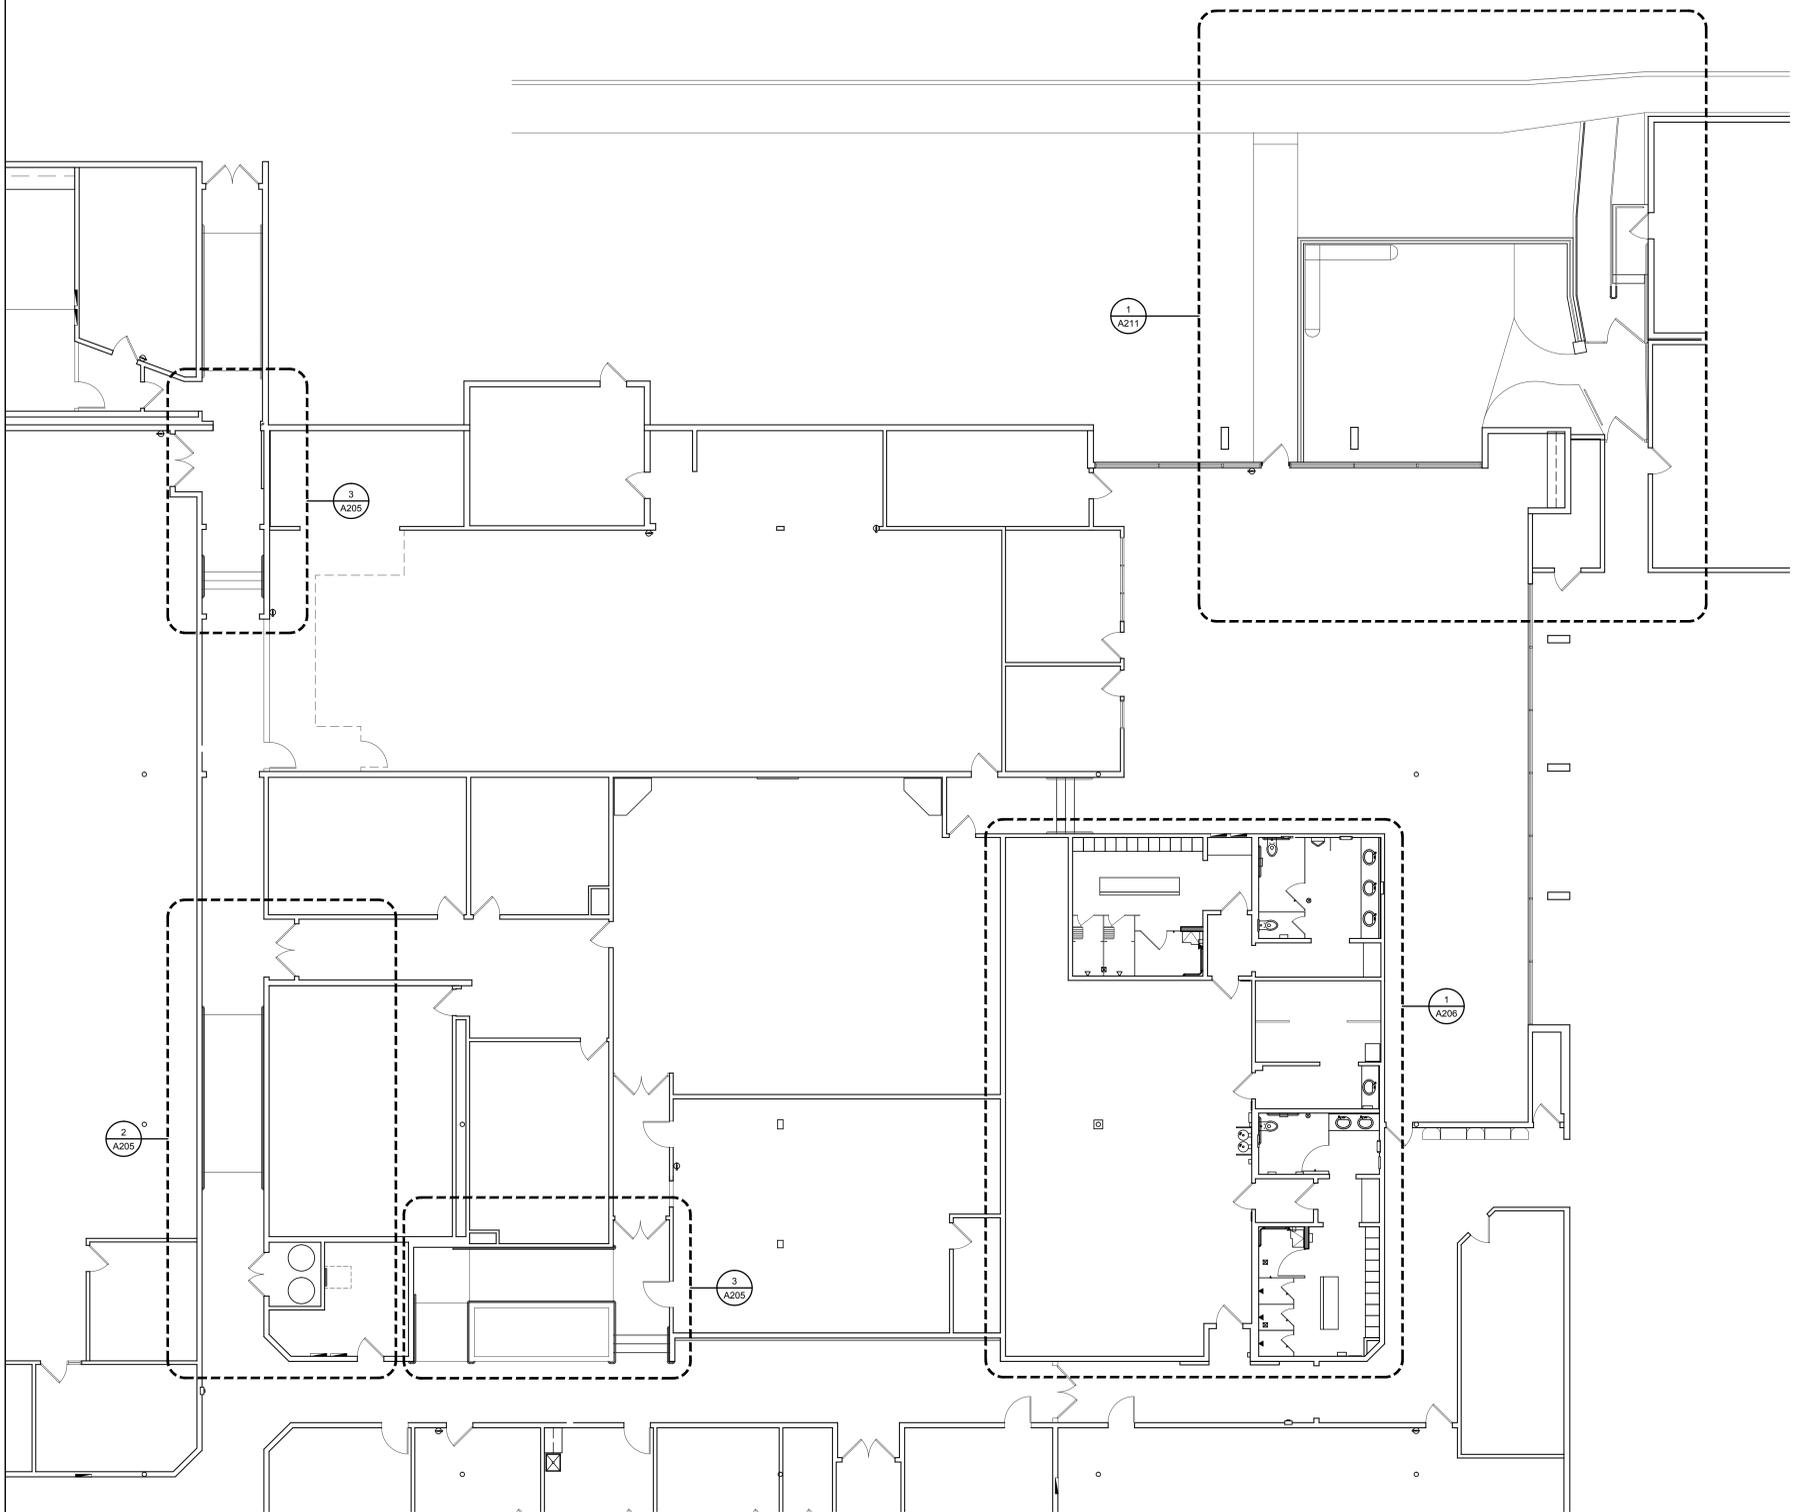

**1 NORTH BUILDING - ENLARGED NE CORNER FLOOR PLAN**

SCALE: 1/8" = 1'-0"

MONTEREY COUNTY GOVERNMENT CENTER  
SCHILLING PLACE - ADA UPGRADES

ALTERNATE No. 3  
MONTEREY COUNTY GOVERNMENT CENTER  
1441 SCHILLING PLACE  
SALINAS, CA 93901  
A.P.N. NO.: 177-181-024

JOB NO.  
**14105.1**  
PRINT DATE: 2.2.2016  
PLOT DATE: 2.2.2016  
DRAWN BY: JTI  
CHECKED BY: PS  
SET ISSUED:

SHEET NAME:  
NORTH BLD'G.  
NE CORNER  
FLOOR PLAN


SHEET NO.:

**A202**


**GENERAL NOTES**

1. SEE SHEET A200 FOR GENERAL NOTES APPLICABLE TO ALL FLOOR PLAN SHEETS.

**LEGEND**



THE USE OF THE PLANS AND SPECIFICATIONS IS RESTRICTED TO THE ORIGINAL SITE FOR WHICH THEY WERE PREPARED, AND PUBLICATION HEREIN IS EXPRESSLY LIMITED TO SUCH USE. REUSE, REPRODUCTION OR PUBLICATION BY ANY METHOD IN WHOLE OR IN PART IS PROHIBITED. TITLE TO THE PLANS AND SPECIFICATIONS REMAINS WITH THE ARCHITECT AND VISUAL CONTACT WITH THEM CONSTITUTES PRIMA FACIE EVIDENCE OF THE ACCEPTANCE OF THESE RESTRICTIONS.

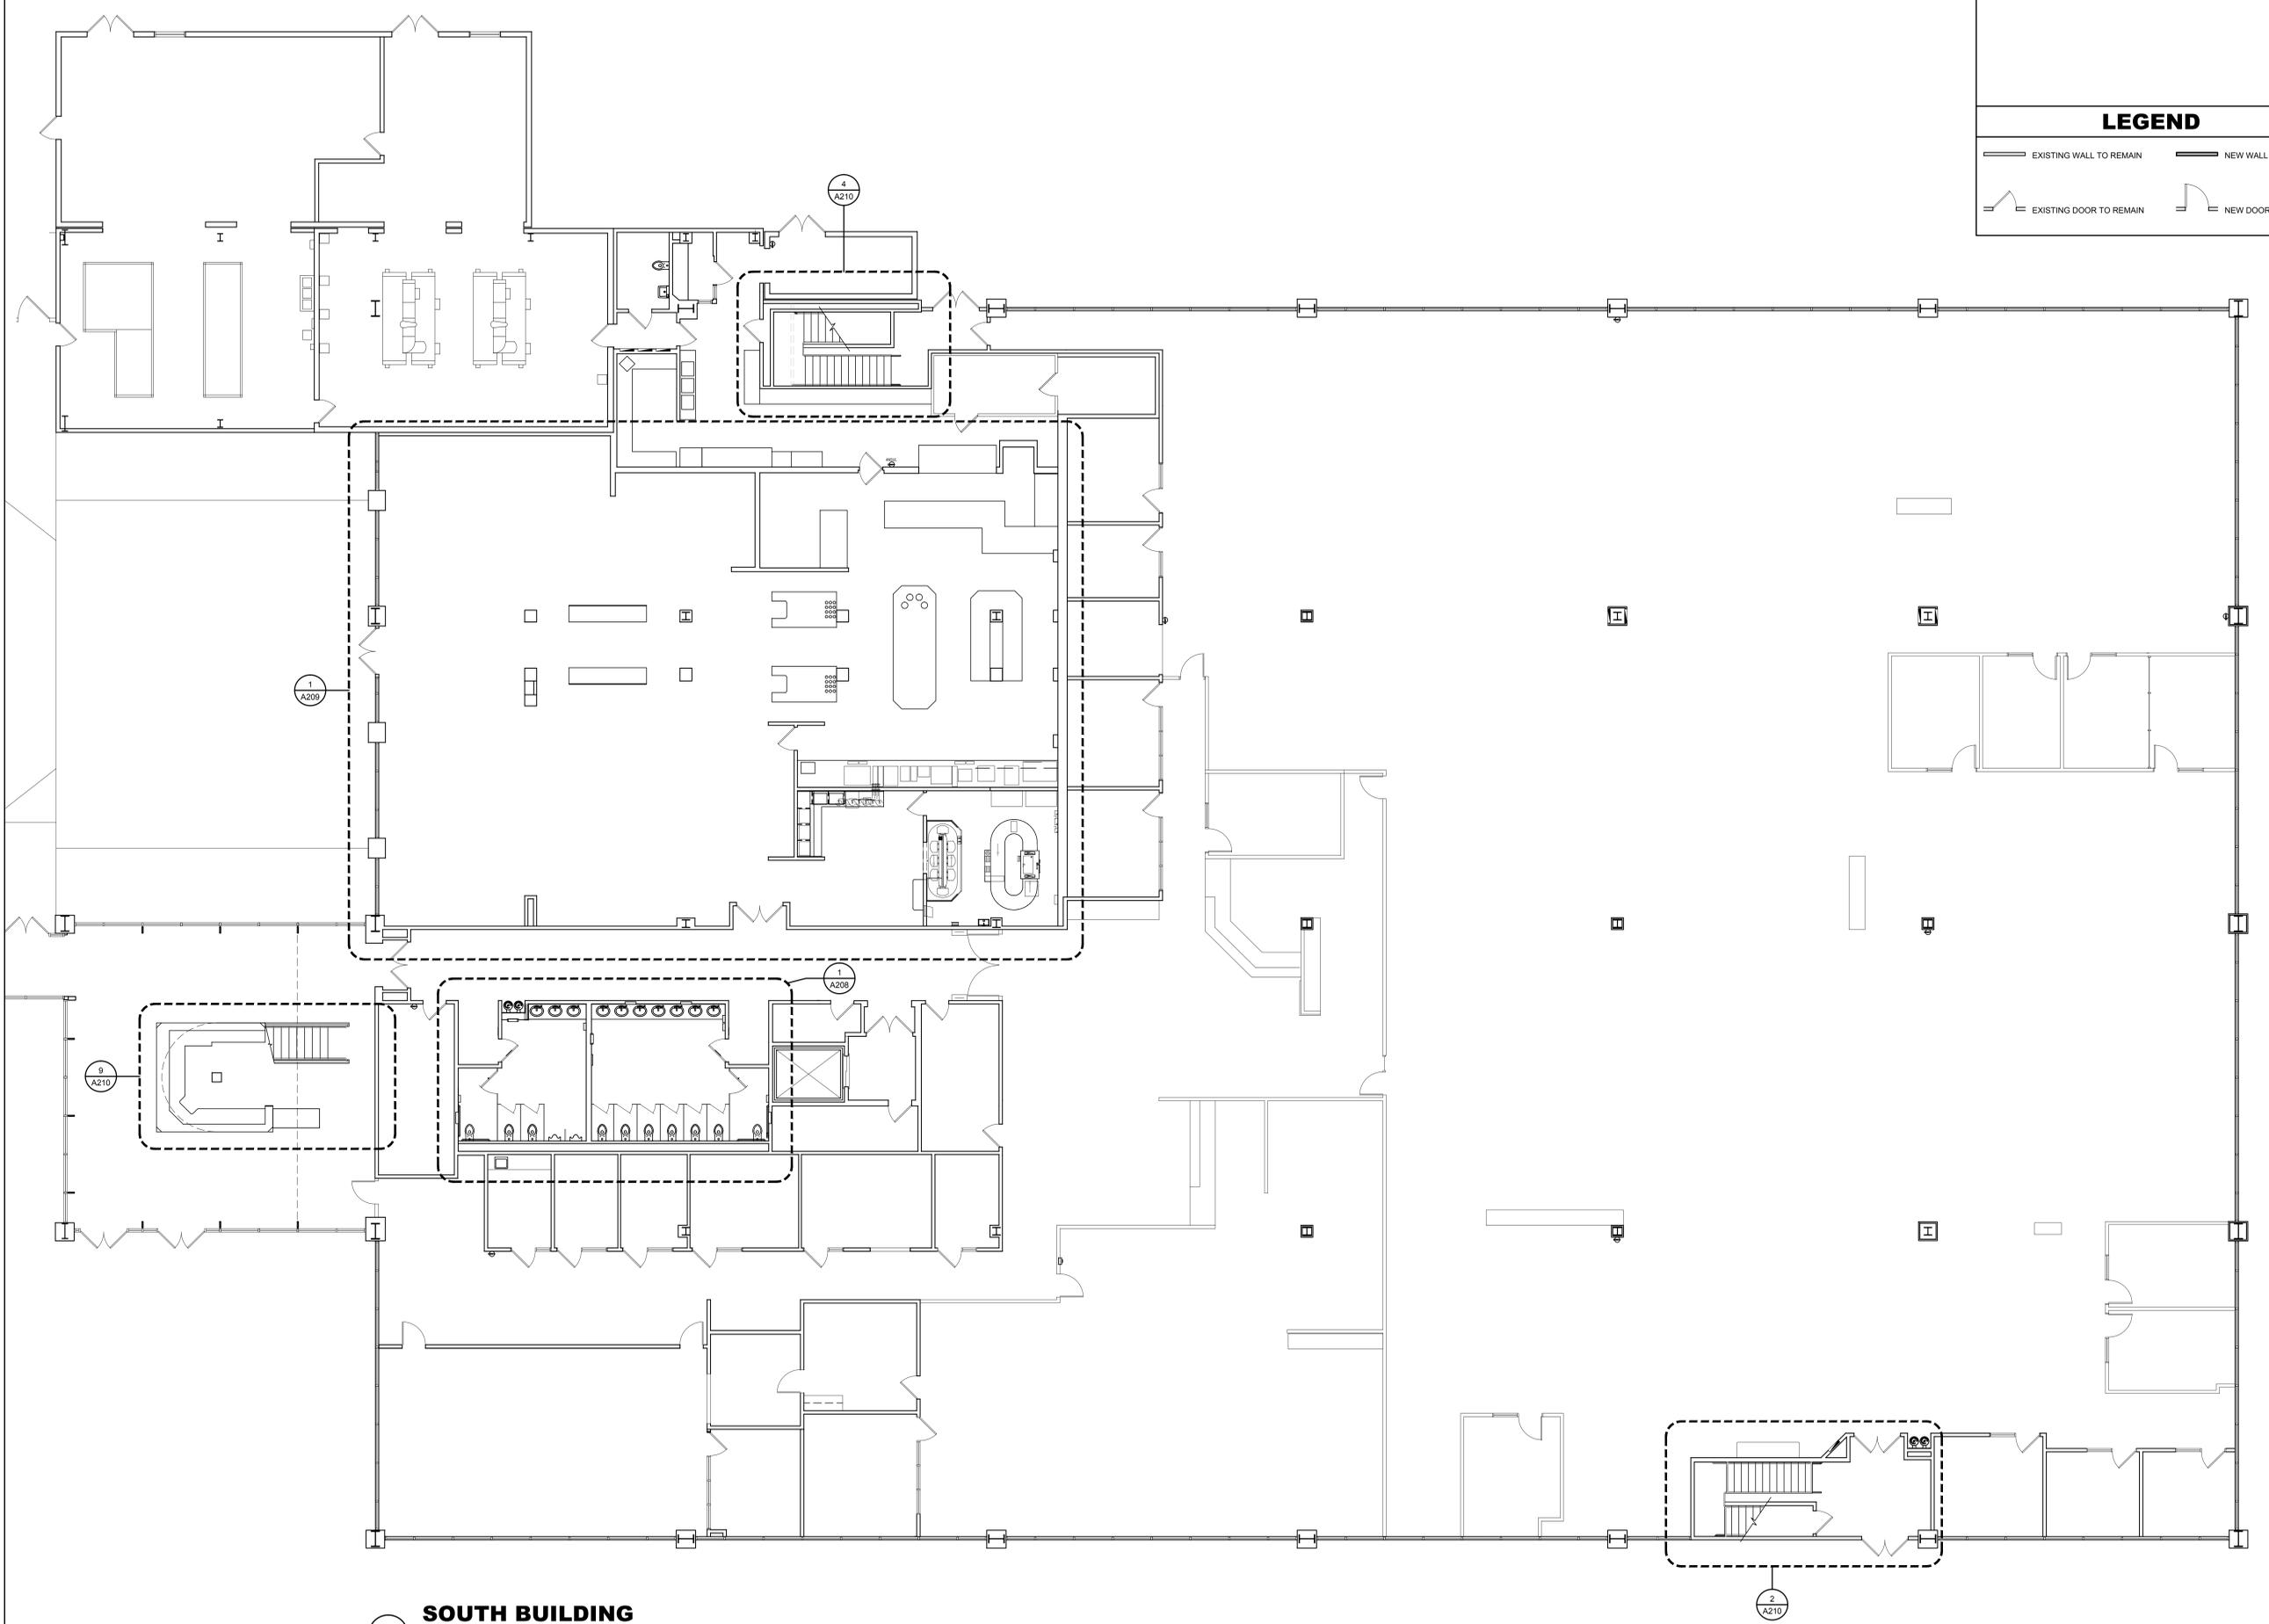

**1 SOUTH BUILDING FIRST FLOOR PLAN**  
SCALE: 1/8" = 1'-0"

**MONTEREY COUNTY GOVERNMENT CENTER  
SCHILLING PLACE - ADA UPGRADES**  
ALTERNATE No. 3  
MONTEREY COUNTY GOVERNMENT CENTER  
1441 SCHILLING PLACE  
SALINAS, CA 93901  
APN. NO.: 177-181-024

JOB NO.  
**14105.1**  
PRINT DATE: 2.2.2016  
PLOT DATE: 2.2.2016  
DRAWN BY: JTI  
CHECKED BY: PS  
SET ISSUED:

SHEET NAME:  
SOUTH BLD'G.  
FIRST  
FLOOR PLAN  
SHEET NO.:

**A203**


**GENERAL NOTES**

1. SEE SHEET A200 FOR GENERAL NOTES APPLICABLE TO ALL FLOOR PLAN SHEETS.

**LEGEND**

-  EXISTING WALL TO REMAIN
-  NEW WALL OR INFILL OF WALL
-  EXISTING DOOR TO REMAIN
-  NEW DOOR

THE USE OF THE PLANS AND SPECIFICATIONS IS RESTRICTED TO THE ORIGINAL SITE FOR WHICH THEY WERE PREPARED, AND PUBLICATION HEREIN IS EXPRESSLY LIMITED TO SUCH USE. REUSE, REPRODUCTION OR PUBLICATION BY ANY METHOD IN WHOLE OR IN PART IS PROHIBITED. TITLE TO THE PLANS AND SPECIFICATIONS REMAINS WITH THE ARCHITECT AND VISUAL CONTACT WITH THEM CONSTITUTES PRIMA FACIE EVIDENCE OF THE ACCEPTANCE OF THESE RESTRICTIONS.

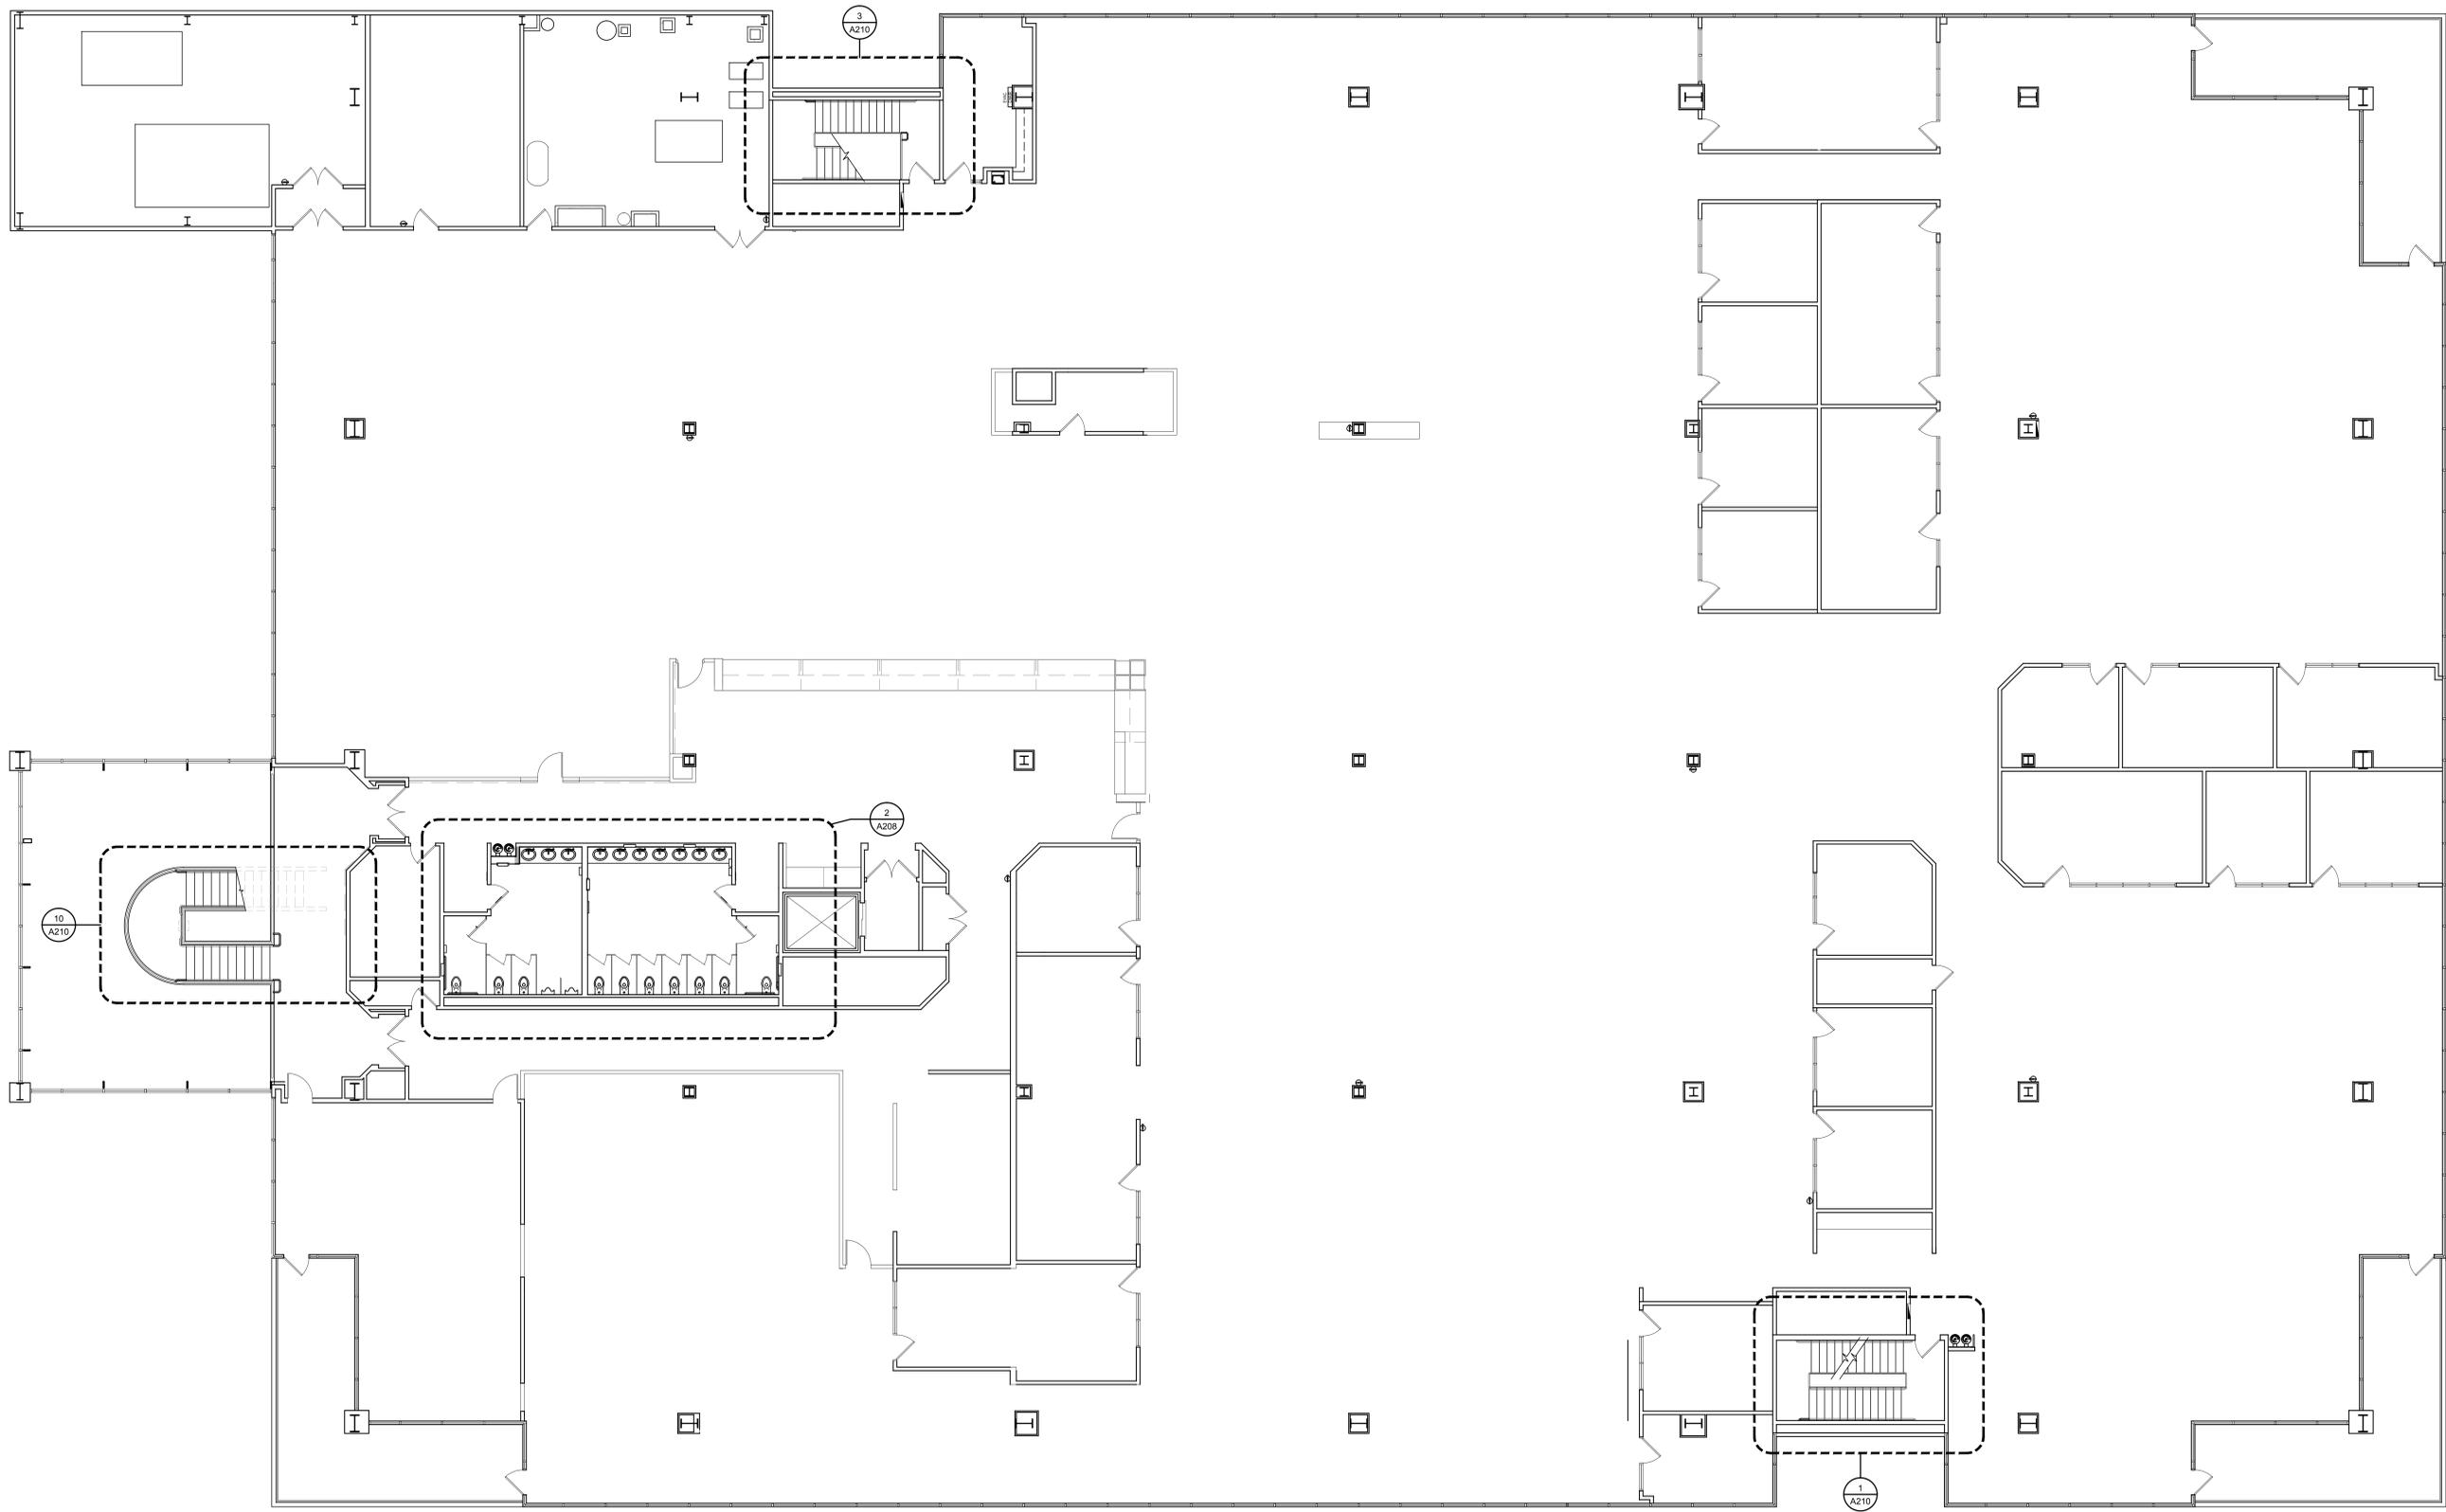

**1 SOUTH BUILDING  
SECOND FLOOR PLAN**  
SCALE: 1/8" = 1'-0"

**MONTEREY COUNTY GOVERNMENT CENTER  
SCHILLING PLACE - ADA UPGRADES**  
ALTERNATE No. 3  
MONTEREY COUNTY GOVERNMENT CENTER  
1441 SCHILLING PLACE  
SALINAS, CA 93901  
A.P.N. NO.: 177-181-024

JOB NO.  
**14105.1**  
PRINT DATE: 2.2.2016  
PLOT DATE: 2.2.2016  
DRAWN BY: JTI  
CHECKED BY: PS  
SET ISSUED:


SHEET NAME:  
**SOUTH BLD'G.  
SECOND  
FLOOR PLAN**  
SHEET NO.:

**A204**


KEY NOTES

THE KEY NOTES THAT FOLLOW APPLY TO THE DRAWING(S) ON THIS SHEET ONLY. REFER TO FOLLOWING SHEETS FOR NOTES THAT ARE APPLICABLE TO THOSE DRAWINGS.


- 1 EXISTING RAISED FLOOR TO REMAIN.
- 2 EXISTING RAMP TO REMAIN.
- 3 EXISTING LANDING TO REMAIN.
- 4 EXISTING PLANTER BOX TO REMAIN.
- 5 EXISTING STEPS TO REMAIN.
- 6 EXISTING UTILITY ROOM (WATER HEATERS) SHOWN FOR REFERENCE ONLY. NO WORK TO OCCUR.
- 7 RELOCATED RAISED ACCESS STEPS.
- 8 NEW HANDRAILS AT I.T. EXIT STEPS. SEE DETAIL 2/A940.
- 9 CLEAN FLOOR AND MATCH EXISTING ADJACENT FLOOR FINISH.
- 10 RE-SLOPE ACCESSIBILITY RAMP. TOP END OF (E) RAMP TO REMAIN AS NEW SLOPE STARTING POINT. RAMP SLOPE SHALL NOT EXCEED 1:12 (8.33%) SLOPE IN DIRECTION OF TRAVEL. IF FEASIBLE, RE-USE EXISTING MATERIALS. NEW FINISHES PER FINISH SCHEDULE. REFER TO PREVIOUS SUBMITTAL SET.
- 11 NEW HANDRAILS AT RAMP. SEE DETAILS 1/A940 & 7/A940.
- 12 NEW HANDRAILS AT PLANTER BOX STEPS. SEE DETAIL 3/A940.
- 13 NEW HANDRAILS OPPOSITE PLANTER BOX STEPS. SEE DETAIL 4/A940.

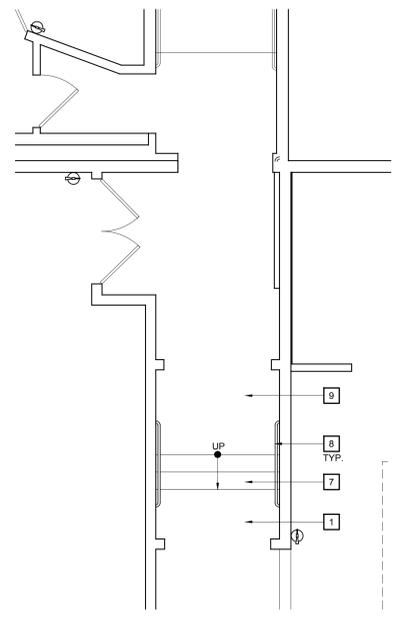

3 **NORTH BUILDING RAISED ACCESS STAIRWAY**  
SCALE: 1/4" = 1'-0"

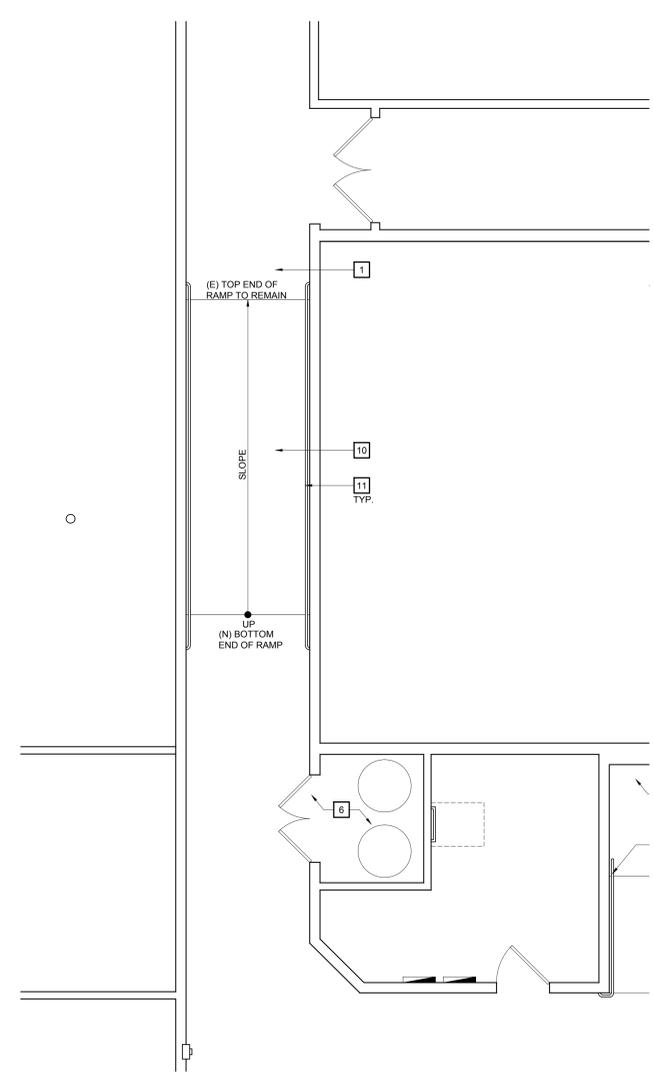

2 **NORTH BUILDING NORTH HALLWAY RAMP**  
SCALE: 1/4" = 1'-0"

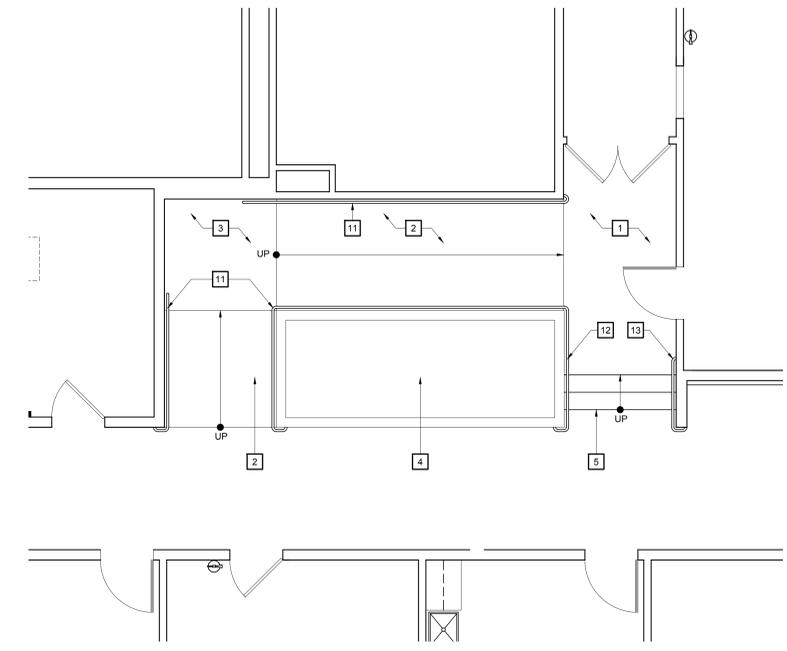

1 **NORTH BUILDING - CENTRAL RAMP AND RAILS FLOOR PLAN**  
SCALE: 1/4" = 1'-0"

MONTEREY COUNTY GOVERNMENT CENTER  
SCHILLING PLACE - ADA UPGRADES  
ALTERNATE No. 3  
MONTEREY COUNTY GOVERNMENT CENTER  
1441 SCHILLING PLACE  
SALINAS, CA 93901  
A.P.N. NO.: 177-181-024

JOB NO.  
14105.1  
PRINT DATE:  
PLOT DATE: 2.2.2016  
DRAWN BY: JTI  
CHECKED BY: PS  
SET ISSUED:

SHEET NAME:  
NORTH BLD'G.  
RAMPS, RAILS,  
STAIR FLR PLN

SHEET NO.:

A205


**GENERAL NOTES**

- CLEAN AND RE-USE SPECIFIC EXISTING FIXTURES AND TOILET ROOM ACCESSORIES PER PLAN. ANY DAMAGED ITEMS NOT FEASIBLE FOR RE-INSTALL ARE TO BE REPLACED IN KIND.
- PATCH AND REPAIR TILE OR EXISTING WALL FINISH TO MATCH EXISTING AT ALL LOCATIONS WHERE OBJECTS, ACCESSORIES, OR FIXTURES ARE REMOVED. REPLACE ALL TILES WITH SCREW HOLES, MARKS OR NOTCHES FROM MOUNTED OBJECTS THAT ARE REMOVED.
- EXISTING TILE FLOORING TO REMAIN. REPLACE ALL TILES WITH SCREW HOLES, MARKS OR NOTCHES FROM FLOOR MOUNTED OBJECTS THAT ARE REMOVED.
- ANY EXTRA FIXTURES AND/OR ACCESSORIES NOT NEEDED FOR RE-INSTALLATION ARE TO BE DISCARDED. RE-USE THE COMPONENTS IN BEST CONDITION.
- ALL DIMENSIONS ARE TO FINISH SURFACE.


**KEY NOTES**

THE KEY NOTES THAT FOLLOW APPLY TO THE DRAWING(S) ON THIS SHEET ONLY. REFER TO FOLLOWING SHEETS FOR NOTES THAT ARE APPLICABLE TO THOSE DRAWINGS.

- EXISTING DRAIN TO REMAIN.
- EXISTING SHOWER HEAD / CONTROLS TO REMAIN.
- EXISTING SOAP DISPENSER TO REMAIN.
- EXISTING LOCKERS TO REMAIN.
- EXISTING MIRROR TO REMAIN.
- EXISTING CABINET TO REMAIN.
- EXISTING GRAB BAR TO REMAIN.
- EXISTING TOILET / SHOWER PARTITIONS TO REMAIN.
- EXISTING WALL MOUNTED WASTE RECEPTACLE TO REMAIN.
- EXISTING WALL MOUNTED HAND DRYER TO REMAIN.
- EXISTING RECESSED PAPER TOWEL DISPENSER TO REMAIN.
- EXISTING COUNTER, SINK, AND SOAP DISPENSER TO REMAIN.
- NEW FLOOR MOUNT TOILET / SHOWER PARTITION TO MATCH EXISTING.
- RE-INSTALL WALL MOUNTED TOILET w/ FLUSH ACTIVATION ON THE WIDE SIDE OF FIXTURE. REFER TO 3/A900. SEE PLUMBING DRAWINGS.
- RE-INSTALL WALL MOUNT URINAL AND CONTROLS. REFER TO 11B/A900.
- RE-INSTALL WALL MOUNTED TOILET TISSUE DISPENSER. REFER TO 7/A900.
- RE-INSTALL RECESSED TOILET SEAT COVER DISPENSER. REFER TO INTERIOR ELEVATIONS FOR EXACT LOCATION AND 7/A900 FOR MOUNTING HEIGHT.
- NEW SINK, FAUCET / LEVER, SOAP DISPENSER, AND INSULATED PIPING. MATCH FIXTURES IN ADJACENT RESTROOMS. SEE PLUMBING DRAWINGS.
- NOT USED.
- NEW GRAB BAR 42" L. REFER TO DETAIL 3 & 4/A900.
- NEW GRAB BAR 48" L. REFER TO DETAIL 3 & 4/A900.
- RE-INSTALL SYRINGE STORAGE DISPENSER. REFER TO INTERIOR ELEVATION FOR EXACT LOCATION AND 7/A900 FOR MOUNTING HEIGHT.
- PROVIDE NEW HOOK AT ACCESSIBLE HEIGHT, 48" MAX. A.F.F. BOBRICK #B-233. CBC 11B-308.3.2.
- DRAIN TRAP AND HOT WATER PIPING SHALL BE INSULATED TO PREVENT DIRECT CONTACT. CBC 11B.606.5.
- NEW ACCESSIBLE DOOR SIGNAGE. REFER TO DETAIL 8/A900.
- NEW HI-LO DUAL WALL MOUNT DRINKING FOUNTAIN. REFER TO DETAIL 10A/A900 AND PLUMBING DRAWINGS.
- NEW DRINKING FOUNTAIN GUARD RAILS. REFER TO DETAIL 10A/A900.
- NEW MIRROR. REFER TO INTERIOR ELEVATION. BOTTOM OF NEW REFLECTING SURFACE MUST BE MAX. 40" ABOVE FINISH FLOOR. VERIFY EXACT MIRROR SIZE IN FIELD.
- NEW 20" DEEP BENCH WITH BACK SUPPORT. SEE PLAN FOR LENGTH. HOLLMAN SOLID SURFACE WITH STAINLESS STEEL T-LEGS.
- NEW WALL MOUNTED ADA COMPLIANT FOLD DOWN SHOWER SEAT. REFER TO INTERIOR ELEVATIONS FOR MOUNTING HEIGHT AND PRODUCT SPECS.
- RE-INSTALL HAND SANITIZER DISPENSER. REFER TO INTERIOR ELEVATIONS FOR EXACT LOCATION AND 7/A900 FOR MOUNTING HEIGHT.
- NEW INFILL WALL. MATCH ADJACENT WALL THICKNESS, MATERIALS & CONDITIONS.
- RE-INSTALL THERMOSTAT CONTROLS. REFER TO INTERIOR ELEVATIONS FOR EXACT LOCATION AND MOUNTING HEIGHTS.
- RE-INSTALL WALL HUNG URINAL PARTITION. REFER TO 11D/A900.
- RE-INSTALL WALL MOUNTED SOAP DISPENSER. REFER TO INTERIOR ELEVATIONS FOR EXACT LOCATION AND 7/A900 FOR MOUNTING HEIGHT.
- RE-INSTALL COUNTERTOP / BACKSPLASH. TRIM OR RECESS DEPTH OF BACKSPLASH AS REQUIRED TO REDUCE DEPTH OF COUNTER FOR ADA COMPLIANT CLEAR SPACE IN FRONT OF COUNTER. SEE DIMENSIONS ON FLOOR PLAN.
- RE-INSTALL PAPER TOWEL DISPENSER. REFER TO INTERIOR ELEVATION FOR EXACT LOCATION AND 7/A900 FOR MOUNTING HEIGHT.
- NEW ADA COMPLIANT SHOWER CONTROLS AND HAND HELD SPRAY UNIT WITH ADJUSTABLE MOUNTING BAR. REFER TO PLUMBING DRAWINGS.
- NEW ADA COMPLIANT SHOWER CONTROLS & SPRAY UNIT W/ HOSE. REFER TO INTERIOR ELEVATION FOR EXACT LOCATION AND MOUNTING HEIGHT. SEE PLUMBING DRAWINGS.
- RE-INSTALL SANITARY NAPKIN/TAMPON DISPENSER. REFER TO INTERIOR ELEVATION FOR EXACT LOCATION AND 7/A900 FOR MOUNTING HEIGHT. SEE PLUMBING DRAWINGS.
- NEW COUNTERTOP, SINK, FAUCET / LEVER, AND SOAP DISPENSER TO MATCH COUNTERTOP AND FIXTURES IN ADJACENT RESTROOMS.
- RE-INSTALL SINK, FAUCET / LEVER, AND SOAP DISPENSERS. REFER TO INTERIOR ELEVATIONS FOR MOUNTING HEIGHT. SEE PLUMBING DRAWINGS.
- PROVIDE NEW HOOK.
- RELOCATED U/C REFRIGERATOR.
- NEW TILE ON WALL TO MATCH EXISTING AT LOCATION OF REMOVED MIRROR. REFER TO INTERIOR ELEVATIONS.
- ADD NEW WALL MOUNTED HAND DRYER TO MATCH EXISTING MODEL. REFER TO 7/A900 FOR MOUNTING HEIGHT.

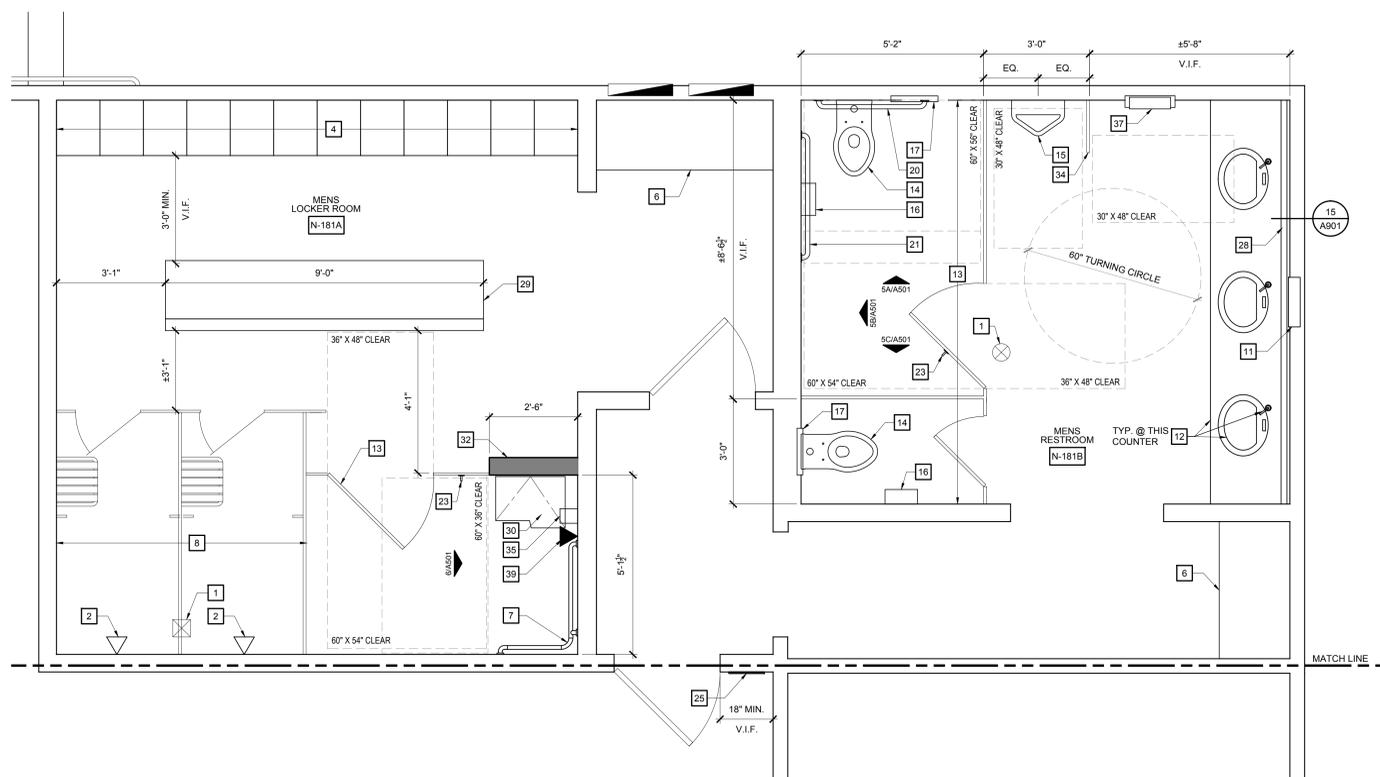

**2 NORTH BUILDING - FITNESS CENTER MENS RESTROOM FLOOR PLAN**  
SCALE: 1/2" = 1'-0"

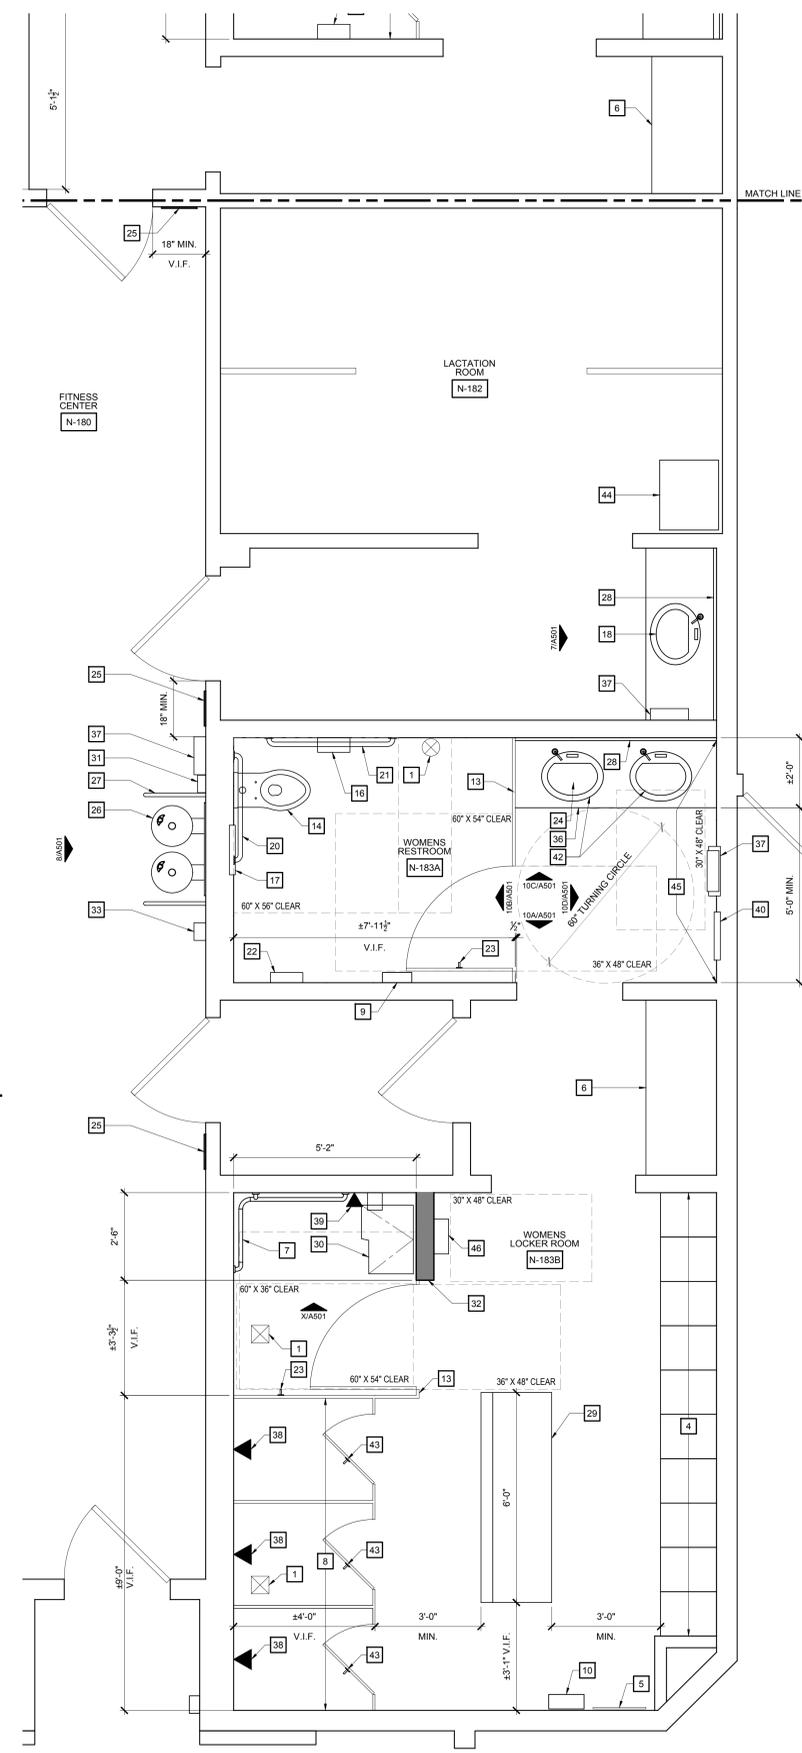

**1 NORTH BUILDING - FITNESS CENTER WOMENS RESTROOM FLOOR PLAN**  
SCALE: 1/2" = 1'-0"

MONTEREY COUNTY GOVERNMENT CENTER  
SCHILLING PLACE - ADA UPGRADES  
ALTERNATE No. 3  
MONTEREY COUNTY GOVERNMENT CENTER  
1441 SCHILLING PLACE  
SALINAS, CA 93901  
APN NO.: 177-181-024

JOB NO.  
**14105.1**  
PRINT DATE: 2.2.2016  
DRAWN BY: JTI  
CHECKED BY: PS  
SET ISSUED:

SHEET NAME:  
**NORTH BLD'G.  
RESTROOMS &  
FITNESS PLAN**

SHEET NO.:

**A206**

**GENERAL NOTES**

- CLEAN AND RE-USE SPECIFIC EXISTING FIXTURES AND TOILET ROOM ACCESSORIES PER PLAN. ANY DAMAGED ITEMS NOT FEASIBLE FOR RE-INSTALL ARE TO BE REPLACED IN KIND.
- PATCH AND REPAIR TILE OR EXISTING WALL FINISH TO MATCH EXISTING AT ALL LOCATIONS WHERE OBJECTS, ACCESSORIES, OR FIXTURES ARE REMOVED. REPLACE ALL TILES WITH SCREW HOLES, MARKS OR NOTCHES FROM MOUNTED OBJECTS THAT ARE REMOVED.
- EXISTING TILE FLOORING TO REMAIN. REPLACE ALL TILES WITH SCREW HOLES, MARKS OR NOTCHES FROM FLOOR MOUNTED OBJECTS THAT ARE REMOVED.
- ANY EXTRA FIXTURES AND/OR ACCESSORIES NOT NEEDED FOR RE-INSTALLATION ARE TO BE DISCARDED. RE-USE THE COMPONENTS IN BEST CONDITION.
- ALL DIMENSIONS ARE TO FINISH SURFACES.

**KEY NOTES**

THE KEY NOTES THAT FOLLOW APPLY TO THE DRAWING(S) ON THIS SHEET ONLY. REFER TO FOLLOWING SHEETS FOR NOTES THAT ARE APPLICABLE TO THOSE DRAWINGS.

- PORTION OF EXISTING WALL TO REMAIN.
- EXISTING TOILET STALLS TO REMAIN.
- EXISTING URINALS TO REMAIN.
- EXISTING SINKS TO REMAIN (LOWER WITH COUNTERTOP).
- EXISTING ACCESSIBLE SIGNAGE TO REMAIN EXCEPT WHERE NOTED OTHERWISE.
- EXISTING CABINET TO REMAIN.
- PATCH WALLS AND MATCH EXISTING ADJACENT CONDITIONS.
- NEW INFILL WALL. MATCH ADJACENT WALL THICKNESS, MATERIALS & CONDITIONS
- LOWER COUNTERTOP w/SUPPORT BRACKETS TO ACCESSIBLE HEIGHT, +34" MAX. CBC 11B-308.3.2.
- EXISTING PAPER TOWEL DISPENSER TO REMAIN.
- LOWER PAPER TOWEL DISPENSER TO ACCESSIBLE HEIGHT, +40" MAX. A.F.F. PER CBC 11B-603.5.
- LOWER SANITARY NAPKIN/TAMPON DISPENSER TO ACCESSIBLE HEIGHT, +40" MAX. A.F.F. PER CBC 11B-603.5.
- PROVIDE NEW TOILET PARTITION TO MATCH EXISTING CONDITIONS.
- RELOCATED ACCESSIBLE HEIGHT TOILET w/ FLUSH ACTIVATION ON THE WIDE SIDE OF FIXTURE. CBC 11B-604.2, CBC 604.4.
- RELOCATED STANDARD HEIGHT TOILET w/ FLUSH ACTIVATION ON THE WIDE SIDE OF FIXTURE.
- RELOCATED TOILET SEAT COVER DISPENSER.
- NEW RECESSED TOILET SEAT COVER, TOILET TISSUE DISPENSER. BOBRICK #B-347.
- RELOCATED TOILET TISSUE DISPENSER.
- RELOCATED SANITARY NAPKIN/TAMPON DISPOSAL CONTAINER.
- NEW GRAB BAR 42" L. BOBRICK #B-06806 x 42. SEE DETAIL 3 & 4/A900.
- NEW GRAB BAR 48" L. BOBRICK #B-06806 x 48. SEE DETAIL 3 & 4/A900.
- RELOCATED SYRINGE STORAGE DISPENSER AT ACCESSIBLE HEIGHT, 48" MAX. A.F.F. CBC 11B-308.3.2.
- PROVIDE NEW HOOK AT ACCESSIBLE HEIGHT, 48" MAX. A.F.F. BOBRICK #B-233. CBC 11B-308.3.2.
- DRAIN TRAP AND HOT WATER PIPING SHALL BE INSULATED TO PREVENT DIRECT CONTACT. CBC 11B.606.5.
- LOWER ACCESSIBLE DOOR SIGNAGE TO +60" MAX. CBC 11B-703.7.2.6.
- NEW HI-LO DUAL WALL MOUNT DRINKING FOUNTAIN. SEE 10/A940 AND PLUMBING DRAWINGS.
- NEW GUARDRAIL. SEE 10/A940.


MONTEREY COUNTY GOVERNMENT CENTER  
SCHILLING PLACE - ADA UPGRADES  
ALTERNATE No. 3  
MONTEREY COUNTY GOVERNMENT CENTER  
1441 SCHILLING PLACE  
SALINAS, CA 93901  
APN NO.: 177-181-024

JOB NO.  
**14105.1**  
PRINT DATE: 2.2.2016  
DRAWN BY: JTI  
CHECKED BY: PS  
SET ISSUED:


SHEET NAME:  
**NORTH BLD'G.  
RESTROOMS  
FLOOR PLAN**

SHEET NO.:

**A207**

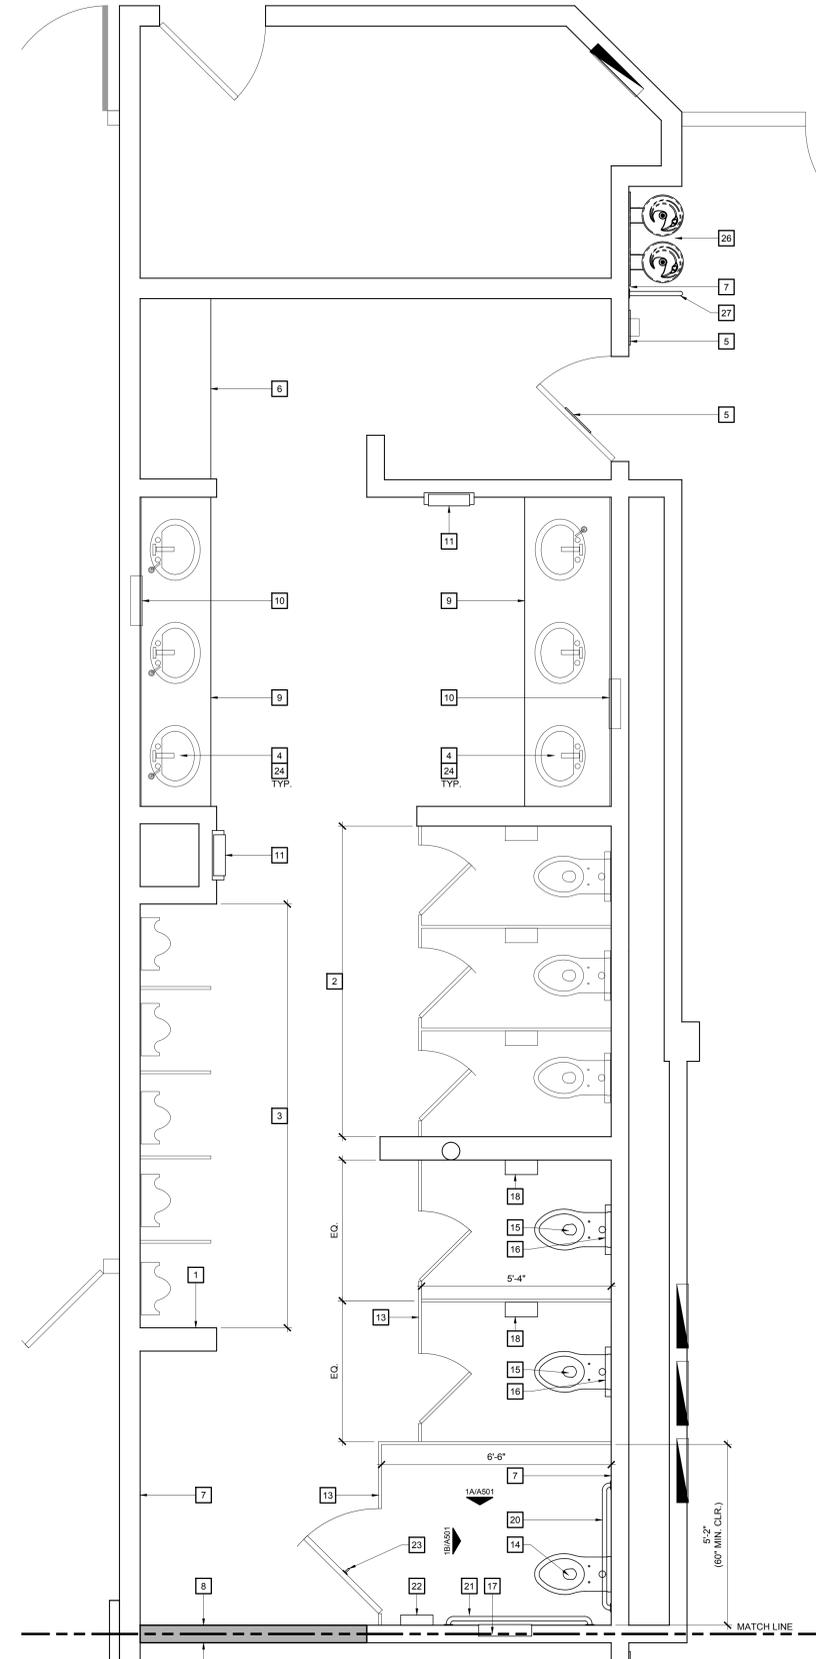

**2 NORTH BUILDING - MENS  
RESTROOMS FLOOR PLAN**  
SCALE: 1/2" = 1'-0"

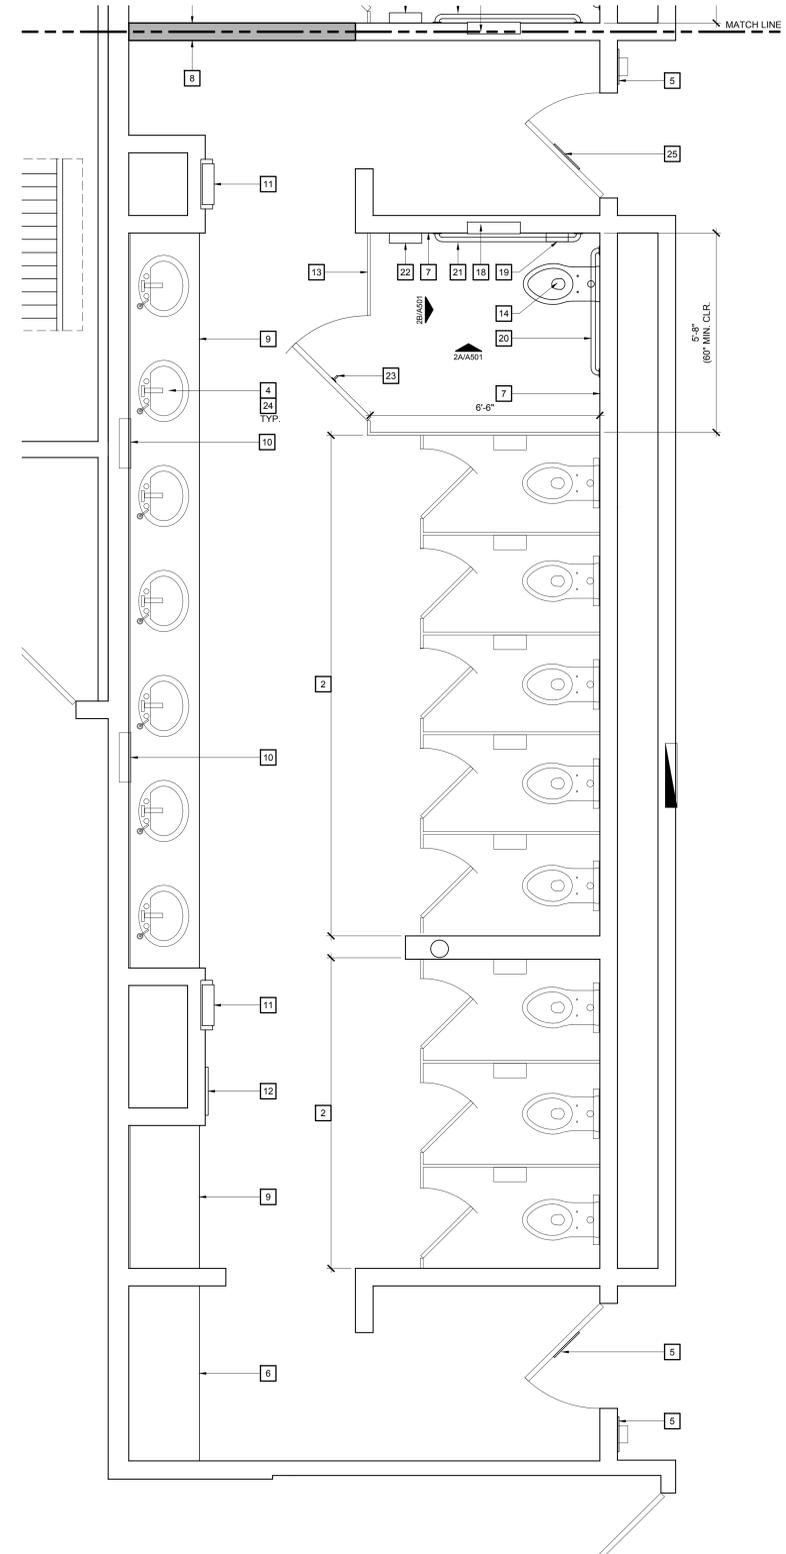


**1 NORTH BUILDING - WOMENS  
RESTROOMS FLOOR PLAN**  
SCALE: 1/2" = 1'-0"

**GENERAL NOTES**


- CLEAN AND RE-USE SPECIFIC EXISTING FIXTURES AND TOILET ROOM ACCESSORIES PER PLAN. ANY DAMAGED ITEMS NOT FEASIBLE FOR RE-INSTALLATION ARE TO BE REPLACED IN KIND.
- PATCH AND REPAIR TILE OR EXISTING WALL FINISH TO MATCH EXISTING AT ALL LOCATIONS WHERE OBJECTS, ACCESSORIES, OR FIXTURES ARE REMOVED. REPLACE ALL TILES WITH SCREW HOLES, MARKS OR NOTCHES FROM MOUNTED OBJECTS THAT ARE REMOVED.
- EXISTING TILE FLOORING TO REMAIN. REPLACE ALL TILES WITH SCREW HOLES, MARKS OR NOTCHES FROM FLOOR MOUNTED OBJECTS THAT ARE REMOVED.
- ANY EXTRA FIXTURES AND/OR ACCESSORIES NOT NEEDED FOR RE-INSTALLATION ARE TO BE DISCARDED. RE-USE THE COMPONENTS IN BEST CONDITION.
- ALL DIMENSIONS ARE TO FINISH SURFACE.

**KEY NOTES**

- THE KEY NOTES THAT FOLLOW APPLY TO THE DRAWING(S) ON THIS SHEET ONLY. REFER TO FOLLOWING SHEETS FOR NOTES THAT ARE APPLICABLE TO THOSE DRAWINGS.
- EXISTING COUNTERTOP TO REMAIN.
  - EXISTING SINKS TO REMAIN.
  - EXISTING TOILET STALLS TO REMAIN.
  - EXISTING URINALS TO REMAIN.
  - EXISTING URINAL PARTITION TO REMAIN.
  - RELOCATED URINAL PARTITION. SEE DETAIL 10/A900. CBC 11B-305.5.
  - NEW OR RELOCATED ACCESSIBLE SIGNAGE. SEE 8/A900.
  - PATCH HOLES IN WALLS. REPLACE DAMAGED TILES. MATCH EXISTING CONDITIONS.
  - DRAIN TRAP AND HOT WATER PIPING SHALL BE INSULATED TO PREVENT DIRECT CONTACT. CBC 11B 606.5.
  - EXISTING PAPER TOWEL DISPENSER TO REMAIN.
  - LOWER PAPER TOWEL DISPENSER TO ACCESSIBLE HEIGHT, +40" MAX. A.F.F. PER CBC 11B-603.5.
  - LOWER SANITARY NAPKIN/TAMPON DISPENSER TO ACCESSIBLE HEIGHT, +40" MAX. A.F.F. PER CBC 11B-604.2, CBC 604-4.
  - RELOCATED TOILET PARTITION. RE-SWING DOOR INTO STALL.
  - PROVIDE NEW FLUSH VALVE LOW FLOW WALL MOUNTED ACCESSIBLE HEIGHT TOILET w/ FLUSH ACTIVATION ON THE WIDE SIDE OF FIXTURE. SEE PLUMBING DRAWINGS. CBC 11B-604.2, CBC 604-4.
  - NEW RECESSED TOILET SEAT COVER, TOILET TISSUE DISPENSER. BOBRICK #B-347.
  - EXISTING MIRROR TO REMAIN.
  - RELOCATED SANITARY NAPKIN/TAMPON DISPOSAL CONTAINER.
  - NEW GRAB BAR 42" L. BOBRICK #B-06806 x 42. SEE DETAIL 3 & 4/A900.
  - NEW GRAB BAR 48" L. BOBRICK #B-06806 x 48. SEE DETAIL 3 & 4/A900.
  - RELOCATED SYRINGE DISPOSAL CONTAINER AT ACCESSIBLE HEIGHT, 48" MAX. A.F.F. CBC 11B-308.3.2.
  - PROVIDE NEW HOOK AT ACCESSIBLE HEIGHT, 48" MAX. A.F.F. BOBRICK #B-233. CBC 11B-308.3.2.
  - NEW PORTION OF WALL TO ACCOMMODATE NEW DRINKING FOUNTAIN. MATCH ADJACENT WALL TYPE AND CONDITIONS. RELOCATE ANY PLUMBING CONNECTIONS AFFECTED.
  - MODIFY (SHORTEN) LENGTH OF COUNTERTOP AND MIRROR TO ACCOMMODATE NEW WALL.
  - NEW HI-LO DUAL WALL MOUNT DRINKING FOUNTAIN. SEE SHEET A900 AND PLUMBING DRAWINGS.

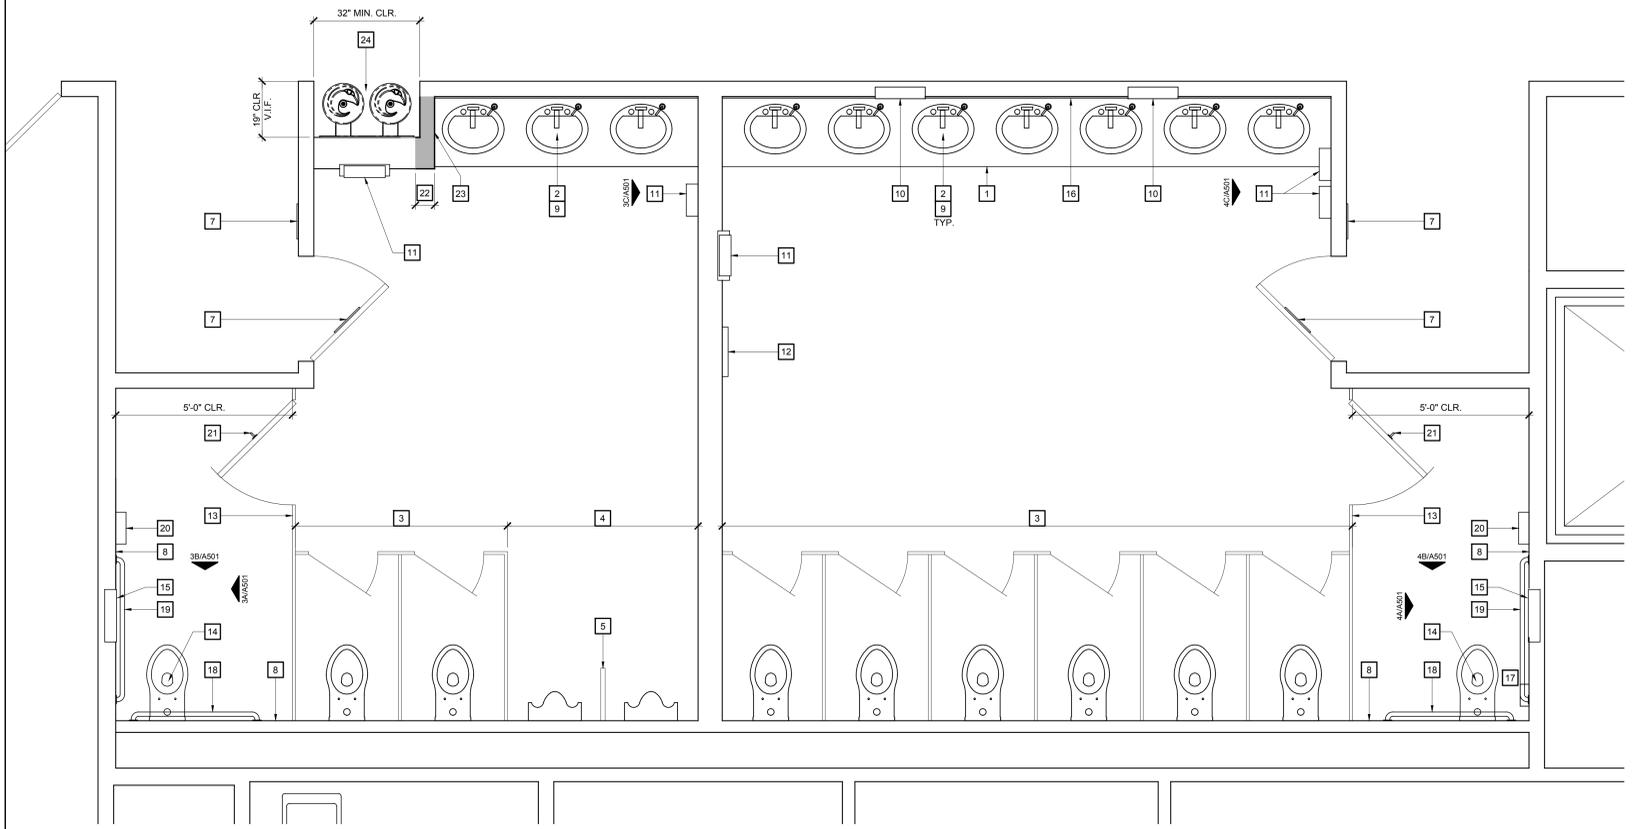

**1 SOUTH BUILDING - FIRST FLOOR RESTROOMS FLOOR PLAN**  
SCALE: 1/4" = 1'-0"

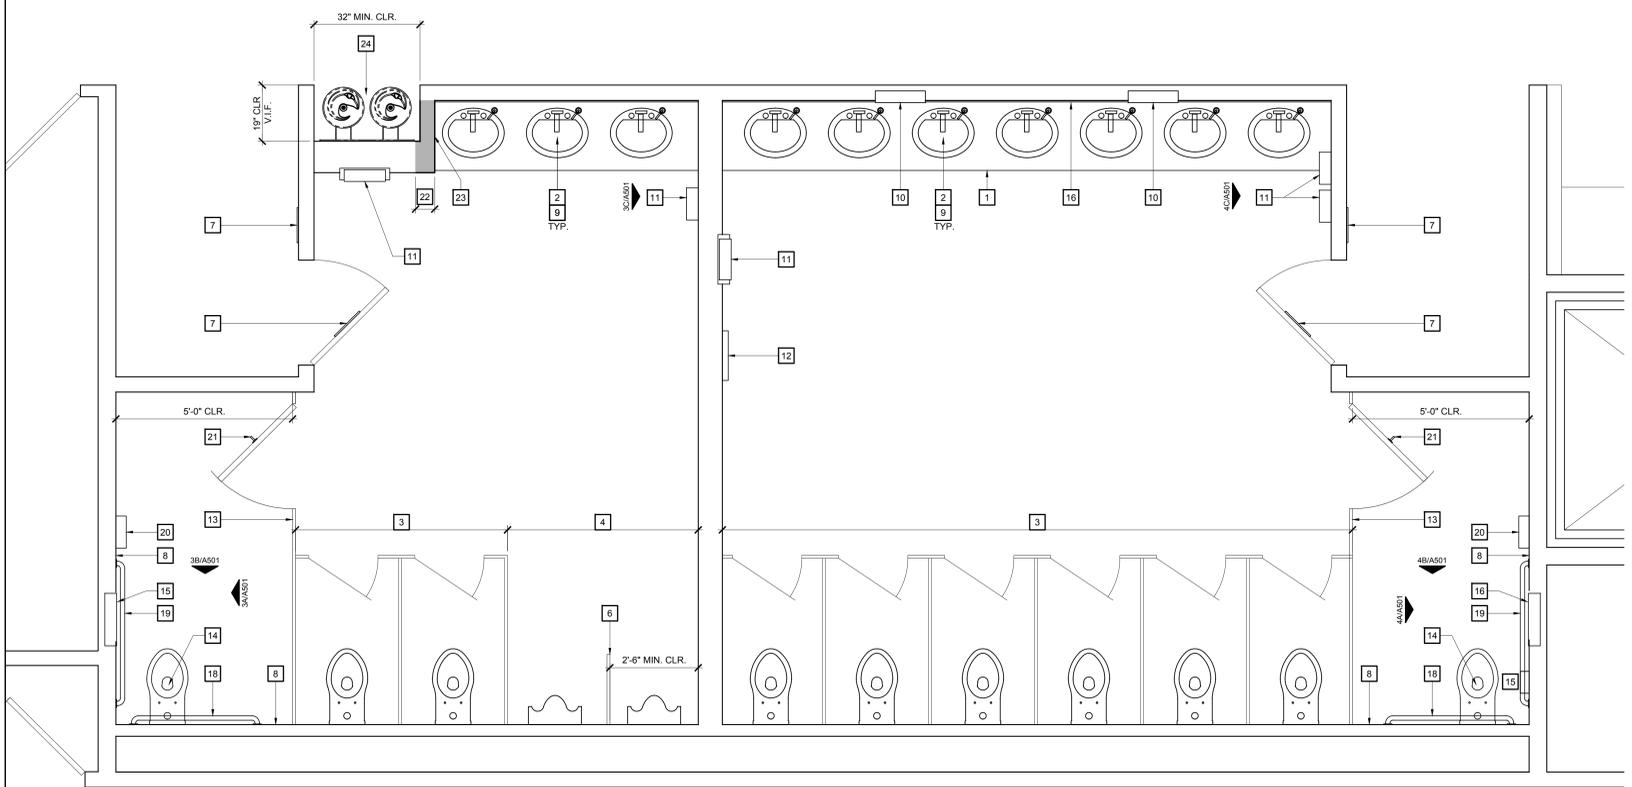

**2 SOUTH BUILDING - SECOND FLOOR RESTROOMS FLOOR PLAN**  
SCALE: 1/4" = 1'-0"

MONTEREY COUNTY GOVERNMENT CENTER  
SCHILLING PLACE - ADA UPGRADES  
ALTERNATE No. 3  
MONTEREY COUNTY GOVERNMENT CENTER  
1441 SCHILLING PLACE  
SALINAS, CA 93901  
A.P.N. NO.: 177-181-024

JOB NO.  
**14105.1**  
PRINT DATE: 2.2.2016  
PLOT DATE: 2.2.2016  
DRAWN BY: JTI  
CHECKED BY: PS  
SET ISSUED:

SHEET NAME:  
**SOUTH BLD'G.  
RESTROOMS  
FLOOR PLAN**

SHEET NO.:


**A208**







**KEY NOTES**

- THE KEY NOTES THAT FOLLOW APPLY TO THE DRAWING(S) ON THIS SHEET ONLY. REFER TO FOLLOWING SHEETS FOR NOTES THAT ARE APPLICABLE TO THOSE DRAWINGS.
- 1 NO WORK TO OCCUR AT THIS LEVEL.
  - 2 MODIFY HANDRAIL EXTENSION. SEE DETAIL 5/A940, CBC 11B-505.10.3.
  - 3 MODIFY WOOD HANDRAIL EXTENSION. SEE DETAIL 9/A940 (2nd FLOOR) AND 8/A940 (LANDING).
  - 4 ADD CONTRASTING COLOR STRIPE. SEE DETAIL 6/A940, CBC 11B-504.4.1.
  - 5 MODIFIED LOBBY COUNTER. SEE DETAIL 5/A951.
  - 6 MODIFIED LOBBY COUNTER & NEW ACCESSIBLE COUNTER. SEE 1-5/A951.
  - 7 NEW WALL, OR INFILL PORTION OF WALL. MATCH EXISTING, ADJACENT WALL THICKNESSES, MATERIALS AND FINISHES.
  - 8 PROVIDE NEW HI-LO DUAL WALL MOUNT DRINKING FOUNTAIN. SEE DETAIL 10/A900.
  - 9 PROVIDE NEW GRAB BAR AT DRINKING FOUNTAIN. SEE DETAIL 10/A900.
  - 10 PATCH AND REPAIR END WALL CONDITION.

**LEGEND**



THE USE OF THE PLANS AND SPECIFICATIONS IS RESTRICTED TO THE ORIGINAL SITE FOR WHICH THEY WERE PREPARED, AND PUBLICATION HEREIN IS EXPRESSLY LIMITED TO SUCH USE. REUSE, REPRODUCTION OR DISTRIBUTION OF ANY METHOD OR MANNER, OR IN ANY MANNER, WITHOUT THE WRITTEN CONSENT OF WR&D ARCHITECTS LLP IS PROHIBITED. TITLE TO THE PLANS AND SPECIFICATIONS REMAINS WITH THE ARCHITECT AND VISUAL CONTACT WITH THEM CONSTITUTES PRIMA FACIE EVIDENCE OF THE ACCEPTANCE OF THESE RESTRICTIONS.

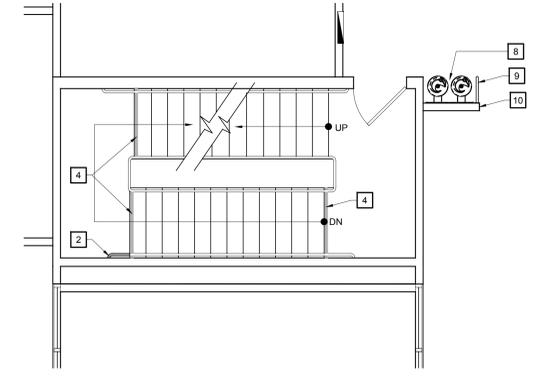
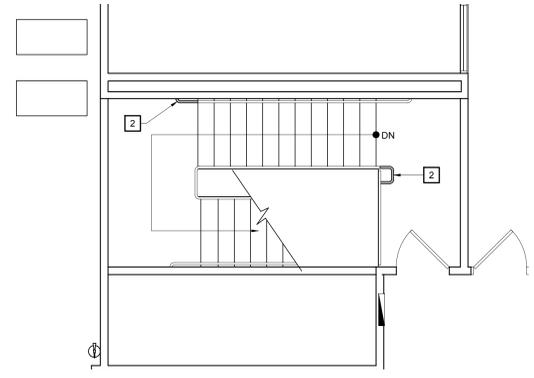
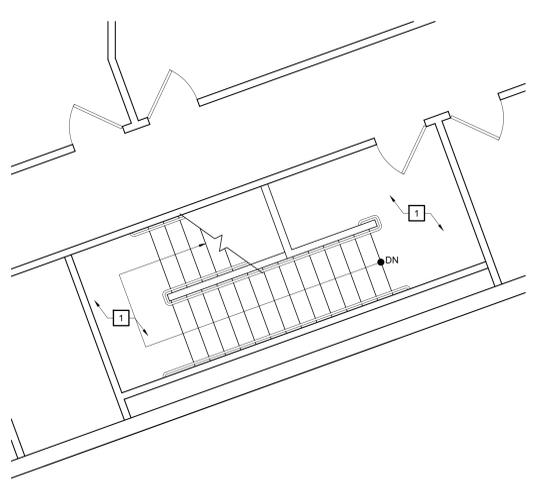
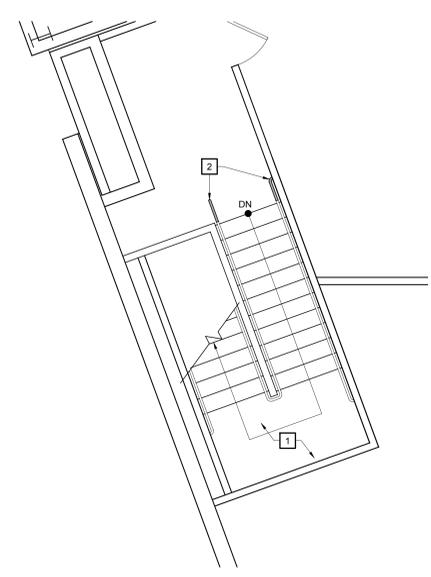


7 **NORTH BUILDING NORTH STAIRWAY (MEZZ.)**  
SCALE: 1/4" = 1'-0"

5 **NORTH BUILDING WEST STAIRWAY (MEZZ.)**  
SCALE: 1/4" = 1'-0"

3 **SOUTH BUILDING SECOND FLOOR - EAST STAIRWAY**  
SCALE: 1/4" = 1'-0"

1 **SOUTH BUILDING SECOND FLOOR - WEST STAIRWAY**  
SCALE: 1/4" = 1'-0"

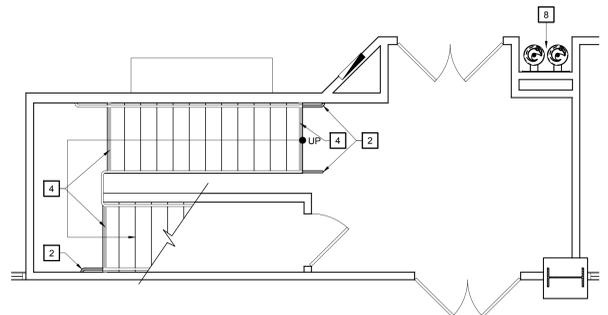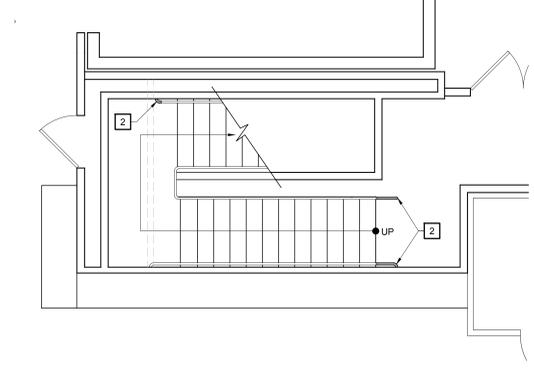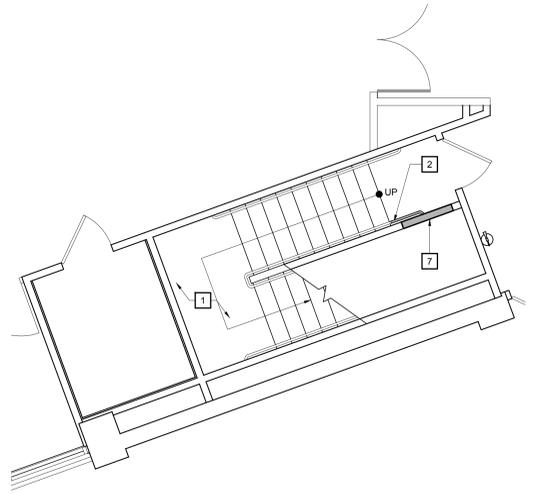
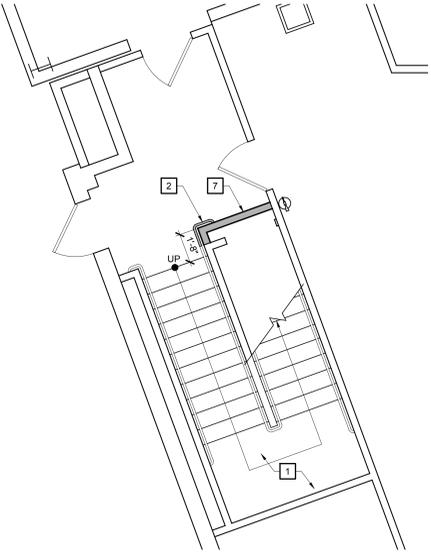


8 **NORTH BUILDING FIRST FLOOR - NORTH STAIRWAY**  
SCALE: 1/4" = 1'-0"

6 **NORTH BUILDING FIRST FLOOR - WEST STAIRWAY**  
SCALE: 1/4" = 1'-0"

4 **SOUTH BUILDING SECOND FLOOR - EAST STAIRWAY**  
SCALE: 1/4" = 1'-0"

2 **SOUTH BUILDING FIRST FLOOR - WEST STAIRWAY**  
SCALE: 1/4" = 1'-0"

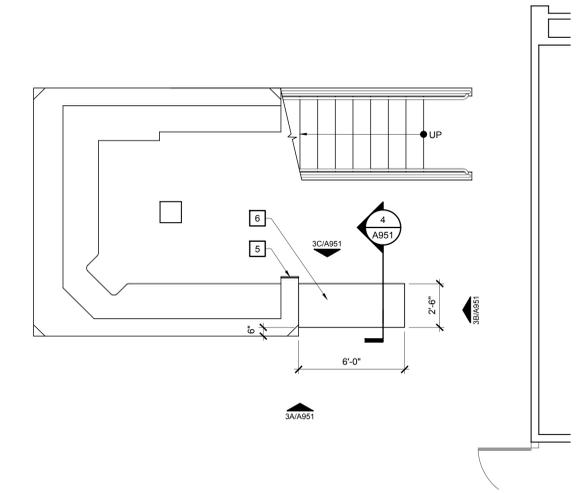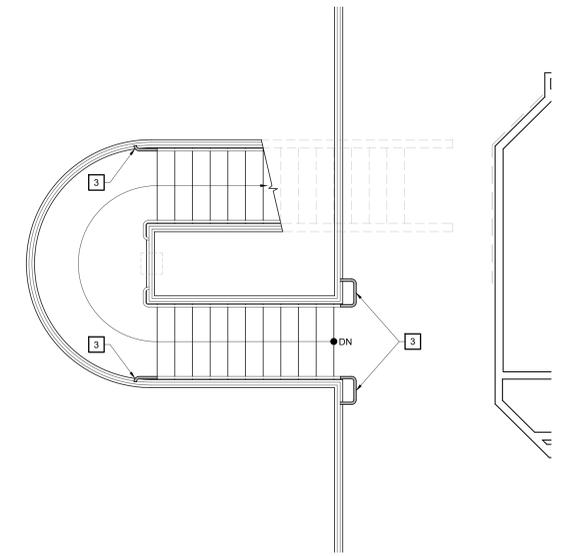

10 **LOBBY STAIRWAY SECOND FLOOR**  
SCALE: 1/4" = 1'-0"

9 **SECURITY COUNTERS AND LOBBY STAIRWAY - FIRST FLOOR**  
SCALE: 1/4" = 1'-0"

MONTEREY COUNTY GOVERNMENT CENTER  
SCHILLING PLACE - ADA UPGRADES  
ALTERNATE No. 3  
MONTEREY COUNTY GOVERNMENT CENTER  
1441 SCHILLING PLACE  
SALINAS, CA 93901  
A.P.N. NO.: 177-181-024

JOB NO.  
14105.1  
PRINT DATE: 2.2.2016  
PLOT DATE: 2.2.2016  
DRAWN BY: JTI  
CHECKED BY: PS  
SET ISSUED:

SHEET NAME:  
NORTH-SOUTH STAIRS-RAILS FLOOR PLANS

SHEET NO.:

A210


14105.1-A210

THE USE OF THE PLANS AND SPECIFICATIONS IS RESTRICTED TO THE ORIGINAL SITE FOR WHICH THEY WERE PREPARED, AND PUBLICATION HEREOF IS EXPRESSLY LIMITED TO SUCH USE. REUSE, REPRODUCTION OR PUBLICATION BY ANY METHOD IN WHOLE OR IN PART IS PROHIBITED. TITLE TO THE PLANS AND SPECIFICATIONS REMAINS WITH THE ARCHITECT AND VISUAL CONTACT WITH THEM CONSTITUTES PRIMA FACIE EVIDENCE OF THE ACCEPTANCE OF THESE RESTRICTIONS.

KEY NOTES

THE KEY NOTES THAT FOLLOW APPLY TO THE DRAWING(S) ON THIS SHEET ONLY. REFER TO FOLLOWING SHEETS FOR NOTES THAT ARE APPLICABLE TO THOSE DRAWINGS.

- 1 EXISTING WALL MOUNTED HANDRAIL TO REMAIN.
- 2 EXISTING HANDRAIL TO REMAIN.
- 3 EXISTING METAL GATE AND BARRIER TO REMAIN.
- 4 EXISTING PATIO ENCLOSURE TO REMAIN.
- 5 EXISTING PUBLIC SIDEWALK.
- 6 EXISTING CURB AND GUTTER.
- 7 EXISTING PUBLIC STREET.
- 8 MODIFY HANDRAIL WHEREBY TOP OF RAIL NOT TO EXCEED 38" CBC 11B-505.4
- 9 MODIFY BOTTOM OF STAIR HANDRAIL WHEREBY HANDRAIL TO SLOPE FOR THE DEPTH OF ONE TREAD PLUS 12 INCHES PARALLEL TO THE FLOOR. CBC 11B-505.10.3. SEE DETAIL 5/24/0.

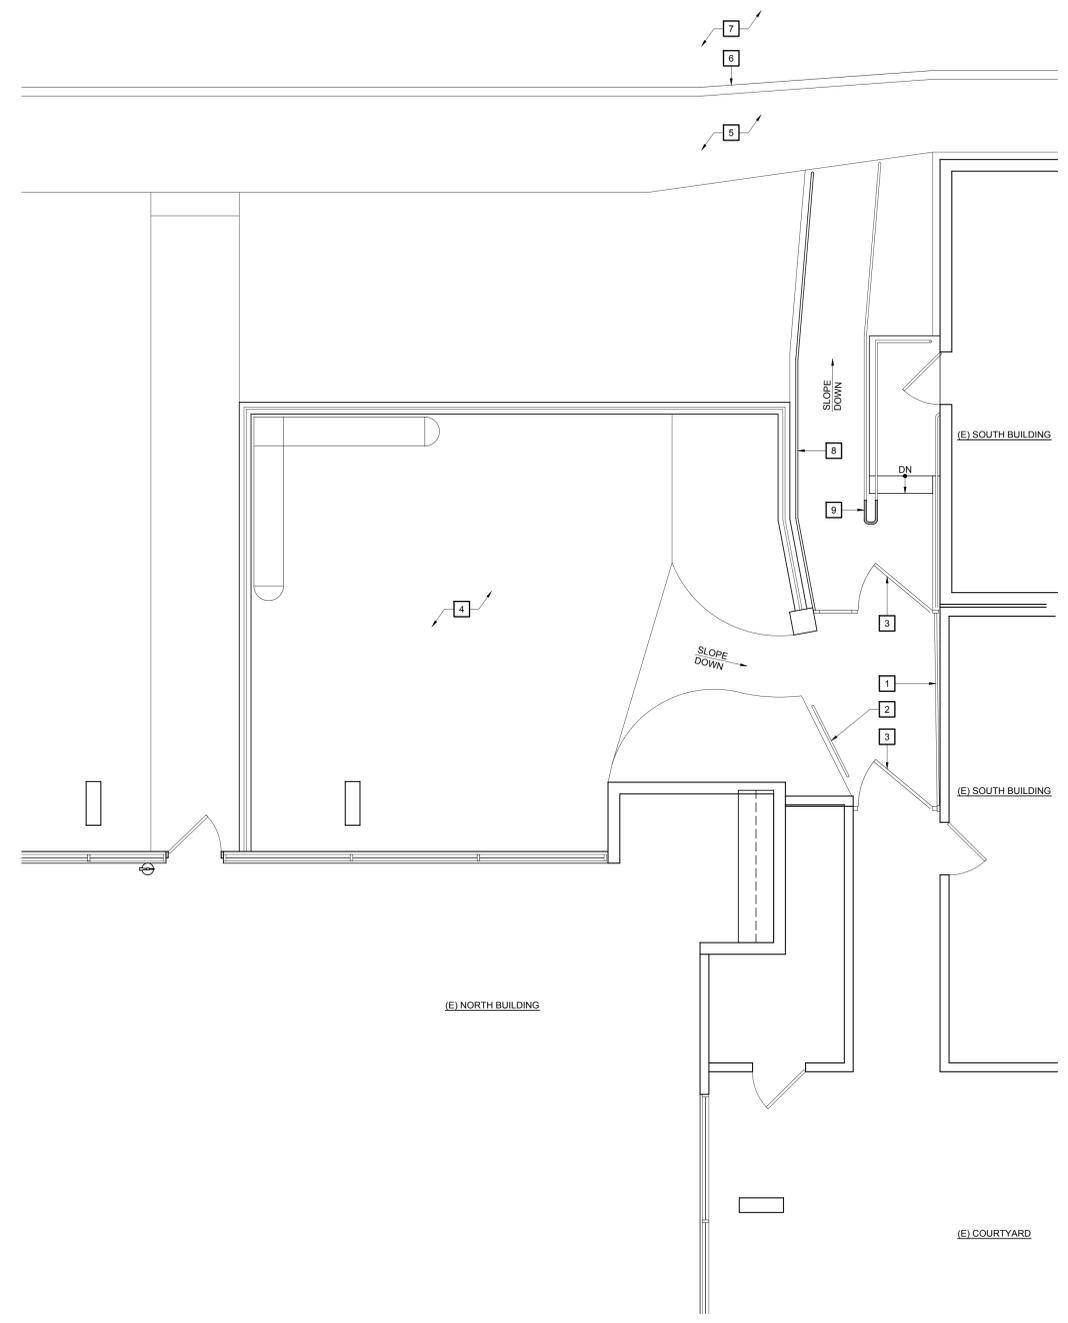

1 PATIO RAILS MODIFICATION PLAN  
SCALE: 1/4" = 1'-0"

MONTEREY COUNTY GOVERNMENT CENTER  
SCHILLING PLACE - ADA UPGRADES  
ALTERNATE No. 3  
AP.N. NO.: 177-181-024

MONTEREY COUNTY GOVERNMENT CENTER  
1441 SCHILLING PLACE  
SALINAS, CA 93901

JOB NO.  
14105.1

PRINT DATE: 2.2.2016

PLOT DATE: 2.2.2016

DRAWN BY: JTI

CHECKED BY: PS

SET ISSUED:

SHEET NAME:  
PATIO RAILS  
MODIFICATION  
PLAN

SHEET NO.:

A211

**GENERAL NOTES**

- CLEAN AND RE-USE SPECIFIC EXISTING FIXTURES AND TOILET ROOM ACCESSORIES PER PLAN. ANY DAMAGED ITEMS NOT FEASIBLE FOR RE-INSTALL ARE TO BE REPLACED IN KIND.
- PATCH AND REPAIR TILE OR EXISTING WALL FINISH TO MATCH EXISTING AT ALL LOCATIONS WHERE OBJECTS, ACCESSORIES, OR FIXTURES ARE REMOVED. REPLACE ALL TILES WITH SCREW HOLES, MARKS OR NOTCHES FROM MOUNTED OBJECTS THAT ARE REMOVED.
- EXISTING TILE FLOORING TO REMAIN, REPLACE ALL TILES WITH SCREW HOLES, MARKS OR NOTCHES FROM FLOOR MOUNTED OBJECTS THAT ARE REMOVED.
- ANY EXTRA FIXTURES AND/OR ACCESSORIES NOT NEEDED FOR RE-INSTALLATION ARE TO BE DISCARDED, RE-USE THE COMPONENTS IN BEST CONDITION.
- ALL DIMENSIONS ARE TO FINISH SURFACE.
- REFER TO DETAILS PER KEYNOTES TO CONFIRM MOUNTING HEIGHTS FOR ALL FIXTURES AND ACCESSORIES.

**KEY NOTES**

THE KEY NOTES THAT FOLLOW APPLY TO THE DRAWING(S) ON THIS SHEET ONLY. REFER TO FOLLOWING SHEETS FOR NOTES THAT ARE APPLICABLE TO THOSE DRAWINGS.


- PATCH HOLES IN WALLS, REPLACE DAMAGED TILES, MATCH EXISTING CONDITIONS.
- RELOCATED PAPER TOWEL DISPENSER, 40" MAX. A.F.F. PER CBC 11B-603.5.
- NEW TOILET PARTITION TO MATCH EXISTING. SEE SHEET A901.
- PROVIDE NEW FLUSH VALVE LOW FLOW WALL MOUNTED ACCESSIBLE HEIGHT TOILET w/ FLUSH ACTIVATION ON THE WIDE SIDE OF FIXTURE. REFER TO 3/A900. SEE PLUMBING DRAWINGS, CBC 11B-604.2, CBC 604.4.
- RELOCATED ACCESSIBLE HEIGHT TOILET w/ FLUSH ACTIVATION ON THE WIDE SIDE OF FIXTURE. REFER TO 3/A900. SEE PLUMBING DRAWINGS, CBC 11B-604.2, CBC 604.4.
- RELOCATED STANDARD HEIGHT TOILET w/ FLUSH ACTIVATION ON THE WIDE SIDE OF FIXTURE.
- NEW RECESSED TOILET SEAT COVER, TOILET TISSUE DISPENSER, BOBRICK #B-347.
- RELOCATED SANITARY NAPKIN/TAMPON DISPOSAL CONTAINER.
- RELOCATED SYRINGE STORAGE DISPENSER, REFER TO 7/A900 FOR MOUNTING HEIGHT.
- NEW GRAB BAR 42" L. BOBRICK #B-06806 x 42. SEE DETAIL 3 & 4/A900.
- NEW GRAB BAR 48" L. BOBRICK #B-06806 x 48. SEE DETAIL 3 & 4/A900.
- EXISTING DOOR TO REMAIN.
- NEW INFILL WALL. MATCH ADJACENT WALL THICKNESS, MATERIALS & CONDITIONS.
- RELOCATED URINAL AND CONTROLS, REFER TO 11B/A900.
- RELOCATED RECESSED PAPER TOWEL DISPENSER / TRASH BIN.
- RELOCATED WALL MOUNTED PAPER TOWEL DISPENSER, REFER TO 7/A900 FOR MOUNTING HEIGHT.
- RELOCATED SANITARY NAPKIN/TAMPON DISPENSER, REFER TO 7/A900 FOR MOUNTING HEIGHT.
- RELOCATED WALL MOUNT TOILET TISSUE DISPENSER, REFER TO 7/A900 FOR MOUNTING HEIGHT.
- NEW HI-LO DUAL WALL MOUNT DRINKING FOUNTAIN, REFER TO DETAIL 10A/A900 AND PLUMBING DRAWINGS.
- NOT USED.
- RELOCATED THERMOSTAT CONTROLS.
- RELOCATED WALL MOUNTED HAND SANITIZER DISPENSER, REFER TO 7/A900 FOR MOUNTING HEIGHT.
- RELOCATED WALL MOUNTED SOAP DISPENSER, REFER TO 7/A900 FOR MOUNTING HEIGHT.
- NEW ACCESSIBLE DOOR SIGNAGE, REFER TO DETAIL 8/A900.
- NEW DRINKING FOUNTAIN GUARD RAILS, REFER TO DETAIL 10A/A900.
- EXISTING COUNTER TO REMAIN.
- EXISTING WALL MOUNTED WASTE RECEPTACLE TO REMAIN.
- EXISTING SOFFIT TO REMAIN.
- NEW LIGHTING, REFER TO ELECTRICAL.
- NEW SINK, FAUCET / LEVER, SOAP DISPENSER AND INSULATED PIPING, MATCH EXISTING FIXTURES IN ADJACENT RESTROOMS, SEE PLUMBING DRAWINGS.
- NEW 1/2" MIRROR SET ON CONTINUOUS BED OF MASTIC WITH J-MOLDS TOP AND BOTTOM, BOTTOM OF NEW REFLECTING SURFACE MUST BE MAX. 40" ABOVE FINISH FLOOR, VERIFY EXACT SIZE IN FIELD.
- RELOCATED LOWERED COUNTERTOP / BACKSPLASH, REFER TO FLOOR PLAN FOR SPECIFIC DIMENSIONAL REQUIREMENTS AT THIS LOCATION.
- WALL MOUNTED FOLD-DOWN ACCESSIBLE SHOWER SEAT PER CBC 11B-310.3, BOBRICK-5181
- EXISTING GRAB BAR TO REMAIN.
- NEW ADA COMPLIANT SHOWER CONTROLS AND HAND HELD SPRAY UNIT WITH ADJUSTABLE MOUNTING BAR, SEE PLUMBING DRAWINGS.
- LOWER EXISTING ELECTRICAL J-BOX AS REQUIRED AFTER NEW LOWER COUNTER IS INSTALLED.
- RELOCATED SINK, FAUCET / LEVER, SOAP DISPENSER AND PLUMBING, PLUMBING TO BE INSULATED.
- RELOCATED RECESSED TOILET SEAT COVER DISPENSER, REFER TO 7/A900 FOR MOUNTING HEIGHT.
- NEW COUNTERTOP / BACKSPLASH TO MATCH EXISTING IN ADJACENT RESTROOMS.
- NEW TILE ON EXISTING WALL TO MATCH EXISTING, INSTALL TILE PER 16/A901 ON EXISTING WALL.
- RELOCATED WALL HUNG URINAL PARTITION, REFER TO 11D/A900.

MONTEREY COUNTY GOVERNMENT CENTER  
SCHILLING PLACE - ADA UPGRADES  
ALTERNATE No. 3  
MONTEREY COUNTY GOVERNMENT CENTER  
1441 SCHILLING PLACE  
SALINAS, CA 93901  
APN NO.: 177-181-024


JOB NO.  
14105.1  
PRINT DATE: 2.2.2016  
DRAWN BY: JTT  
CHECKED BY: PS  
SET ISSUED:

SHEET NAME:  
INTERIOR  
ELEVATIONS  
SHEET NO.:


A501

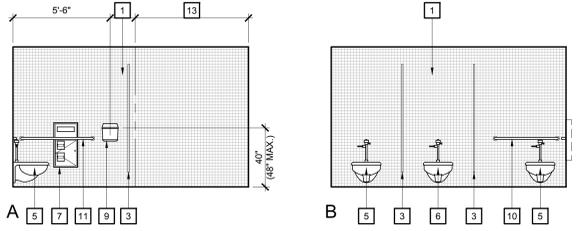


1 **MENS RESTROOM NORTH BUILDING**  
SCALE: 1/4" = 1'-0"

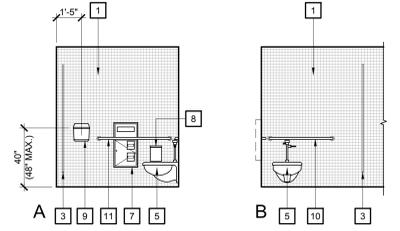


2 **WOMENS RESTROOM NORTH BUILDING**  
SCALE: 1/4" = 1'-0"

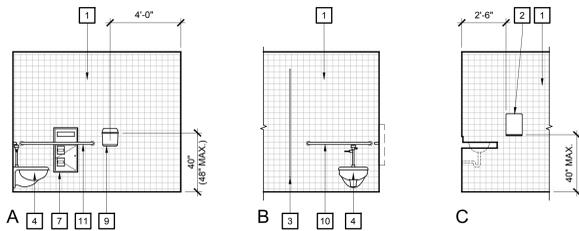


3 **MENS RESTROOMS SOUTH BUILDING**  
SCALE: 1/4" = 1'-0"

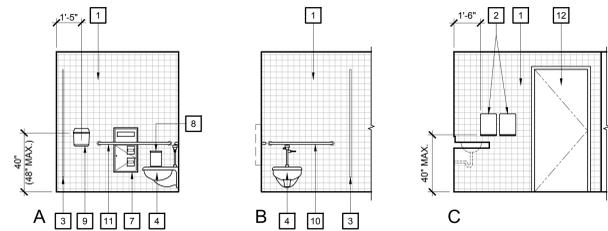


4 **WOMENS RESTROOMS SOUTH BUILDING**  
SCALE: 1/4" = 1'-0"

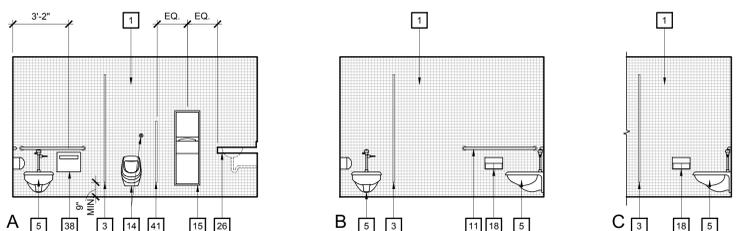


5 **MENS LOCKER ROOM RESTROOM NORTH BUILDING**  
SCALE: 1/4" = 1'-0"

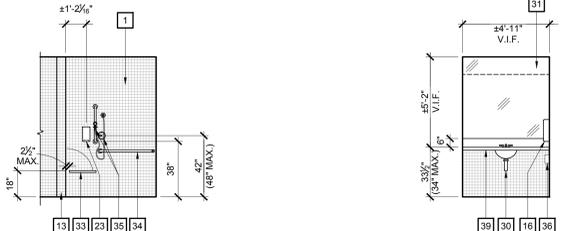

6 **MENS LOCKER ROOM NORTH BUILDING**  
SCALE: 1/4" = 1'-0"




7 **LACTATION ROOM NORTH BUILDING**  
SCALE: 1/4" = 1'-0"



8 **FITNESS CENTER NORTH BUILDING**  
SCALE: 1/4" = 1'-0"



9 **WOMENS LOCKER ROOM NORTH BUILDING**  
SCALE: 1/4" = 1'-0"

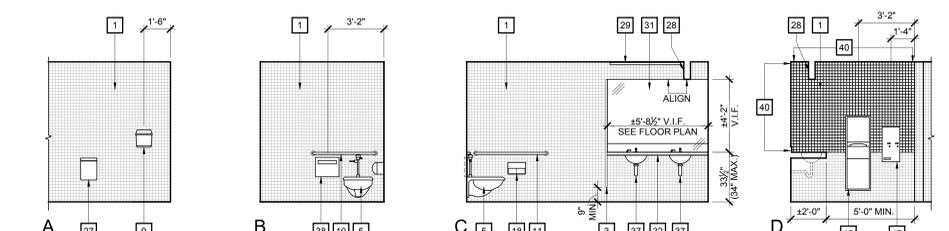


10 **WOMENS LOCKER ROOM RESTROOM NORTH BUILDING**  
SCALE: 1/4" = 1'-0"

### ACCESSIBILITY NOTES


- A. GENERAL**
- All dimensions and clearances within restroom areas shown on details are to be measured from finished surfaces.
  - Doorways leading to men's sanitary facilities shall be identified by an equilateral triangle 1/2" thick with edges 12" long and a vertex pointing upward. Women's sanitary facilities shall be identified by a circle 1/2" thick and 12" in diameter.
  - Unisex sanitary facilities shall be identified by a circle 1/2" thick, 12" diameter, with a 1/2" thick triangle superimposed within the circle.
  - Where a tactile sign is provided at a door, the sign shall be located alongside the door at the latch side. Where a tactile sign is provided at double doors with two active leaves, the sign shall be installed on the wall adjacent to the latch outside of the door. Where a tactile sign is provided at double doors with two active leaves, the sign shall be located to the right of the right hand door. Where there is no wall space at the latch side of a single door or at the right side of double doors, signs shall be located on the nearest adjacent wall. Signs containing tactile characters shall be located so that a clear floor space of 18" min. by 18" min., centered on the tactile characters, is provided beyond the arc of any door swing between the closed position and 45 degree open position. Tactile characters on signs shall be located 48" min. above the finish floor or ground surface, measured from the baseline of the lowest tactile character and 60" max. above the finish floor or ground surface, measured from the baseline of the highest tactile character.
  - There shall be sufficient space in the toilet room for a wheelchair measuring 30" wide by 48" long to enter the room and permit the door to close.
  - There shall be in the room a clear floor space of at least 60" in diameter, or a T-shaped space. No door shall encroach into this space for more than 12".
  - The water closet shall be located in a space 60" min. clear in width. The side shall provide a minimum of 17" and a maximum of 18" from the center line of the water closet to the adjacent wall. A minimum 48"x60" clear floor space shall be provided in front of the water closet. Provide a minimum 60"x56" clear floor space around water closet when toilet is wall mounted, and a 60" x 59" minimum clear floor space if water closet is floor mounted. No fixture (including sinks) shall obstruct this clear floor space at the water closet.
  - In other than dwelling units, toilet rooms floors shall have a smooth, hard, non-absorbent surface such as portland cement, concrete, ceramic tile or other approved material which extends upward onto the walls at least 5 inches. Walls within water closet compartments shall be similarly finished to a height of 48 inches.

- B. SANITARY FACILITY FIXTURES & ACCESSORIES**
- A minimum of 30"x48" clear space is provided in front of lavatory allowing forward approach.
  - Lavatory faucets are lever type, push type or electronic control mechanism valves that are operable with one hand and do not require tight grasping, pinching or twisting of the wrist. Self closing valves shall maintain a minimum of 10 second open flow of 5 lbs. maximum force required to activate controls.
  - Lavatories adjacent to a wall shall be mounted with a minimum distance of 18" to the center line of the fixture.
  - All lavatories that are designed to be accessible shall be mounted with the rim or counter edge no higher than 34" above the finished floor and vertical clearance measured from the bottom of the apron or outside bottom edge of the lavatory of 29" reducing to 27" at a point located 5" back from edge. Toe clearance under lavatory is under 2" high, 30" wide and extends a minimum of 17" in depth from the front of the lavatory.
  - All piping under lavatories shall be configured, insulated or otherwise covered to prevent contact. There shall be no sharp or abrasive surfaces under lavatories.
  - Controls for water closet flush valves shall be mounted on the wide side of toilet areas and shall require 5 lbs. maximum pressure to operate flush valve.
  - Water closet and urinal flush valves controls and faucet and operating mechanism controls, shall be operable with one hand, shall not require tight grasping, pinching, or twisting of the wrist, and shall be mounted no more than 44" above the floor.
  - Mirrors shall be mounted with the bottom of the reflective surface no higher than 40" from the finished floor elevation.
  - Where towels, sanitary napkins, waste receptacles, and other similar dispensing and disposal fixtures are provided, at least one of each type shall be located with all operable parts, including coin slots, within 40" from the finished floor.
  - Toilet tissue dispensers that control delivery or that do not permit continuous paper flow shall not be used. Dispenser is to be located within 7'-9" of the front edge of the toilet seat to the centerline of the dispenser with 19" min. height from floor to center line of dispenser (below grab bar).
  - The top of the toilet seat 17" to 19" from floor surface measured to the top of a maximum 2" high toilet seat.

- C. GRAB BARS**
- Grab bars shall be located on each side, or on one side and the back of the accessible toilet stall or compartment.
  - Grab bars at the side shall be with the front end positioned 24" in front of the water closet stool and with the back end positioned no more than 12" from the rear wall.
  - Grab bars shall be securely attached 33" above and parallel to the floor, except that where a tank-type toilet is used which obstructs placement at 33", the grab bar may be as high as 36".
  - The diameter or width of the gripping surfaces of a grab bar shall be 1-1/4" to 1-1/2" or the shape shall provide an equivalent gripping surface. If grab bars are mounted adjacent to a wall, the clearance between the wall and the grab bars shall be 1-1/2".
  - No protruding objects shall be mounted 12" above the grab bar or 1-1/2" below the grab bar.


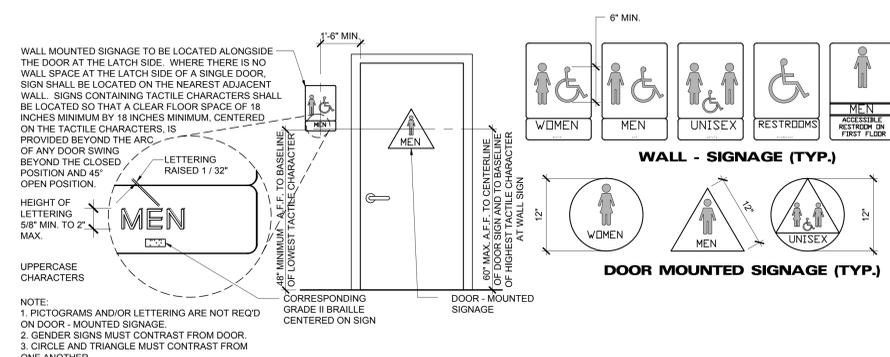


### 8 IDENTIFICATION SYMBOL AT SANITARY FACILITIES

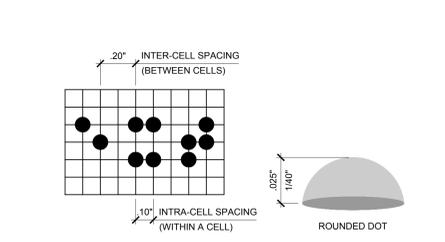


- A. VERT. OR HORIZ. BRAILLE CELL SPACING** **B. BRAILLE DOT**
- PER 2010 CBC, BRAILLE SHALL CONFORM TO THE FOLLOWING:
- BRAILLE CHARACTERS: CONTRACTED GRADE 2 BRAILLE.
  - CALIFORNIA SPACING: DOTS ARE 1/10" O.C. IN EA. CELL WITH 2/10" SPACE BETWEEN CELLS MEASURED FROM THE SECOND COLUMN OF DOTS IN THE FIRST CELL TO THE FIRST COLUMN OF DOTS IN THE SECOND CELL.
  - CHARACTER THICKNESS & SHAPE: DOTS SHALL BE RAISED 1/40" MIN. ABOVE BACKGROUND AND SHALL BE DOMED.
- C. BRAILLE CHARACTER NOTES**


### 9 CONTRACTED GRADE 2 BRAILLE

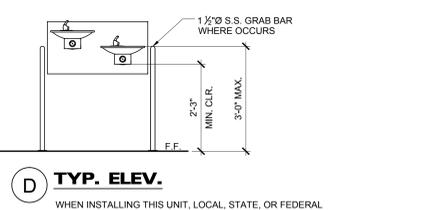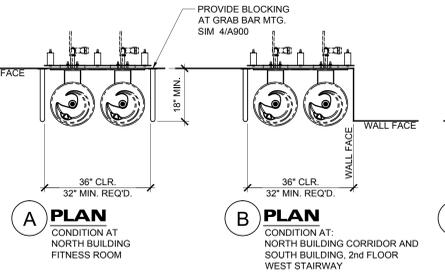


### 10 HI-LO DRINKING FOUNTAIN

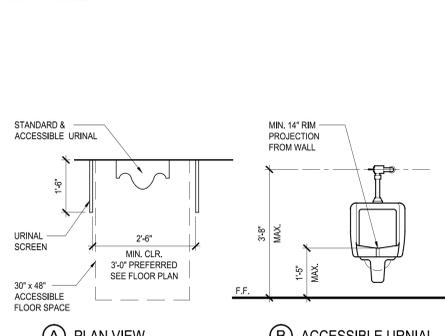


### 11 ACCESSIBLE / STANDARD URINALS

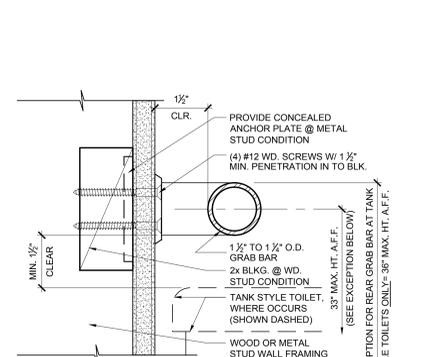


### 4 GRAB BAR

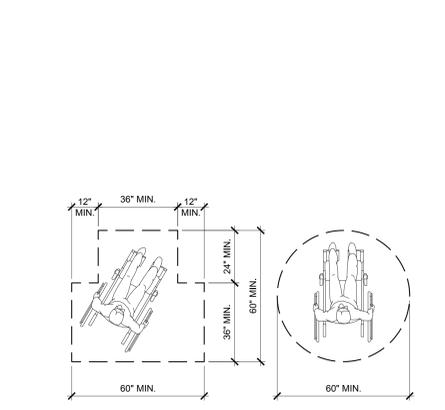

### 5 WHEEL CHAIR TURNING SPACE

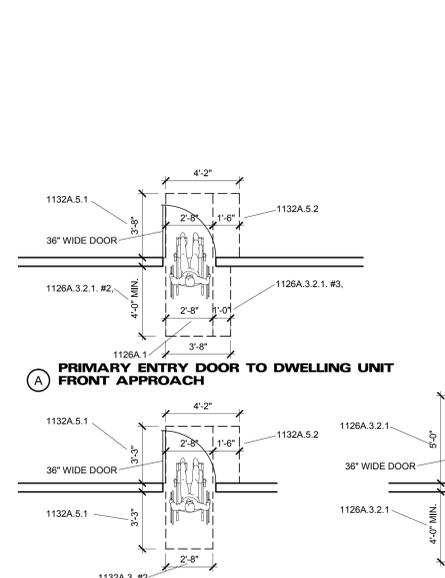

### 6 DOOR CLEARANCES

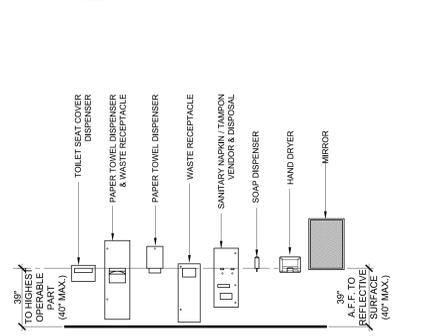


### 7 REQUIRED ACCESSIBLE MOUNTING HEIGHTS




- INTERNATIONAL SYMBOL OF ACCESSIBILITY**
- MINIMUM 5"x5" DECAL TO BE LOCATED AT EACH PRIMARY PUBLIC ENTRANCE AND AT EVERY MAJOR EXTERIOR JUNCTION ALONG OR LEADING TO AN ACCESSIBLE ROUTE OF TRAVEL.
  - MINIMUM 36"x36" PAINTED SYMBOL ON PAVEMENT SHALL BE LOCATED IN STALL SO THAT IT IS VISIBLE BY A TRAFFIC ENFORCEMENT OFFICER WHEN A VEHICLE IS PROPERLY PARALLEL TO THE SPACE, (CENTERED AT STALL ENTRANCE RECOMMENDED)
  - BACKGROUND TO BE BLUE, WHEELCHAIR SYMBOL TO BE WHITE (TYPICAL).

### 1 ACCESSIBILITY SYMBOL

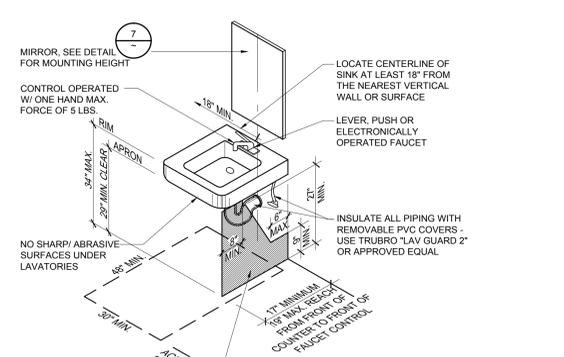


### 2 SINK CLEARANCES

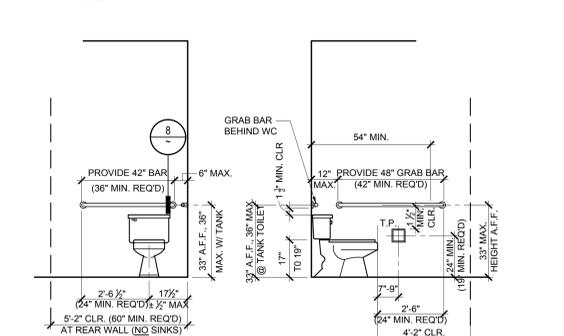


### 3 ACCESSIBLE TOILET




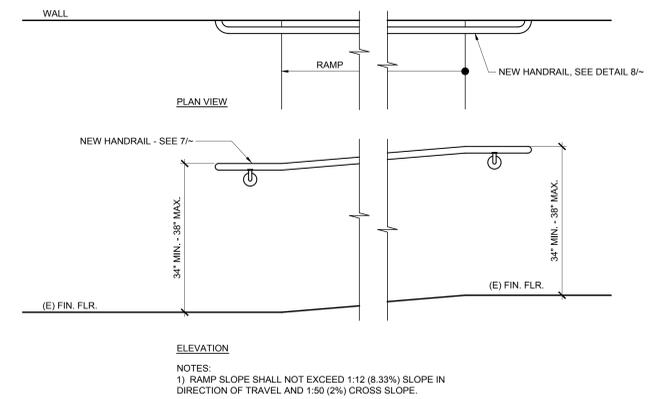


**1 RAMP AND HANDRAILS**  
SCALE: 3/4" = 1'-0"

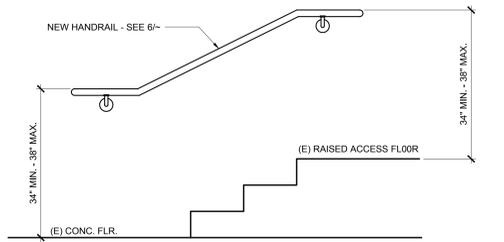


**2 HANDRAIL AT I.T. EXIT RAISED ACCESS FLOOR**  
SCALE: 3/4" = 1'-0"

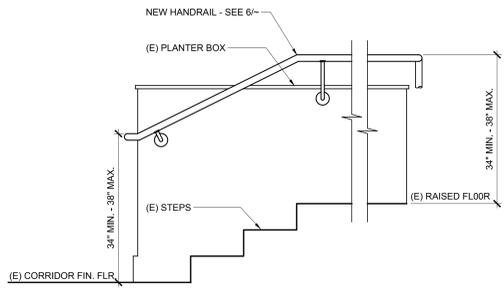


**3 HANDRAIL AT PLANTER BOX STEPS**  
SCALE: 3/4" = 1'-0"

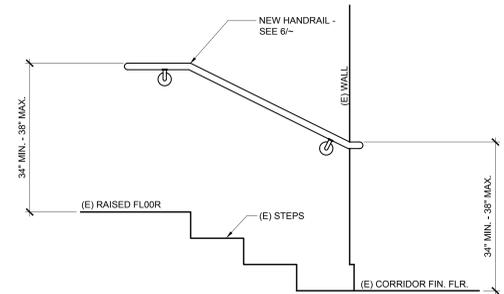


**4 HANDRAIL AT STEPS OPPOSITE PLANTER BOX**  
SCALE: 3/4" = 1'-0"

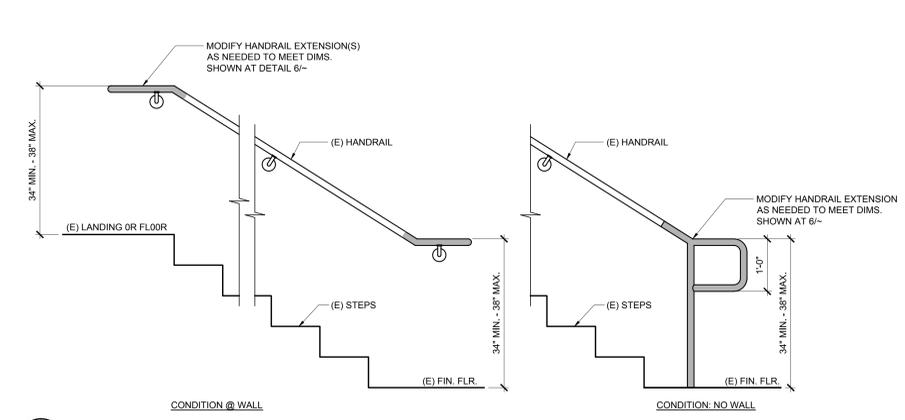


**5 STAIRWAY HANDRAIL REQUIREMENTS**  
SCALE: 3/4" = 1'-0"

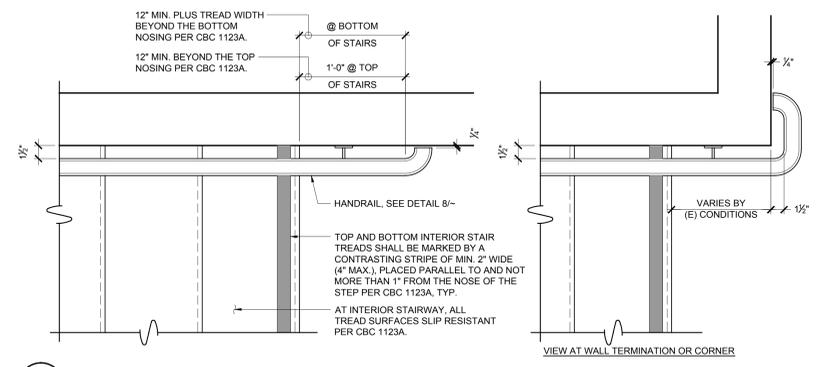


**6 STAIR HANDRAIL REQUIREMENTS**  
SCALE: 1 1/2" = 1'-0"

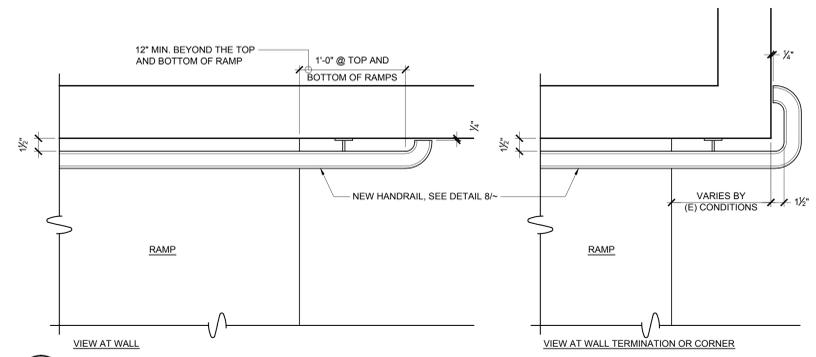

**7 RAMP HANDRAIL REQUIREMENTS**  
SCALE: 1 1/2" = 1'-0"

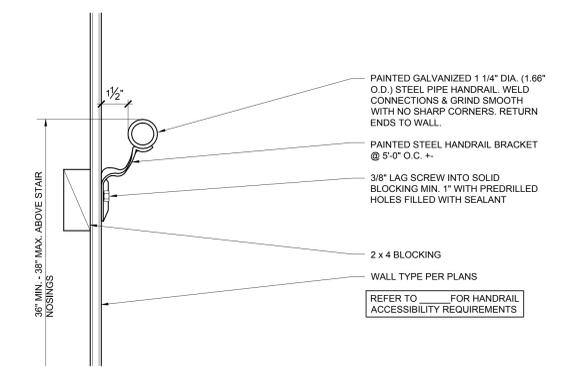

**8 HANDRAIL AT WALL**  
SCALE: 3" = 1'-0"

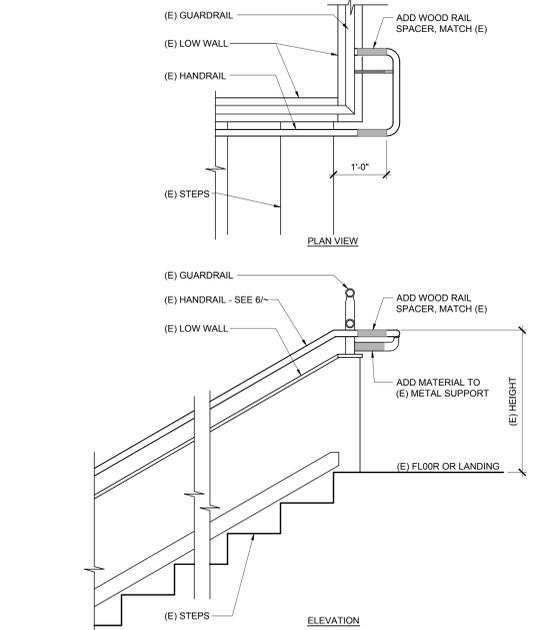


**9 WOOD HANDRAIL EXTENSION**  
SCALE: 3/4" = 1'-0"


**9 WOOD HANDRAIL EXTENSION**  
SCALE: 3/4" = 1'-0"



1 A EXISTING COUNTER

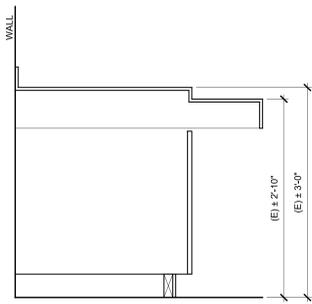

A EXISTING COUNTER

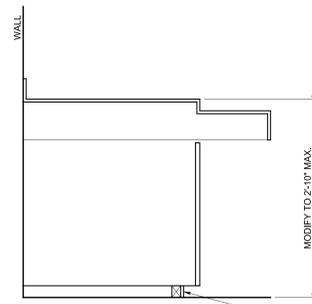


1 A MODIFICATION: REMOVE MATERIAL FROM BASE


NOTE: SLEEPER IS RIPPED TO ACHIEVE MODIFICATION HEIGHT. TRIM AND REPLACE TILE BASE.



1 B EXISTING SALAD BAR

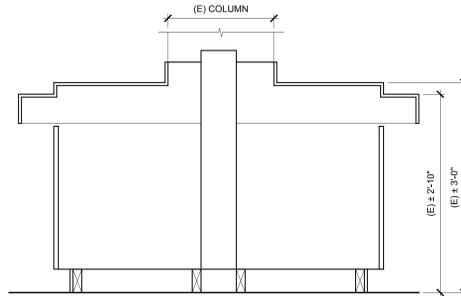

B EXISTING SALAD BAR

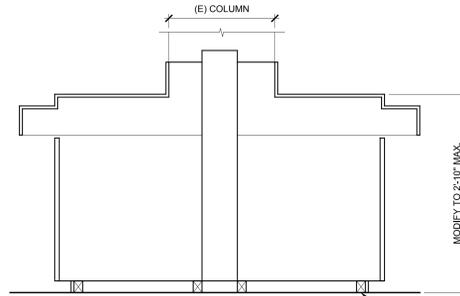


1 B MODIFICATION: REMOVE MATERIAL FROM BASE


NOTE: SLEEPER IS RIPPED TO ACHIEVE MODIFICATION HEIGHT. TRIM AND REPLACE TILE BASE.



1 C EXISTING SOUP / HOT FOODS

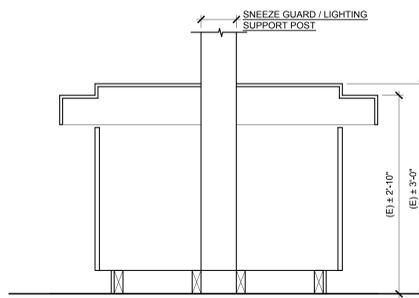

C EXISTING SOUP / HOT FOODS

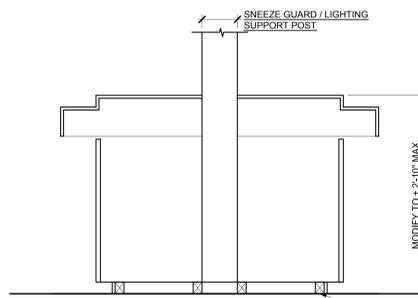

1 C MODIFICATION: REMOVE MATERIAL FROM BASE


NOTE: SLEEPER IS RIPPED TO ACHIEVE MODIFICATION HEIGHT. TRIM AND REPLACE TILE BASE.




1 E EXISTING SERVING COUNTER



1 D EXISTING SERVING COUNTER

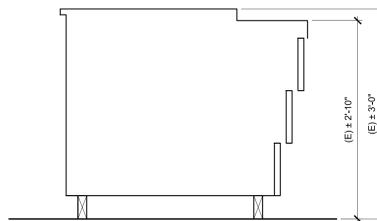

D EXISTING SERVING COUNTER

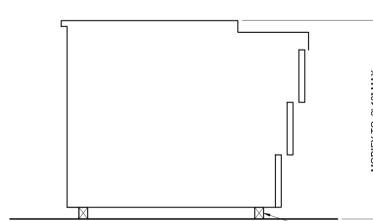


1 D MODIFICATION: REMOVE MATERIAL FROM BASE


NOTE: SLEEPER IS RIPPED TO ACHIEVE MODIFICATION HEIGHT. TRIM AND REPLACE TILE BASE.



2 F EXISTING CASHIER STAND

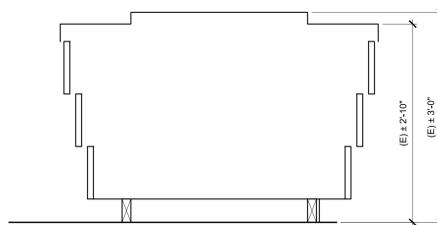

F EXISTING CASHIER STAND

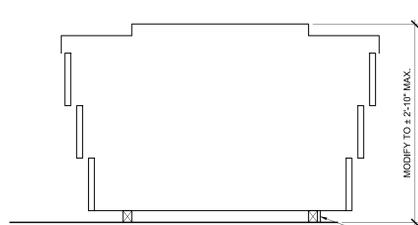


2 F MODIFICATION: REMOVE MATERIAL FROM BASE


NOTE: SLEEPER IS RIPPED TO ACHIEVE MODIFICATION HEIGHT. TRIM AND REPLACE TILE BASE.



3 G EXISTING CONDIMENT STATION



G EXISTING CONDIMENT STATION



3 G MODIFICATION: REMOVE MATERIAL FROM BASE

NOTE: SLEEPER IS RIPPED TO ACHIEVE MODIFICATION HEIGHT. TRIM AND REPLACE TILE BASE.

**KEY NOTES**

- THE KEY NOTES THAT FOLLOW APPLY TO THE DRAWING(S) ON THIS SHEET ONLY. REFER TO FOLLOWING SHEETS FOR NOTES THAT ARE APPLICABLE TO THOSE DRAWINGS.
- 1 SERVERY STATION TO BE LOWERED TO ACCOMMODATE REQUIRED COUNTERTOP HEIGHT FOR ADA ACCESSIBILITY +34" A.F.F. CBC 11B-308.3.2
  - 2 CASHIER STATION TO BE LOWERED TO ACCOMMODATE REQUIRED COUNTERTOP HEIGHT FOR ADA ACCESSIBILITY +34" A.F.F. CBC 11B-308.3.2
  - 3 CONDIMENT STATION TO BE LOWERED TO ACCOMMODATE REQUIRED COUNTERTOP HEIGHT FOR ADA ACCESSIBILITY +34" A.F.F. CBC 11B-308.3.2

**GENERAL NOTES**

- (X) INDICATES GRAPHIC PROFILE / SECTION AND PHOTO OF COUNTER TO BE MODIFIED. TOP OF COUNTER TO CONFORM TO 34" MAX. A.F.F. PER CBC 11B-308.3.2


**KEY NOTES**

THE KEY NOTES THAT FOLLOW APPLY TO THE DRAWING(S) ON THIS SHEET ONLY. REFER TO FOLLOWING SHEETS FOR NOTES THAT ARE APPLICABLE TO THOSE DRAWINGS.

- 1 SOLID SURFACE - FROM SALVAGED MATERIAL, CUT, RESHAPE & POLISH WHERE NEEDED TO MATCH (E) FINISH. ALSO SEE DETAIL 5A951
- 2 PANELS - FROM SALVAGED MATERIAL, CUT, RESHAPE AND MATCH (E) COUNTER.
- 3 TOE KICK - FROM SALVAGED MATERIALS. MATCH (E) COUNTER.
- 4 ALIGN AND MATCH (E) REVEAL.
- 5 (E) BEYOND.

**GENERAL NOTES**

- 1. MATCH (E) FINISHES WHERE FEASIBLE.

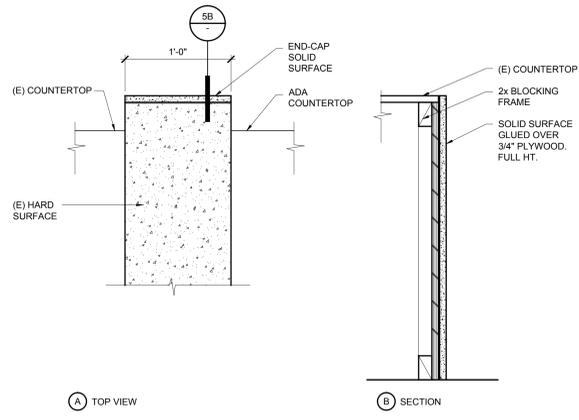

5 **END-CAP DETAIL**  
SCALE: 1 1/2"




A




B


1 **EXISTING COUNTER**  
SCALE: N.T.S

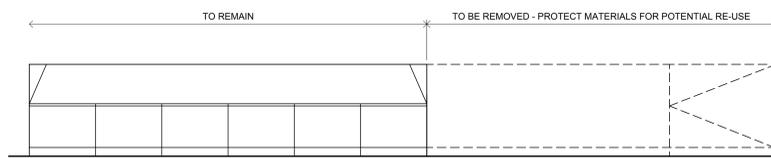


2 **EXISTING COUNTER ELEVATION**  
SCALE: N.T.S

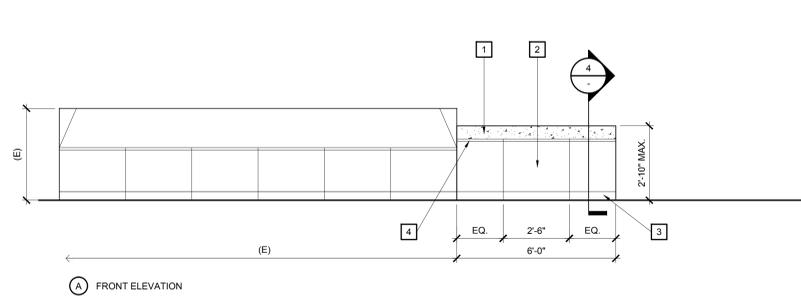

A FRONT ELEVATION




B SIDE ELEVATION

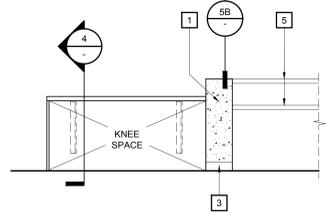

C BACK ELEVATION

3 **MODIFIED COUNTER ELEVATION - LOBBY**  
SCALE: 3/8" = 1'-0"

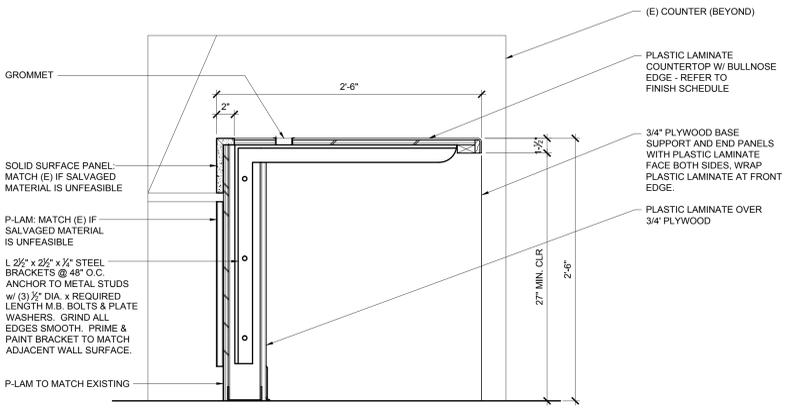

4 **ACCESSIBLE COUNTER SECTION**  
SCALE: FULLSCALE

MONTEREY COUNTY GOVERNMENT CENTER  
SCHILLING PLACE - ADA UPGRADES  
ALTERNATE No. 3  
MONTEREY COUNTY GOVERNMENT CENTER  
1441 SCHILLING PLACE  
SALINAS, CA 93901  
A.P.N. NO.: 177-181-024

JOB NO.  
14105.1  
PRINT DATE: 2.2.2016  
DRAWN BY: ED  
CHECKED BY: PS  
SET ISSUED:

SHEET NAME:  
LOBBY ADA  
COUNTER  
MODIFICATIONS  
SHEET NO.:

THE USE OF THE PLANS AND SPECIFICATIONS IS RESTRICTED TO THE ORIGINAL SITE FOR WHICH THEY WERE PREPARED AND PUBLISHED. THESE SPECIFICATIONS AND PUBLICATIONS ARE NOT TO BE REPRODUCED OR PUBLISHED IN ANY MANNER WITHOUT THE WRITTEN PERMISSION OF WR&D ARCHITECTS LLP. THE PLANS AND SPECIFICATIONS REMAIN THE PROPERTY OF WR&D ARCHITECTS LLP AND VISUAL CONTACT WITH THEM CONSTITUTES A BREACH OF THE TERMS OF ACCEPTANCE OF THESE RESTRICTIONS.



MONTEREY COUNTY GOVERNMENT CENTER  
SCHILLING PLACE - ADA UPGRADES  
ALTERNATE No. 3  
MONTEREY COUNTY GOVERNMENT CENTER  
1441 SCHILLING PLACE  
SALINAS, CA 93901  
JOB NO.  
14105.1  
PRINT DATE:  
PLOT DATE: 2.1.2016  
DRAWN BY: CADD  
CHECKED BY: F.P.  
SET ISSUED:

SHEET NAME:  
SYMBOLS, LIGHT  
FIXT. SCHED.,  
CODES, STAND.  
SHEET INDEX  
SHEET NO.:

E001

## GENERAL CONSTRUCTION NOTES

- CONTRACTOR SHALL COMPLY WITH ALL APPLICABLE CODES AND REGULATIONS. MATERIALS AND EQUIPMENT SHALL BE U.L. LISTED AND LABELED FOR THE APPLICATION.
- THE CONTRACTOR SHALL OBTAIN AND PAY FOR ALL PERMITS, LICENSES AND INSPECTION FEES REQUIRED BY THIS CONTRACT WORK.
- CONTRACTOR SHALL VISIT THE PROJECT SITE PRIOR TO BIDDING AND ALLOW FOR ALL FIELD CONDITIONS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL ELECTRICAL WORK NOTED AND CALLED OUT ON ALL CONTRACT DOCUMENTS. THE CONTRACTOR SHALL OBTAIN INFORMATION AND BE FAMILIAR WITH ALL OTHER TRADES WORK. THE CONTRACTOR SHALL BE RESPONSIBLE FOR COORDINATION BETWEEN OTHER TRADES ON PROJECT.
- CONTRACTOR SHALL BE RESPONSIBLE FOR THE SAFETY OF PERSONS AND PROPERTY AND SHALL PROVIDE INSURANCE COVERAGE AS NECESSARY FOR LIABILITY AND PERSONAL PROPERTY DAMAGE. TO FULLY PROTECT THE OWNER, ARCHITECT AND ENGINEER FROM ANY AND ALL CLAIMS RESULTING FROM THIS WORK.
- CONTRACTOR SHALL MAINTAIN RECORD DRAWINGS AT THE PROJECT SITE INDICATING ALL MODIFICATIONS TO ELECTRICAL SYSTEMS. THE CONTRACTOR SHALL AT THE CONCLUSION OF THE PROJECT PROVIDE ACCURATE "AS-BUILT" DRAWINGS ACCEPTABLE TO THE ARCHITECT.
- ALL MATERIALS PROVIDED TO THE PROJECT SHALL BE NEW. THE CONTRACTOR SHALL BE RESPONSIBLE TO PROVIDE AND INSTALL ALL INCIDENTAL MATERIALS REQUIRED FOR A COMPLETE INSTALLATION.
- CONTRACTOR SHALL PROVIDE TO THE ARCHITECT A CONSTRUCTION SCHEDULE OF ELECTRICAL WORK. THE CONSTRUCTION SCHEDULE SHALL IDENTIFY ALL SIGNIFICANT MILESTONES FOR COMPLETION DATES.
- CONTRACTOR SHALL PROVIDE ALL REQUIRED CUTTING, PATCHING, EXCAVATION, BACKFILL AND REPAIRS NECESSARY TO RESTORE DAMAGED SURFACES TO EQUAL OR BETTER THAN ORIGINAL CONDITIONS EXISTING AT START OF WORK.
- CONTRACTOR SHALL BE RESPONSIBLE FOR PAINTING ALL EXPOSED CONDUITS AND ELECTRICAL EQUIPMENT. REFER TO ARCHITECT'S PAINTING SECTION FOR REQUIREMENTS.
- ALL ELECTRICAL EQUIPMENT INSTALLED OUTDOORS SHALL BE WEATHERPROOF. EXTERIOR CONDUITS RUN INTO BUILDINGS SHALL BE INSTALLED WITH FLASHING, CAULKED AND SEALED. CONDUITS FOR EXTERIOR ELECTRICAL DEVICES SHALL BE RUN INSIDE BUILDING UNLESS OTHERWISE NOTED ON DRAWINGS.
- ALL CONDUITS UNLESS OTHERWISE NOTED ON DRAWINGS SHALL HAVE AS A MINIMUM TWO (2) 1/2" WITH ONE (1) 1/2" GROUND. "TICK" MARKS SHOWN ON CIRCUITRY ARE FOR ROUGH ESTIMATING ONLY. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL WIRES AND WIRE SIZES REQUIRED BY LATEST CODE.
- ALL BRANCH CIRCUITS SHALL HAVE INDIVIDUAL NEUTRALS. SHARED NEUTRALS ON MULTIWIRED CIRCUITS IS NOT ALLOWED.
- ALL 120/277V LIGHT SWITCHES AND WALL OCCUPANT SENSORS SHALL HAVE A NEUTRAL INSTALLED TO THE DEVICE BOX EXCEPT WHERE A CONDUIT OR SURFACE RACEWAY SYSTEM IS INSTALLED.
- COORDINATE ALL CONDUIT RUNS, ELECTRICAL EQUIPMENT AND PANELS WITH ALL OTHER WORK TO AVOID CONFLICTS.
- SEE ARCHITECTURAL DOCUMENTS FOR EXACT PLACEMENT OF LIGHTING FIXTURES AND DEVICES. THE ELECTRICAL CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFICATION OF CEILING TYPES FROM ARCHITECTURAL DOCUMENTS AND PROVIDE AND INSTALL ALL REQUIRED FIXTURE MOUNTING HARDWARE. PROVIDE AND INSTALL U.L. LISTED FIRE STOP ENCLOSURES FOR ALL RECESSED FIXTURES IN FIRE RATED CEILINGS.
- CONTRACTOR SHALL, PRIOR TO BID, FIELD VERIFY ALL REQUIREMENTS FOR MODIFYING THE EXISTING DATA, AND INTERCOM SYSTEMS TO ACCOMMODATE ADDITIONS NOTED. THE CONTRACTOR SHALL PROVIDE ALL MATERIALS NEEDED TO MAKE A FULLY OPERATIONAL SYSTEM AT THE CONCLUSION OF PROJECT WORK.
- CONTRACTOR SHALL PROVIDE IN EVERY EMPTY CONDUIT A DRAW STRING FOR USE IN FUTURE CONSTRUCTION.
- ALL CONDUIT SHALL BE CONCEALED WHERE POSSIBLE. CUT AND PATCH EXISTING WALLS WHERE NECESSARY. WHERE IT IS NECESSARY TO CUT OR REMOVE EXISTING STRUCTURAL MEMBERS FOR NEW ELECTRICAL WORK OBTAIN PERMISSION FROM THE ARCHITECT PRIOR TO STARTING WORK. REUSE EQUIPMENT WHERE POSSIBLE.
- WHERE IT IS NOT POSSIBLE TO REUSE EQUIPMENT CONDUIT OR RUN IN CONCEALED CONDUIT USE NON-METALLIC SURFACE RACEWAY AND BOXES. ROUTING OF ALL NON-METALLIC RACEWAYS SHALL BE APPROVED BY THE ARCHITECT OR OWNER'S REPRESENTATIVE PRIOR TO ROUGH-IN.
- EXTENSION RINGS OR RESET BOXES TO BE FLUSH WITH NEW WALL THICKNESS.
- CONTRACTOR SHALL BE RESPONSIBLE FOR ALL DAMAGE TO UNDERGROUND SYSTEMS (GAS, WATER, TELEPHONE, ELECTRICAL, SEWER, ETC.) THE CONTRACTOR SHALL REPAIR AND PAY ALL EXPENSES FOR DAMAGE TO UNDERGROUND SYSTEMS AS A RESULT OF NEW WORK. REPAIR TO DAMAGED UNDERGROUND SYSTEMS SHALL BE TO THE OWNER'S SATISFACTION WITHOUT EXTRA EXPENSE TO THE OWNER.
- EXISTING WIRING SHOWN HAS BEEN TAKEN FROM OLD PLANS AND IS ASSUMED TO BE CORRECT. ELECTRICAL CONTRACTOR SHALL FIELD VERIFY ACTUAL CONDITIONS AND MAKE ADJUSTMENTS TO SUIT ACTUAL CONDITIONS AND TO MEET THE INTENT OF THE CONTRACT DOCUMENTS.
- WHERE NON-METALLIC SHEATHED CONDUCTORS ARE FOUND, THE CONTRACTOR SHALL REMOVE TO FULLEST EXTENT PER THE GENERAL DEMOLITION NOTES AND REPLACE WITH CONDUIT. METAL CLAD CABLE WILL BE PERMITTED ON A CASE-BY-CASE BASIS ONLY BY WRITTEN APPROVAL FROM THE ARCHITECT.
- ALL INSTALLATION OF EXPOSED SURFACE MOUNTED RACEWAY IN PUBLIC AREAS SHALL BE REVIEWED BY ELECTRICAL ENGINEER BEFORE ROUGH-IN. CONTRACTOR IS TO DETERMINE THE ACCESSIBILITY OF ATTIC, FURRED SPACE, HOLLOW MULLIONS, ETC. IN EACH AREA AND REVIEW WITH ENGINEER. IF SYSTEM CAN BE ROUTED CONCEALED EITHER BY FISHING OR ACCESSIBILITY, CONTRACTOR IS TO DO SO. IF INACCESSIBILITY IS DETERMINED, CONTRACTOR SHALL INSTALL SURFACE MOUNTED RACEWAY. IN THE MOST AESTHETICALLY PLEASING MEANS AS DETERMINED BY THE ENGINEER. NO ALLOWANCE FOR ADDITIONAL COMPENSATION DUE TO ROUTING AS DIRECTED BY THE ENGINEER WILL BE MADE.

## LIGHT FIXTURE SCHEDULE

- FIXTURE NOTES:**
- ALL FLUORESCENT LED LIGHT FIXTURE BALLASTS DRIVERS SHALL BE ELECTRONIC TYPE, 10% TOTAL HARMONIC DISTORTION MAXIMUM.
  - ALL FLUORESCENT LIGHT FIXTURE LAMPS AND LED LIGHT MODULES SHALL BE ENERGY SAVING 3500°K, 80 CRI MINIMUM, U.O.N. (SEE SPECIFICATIONS FOR MORE INFORMATION).
  - ALL FLUORESCENT BALLASTS AND LED DRIVERS AND ASSOC. FIXTS. SHALL HAVE MANUFACTURERS CERTIFICATION OF COMPLIANCE WITH CALIFORNIA ENERGY COMMISSION STANDARDS AND REQUIREMENTS, WHERE SUCH ARE USED IN CONDITIONED SPACES.
  - EXIT SIGNS, EMERGENCY LIGHTS AND LIGHT FIXTURES WITH EMERGENCY BATTERY BACK-UP SHALL SUPPLY A MINIMUM DURATION OF 90 MINUTES OF POWER IN THE EVENT OF A POWER OUTAGE FAILURE.

TYPE	DESCRIPTION	LAMPS	MANUFACTURER
A	4"W x 4"H x 3.1" WALL MOUNTED FIXTURE, HIGH OUTPUT, SINGLE CIRCUIT, WHITE FINISH, UNIVERSAL VOLTAGE.	LED 37W	FINELITE HP4-WMD

## ELECTRICAL SYMBOLS & ABBREVIATIONS

SYMBOLS & ABBREVIATIONS SHOWN ARE FOR GENERAL USE. DISREGARD THOSE WHICH DO NOT APPEAR ON THE PLANS.

FLUORESCENT OR LED LUMINAIRE - SEE SCHEDULE EMERGENCY OR NIGHT LIGHT STRIP FLUORESCENT OR LED LUMINAIRE - SEE SCHEDULE LUMINAIRE - RECESSED - SEE SCHEDULE RECESSED WALL WASHER LUMINAIRE - SURFACE MOUNTED - SEE SCHEDULE LUMINAIRE - POLE OR POST MOUNTED - SEE SCHEDULE LUMINAIRE - WALL MOUNTED SEE SCHEDULE BOLLARD OR PATH LIGHT - SEE SCHEDULE EXIT LIGHT - DIRECTIONAL ARROWS AS INDICATED - SEE SCHEDULE TRACK LIGHTING - SEE SCHEDULE EMERGENCY LIGHT DIGITAL DUAL TECHNOLOGY OCC. SENSOR LIGHTING CONTROL OCCUPANCY SENSOR CORNER MOUNTED DIMMER ROOM CONTROLLER PLUG LOAD CONTROLLER ROOM LIGHTING CONTROLLER LIGHTING CONTROL PANEL DIGITAL DAYLIGHT SENSOR SINGLE POLE SWITCH SINGLE POLE SWITCH - CIRCUIT CONTROLLED THREE WAY SWITCH FOUR WAY SWITCH MANUAL MOTOR STARTER KEY OPERATED SWITCH LIGHTING DIMMER DIGITAL ON OFF SWITCH DIGITAL DIMMER SWITCH DIGITAL MULTI SCENE LIGHTING SWITCH DIGITAL DUAL TECHNOLOGY WALL OCC. SENSOR WALL OCCUPANCY SENSOR DOUBLE SWITCHED WALL OCCUPANCY SENSOR DIMMING DUAL TECHNOLOGY WALL SWITCH OCCUPANCY SENSOR 2-BUTTON DIMMING DUAL TECHNOLOGY WALL SWITCH OCCUPANCY SENSOR FLUORESCENT OR LED LUMINAIRE - SEE SCHEDULE EMERGENCY OR NIGHT LIGHT STRIP FLUORESCENT OR LED LUMINAIRE - SEE SCHEDULE LUMINAIRE - RECESSED - SEE SCHEDULE RECESSED WALL WASHER LUMINAIRE - SURFACE MOUNTED - SEE SCHEDULE LUMINAIRE - POLE OR POST MOUNTED - SEE SCHEDULE LUMINAIRE - WALL MOUNTED SEE SCHEDULE BOLLARD OR PATH LIGHT - SEE SCHEDULE EXIT LIGHT - DIRECTIONAL ARROWS AS INDICATED - SEE SCHEDULE TRACK LIGHTING - SEE SCHEDULE EMERGENCY LIGHT DIGITAL DUAL TECHNOLOGY OCC. SENSOR LIGHTING CONTROL OCCUPANCY SENSOR CORNER MOUNTED DIMMER ROOM CONTROLLER PLUG LOAD CONTROLLER ROOM LIGHTING CONTROLLER LIGHTING CONTROL PANEL DIGITAL DAYLIGHT SENSOR SINGLE POLE SWITCH SINGLE POLE SWITCH - CIRCUIT CONTROLLED THREE WAY SWITCH FOUR WAY SWITCH MANUAL MOTOR STARTER KEY OPERATED SWITCH LIGHTING DIMMER DIGITAL ON OFF SWITCH DIGITAL DIMMER SWITCH DIGITAL MULTI SCENE LIGHTING SWITCH DIGITAL DUAL TECHNOLOGY WALL OCC. SENSOR WALL OCCUPANCY SENSOR DOUBLE SWITCHED WALL OCCUPANCY SENSOR DIMMING DUAL TECHNOLOGY WALL SWITCH OCCUPANCY SENSOR 2-BUTTON DIMMING DUAL TECHNOLOGY WALL SWITCH OCCUPANCY SENSOR SECURITY DOOR CONTACTS SECURITY MOTION DETECTOR CCTV CAMERA - SECURITY CCTV CAMERA - SECURITY ELECTIONS SECURITY SYSTEM KEYPAD DOOR BELL PUSHBUTTON DOOR CHIME WITH LED CONVENIENCE RECEPTACLE - DUPLEX DUPLEX RECEPTACLE MOUNTED ABOVE COUNTER - FIELD VERIFY HEIGHT GFCI CONVENIENCE RECEPTACLE - DUPLEX GFCI CONVENIENCE DUPLEX RECEPTACLE MOUNTED ABOVE COUNTER - FIELD VERIFY HEIGHT DEDICATED RECEPTACLE WITH DEDICATED NEUTRAL RECEPTACLE DOUBLE DUPLEX HALF SWITCHED RECEPTACLE - DUPLEX SINGLE RECEPTACLE CONVENIENCE RECEPTACLE - DUPLEX CEILING MOUNTED LETTER INDICATES DUPLEX HALF CONTROLLED RECEPTACLE LETTER INDICATES DUPLEX FULLY CONTROLLED RECEPTACLE FLOOR MOUNTED DUPLEX RECEPTACLE POWER OUTLET BOX, SEE PLANS FOR NEMA TYPE POWER POLE VOICE DATA WALL OUTLET - INSTALL ABOVE COUNTER - FIELD VERIFY HEIGHT VOICE DATA WALL OUTLET DATA WALL OUTLET NEAR CEILING - 12" BELOW FINISHED CEILING FLOOR MOUNTED VOICE DATA OUTLET TV OUTLET INTERIOR SPEAKERS CEILING MOUNTED INTERIOR SPEAKERS WALL MOUNTED CLOCK - 8-07 U.O.N. VERIFY BEFORE INSTALLATION. THERMOSTAT - SEE MECHANICAL DRAWINGS PANELBOARD - FLUSH MOUNTED EQUIPMENT PANEL - FLUSH MOUNTED PANELBOARD - SURFACE MOUNTED EQUIPMENT PANEL - SURFACE MOUNTED METER W/ CURRENT TRANSFORMER JUNCTION BOX - CEILING OR WALL MOUNTED, SIZE PER CODE, TAPE AND TAG WIRES. MOTOR CONNECTION NON-FUSED DISCONNECT SWITCH FUSED DISCONNECT SWITCH, FUSED WITH DUAL-ELEMENT FUSES, SIZE PER EQUIPMENT MFG'S NAMEPLATE DATA. MAGNETIC STARTER - NEMA SIZE INDICATED, NEMA 3R ENCLOSURE UNLESS OTHERWISE SPECIFIED, CIRCUIT BREAKER. GROUND ROD WITH GROUNDWELL BOX GROUND ELECTRODE NORMALLY OPEN CONTACT. NORMALLY CLOSED CONTACT. TRANSFORMER - SEE SINGLE LINE FOR SIZE. PULLBOX FLEX CONDUIT WITH CONNECTION. CONDUIT - UP. CONDUIT - DOWN. CONDUIT EMERGENCY SYSTEM. CONDUIT - TELEPHONE CONDUIT - TELEVISION LOW VOLTAGE WIRING SURFACE METAL OR NON-METALLIC RACEWAY CONDUIT - CONCEALED IN WALLS OR CEILING. CONDUIT - EXISTING CONDUIT - BELOW SLAB OR UNDERGROUND, 3-4" CAPPED CONDUIT, STUB-OUT CONDUIT CONTINUATION. CONDUIT - HOME RUN TO PANEL, TERMINAL CABINET, ETC. RUNS MARKED WITH CROSSHATCHES INDICATE NUMBER OF 12 AWG WIRES WHEN MORE THAN TWO SIZE CONDUIT ACCORDING TO SPECIFICATIONS AND APPLICABLE CODE. CROSS HATCHES WITH NUMBER ADJACENT INDICATES WIRE SIZE OTHER THAN 12AWG. SHEET NOTE REFERENCE SYMBOL, SEE ASSOCIATED NOTE ON SAME SHEET. SCHEDULE SYMBOL, SEE ASSOCIATED NOTE ON SAME SHEET. DETAIL NOTE REFERENCE SYMBOL, SEE ASSOCIATED NOTE ON SAME DETAIL. INDICATES QUANTITY OF TELEPHONE OUTLETS INDICATES QUANTITY OF DATA OUTLETS 	<p><b>ABBREVIATIONS</b></p> <table border="0"> <tr> <td>A</td><td>AMPERE</td><td>GFCI</td><td>GROUND FAULT INTERRUPTING</td><td>OAH</td><td>OVERALL HEIGHT</td> </tr> <tr> <td>AFF</td><td>ABOVE FINISHED</td><td>GFI</td><td>GROUND</td><td>OC</td><td>ON CENTER</td> </tr> <tr> <td>ALUM.</td><td>ALUMINUM</td><td>GND.</td><td>GALVANI ED RIGID</td><td>OH</td><td>OVERHEAD</td> </tr> <tr> <td>ARCH.</td><td>ARCHITECT</td><td>GRS</td><td>STEEL</td><td>PA</td><td>PUBLIC ADDRESS</td> </tr> <tr> <td>AWG</td><td>AMERICAN WIRE GAUGE</td><td>HT</td><td>HEIGHT</td><td>PB</td><td>PULL BOX</td> </tr> <tr> <td>BKR</td><td>BREAKER</td><td>IDF</td><td>INTERCOM</td><td>PH</td><td>POWER FACTOR PHASE</td> </tr> <tr> <td>C</td><td>CONDUIT</td><td>INCAND.</td><td>INTERMEDIATE DISTRIBUTION FRAME</td><td>PIR</td><td>PASSIVE INFRARED</td> </tr> <tr> <td>CATV</td><td>CABLE TV</td><td>JB</td><td>INCANDESCENT JUNCTION BOX</td><td>PNL</td><td>PANEL</td> </tr> <tr> <td>CB</td><td>CIRCUIT BREAKER</td><td>KV</td><td>KILOVOLT</td><td>PV</td><td>PHOTOVOLTAIC</td> </tr> <tr> <td>CCTV</td><td>CLOSED CIRCUIT TV</td><td>KVA</td><td>KILOVOLT AMPERES</td><td>PWR</td><td>POWER</td> </tr> <tr> <td>CKT</td><td>CIRCUIT</td><td>KW</td><td>KILOWATT</td><td>R</td><td>EXISTING TO BE REMOVED</td> </tr> <tr> <td>CL</td><td>CENTER LINE</td><td>LCP</td><td>LIGHTING CONTROL PANEL</td><td>RP</td><td>REMOVABLE POLE RECEPTACLES</td> </tr> <tr> <td>CLG</td><td>CEILING</td><td>LV</td><td>LOW VOLTAGE</td><td>RE D</td><td>RECEIVED</td> </tr> <tr> <td>CO</td><td>CONDUIT ONLY</td><td>MTS</td><td>THOUSAND</td><td>RE: MTS</td><td>REQUIREMENT SHEET</td> </tr> <tr> <td>CTR</td><td>CENTER</td><td>MTG</td><td>MOUNTING</td><td>SHT</td><td>SHEET</td> </tr> <tr> <td>DIM</td><td>DIMMER</td><td>N</td><td>NOT IN CONTRACT</td><td>S.L.D.</td><td>SINGLE LINE DIAGRAM</td> </tr> <tr> <td>DIST</td><td>DISTRIBUTION</td><td>NEC</td><td>NOT IN ELECTRICAL CODE</td><td>STC</td><td>SYSTEMS TERMINATION CABINET</td> </tr> <tr> <td>E</td><td>EXISTING</td><td>MECH.</td><td>MECHANICAL</td><td>SW</td><td>SWITCH</td> </tr> <tr> <td>EC</td><td>ELECTRICAL CONTRACTOR</td><td>MH</td><td>MAIN LUGS ONLY</td><td>SWBD</td><td>SWITCHBOARD</td> </tr> <tr> <td>EL</td><td>EVENING LIGHT</td><td>MLO</td><td>MAIN POINT OF ENTRANCE</td><td>TTB</td><td>TELEPHONE TERMINAL BOARD</td> </tr> <tr> <td>EM</td><td>EMERGENCY ELECTRICAL</td><td>MPOE</td><td>MOUNTED MOUNTING</td><td>TP</td><td>TYPICAL</td> </tr> <tr> <td>EMT</td><td>METALLIC TUBING</td><td>MTD</td><td>MOUNTING</td><td>UON</td><td>UNLESS OTHERWISE NOTED</td> </tr> <tr> <td>EQUIP</td><td>EQUIPMENT</td><td>NEW</td><td>NEW</td><td>UG</td><td>UNDERGROUND</td> </tr> <tr> <td>FA</td><td>FIRE ALARM</td><td>NIC</td><td>NOT IN ELECTRICAL CONTRACT</td><td>V</td><td>VOLT</td> </tr> <tr> <td>FACP</td><td>FIRE ALARM CONTROL PANEL</td><td>N</td><td>NOT IN ELECTRICAL CONTRACT</td><td>W</td><td>WATT</td> </tr> <tr> <td>FIN</td><td>FINISH</td><td>NL</td><td>NIGHT LIGHT</td><td>WP</td><td>WEATHERPROOF</td> </tr> <tr> <td>FL</td><td>FLOOR</td><td>NOM</td><td>NOMINAL</td><td>XPFR</td><td>TRANSFORMER</td> </tr> <tr> <td>FLUOR.</td><td>FLUORESCENT</td><td>NTS</td><td>NOT TO SCALE</td><td></td><td></td> </tr> <tr> <td>F</td><td>FUTURE</td><td></td><td></td><td></td><td></td> </tr> <tr> <td>GC</td><td>GENERAL CONTRACTOR</td><td></td><td></td><td></td><td></td> </tr> </table>	A	AMPERE	GFCI	GROUND FAULT INTERRUPTING	OAH	OVERALL HEIGHT	AFF	ABOVE FINISHED	GFI	GROUND	OC	ON CENTER	ALUM.	ALUMINUM	GND.	GALVANI ED RIGID	OH	OVERHEAD	ARCH.	ARCHITECT	GRS	STEEL	PA	PUBLIC ADDRESS	AWG	AMERICAN WIRE GAUGE	HT	HEIGHT	PB	PULL BOX	BKR	BREAKER	IDF	INTERCOM	PH	POWER FACTOR PHASE	C	CONDUIT	INCAND.	INTERMEDIATE DISTRIBUTION FRAME	PIR	PASSIVE INFRARED	CATV	CABLE TV	JB	INCANDESCENT JUNCTION BOX	PNL	PANEL	CB	CIRCUIT BREAKER	KV	KILOVOLT	PV	PHOTOVOLTAIC	CCTV	CLOSED CIRCUIT TV	KVA	KILOVOLT AMPERES	PWR	POWER	CKT	CIRCUIT	KW	KILOWATT	R	EXISTING TO BE REMOVED	CL	CENTER LINE	LCP	LIGHTING CONTROL PANEL	RP	REMOVABLE POLE RECEPTACLES	CLG	CEILING	LV	LOW VOLTAGE	RE D	RECEIVED	CO	CONDUIT ONLY	MTS	THOUSAND	RE: MTS	REQUIREMENT SHEET	CTR	CENTER	MTG	MOUNTING	SHT	SHEET	DIM	DIMMER	N	NOT IN CONTRACT	S.L.D.	SINGLE LINE DIAGRAM	DIST	DISTRIBUTION	NEC	NOT IN ELECTRICAL CODE	STC	SYSTEMS TERMINATION CABINET	E	EXISTING	MECH.	MECHANICAL	SW	SWITCH	EC	ELECTRICAL CONTRACTOR	MH	MAIN LUGS ONLY	SWBD	SWITCHBOARD	EL	EVENING LIGHT	MLO	MAIN POINT OF ENTRANCE	TTB	TELEPHONE TERMINAL BOARD	EM	EMERGENCY ELECTRICAL	MPOE	MOUNTED MOUNTING	TP	TYPICAL	EMT	METALLIC TUBING	MTD	MOUNTING	UON	UNLESS OTHERWISE NOTED	EQUIP	EQUIPMENT	NEW	NEW	UG	UNDERGROUND	FA	FIRE ALARM	NIC	NOT IN ELECTRICAL CONTRACT	V	VOLT	FACP	FIRE ALARM CONTROL PANEL	N	NOT IN ELECTRICAL CONTRACT	W	WATT	FIN	FINISH	NL	NIGHT LIGHT	WP	WEATHERPROOF	FL	FLOOR	NOM	NOMINAL	XPFR	TRANSFORMER	FLUOR.	FLUORESCENT	NTS	NOT TO SCALE			F	FUTURE					GC	GENERAL CONTRACTOR				
A	AMPERE	GFCI	GROUND FAULT INTERRUPTING	OAH	OVERALL HEIGHT																																																																																																																																																																																
AFF	ABOVE FINISHED	GFI	GROUND	OC	ON CENTER																																																																																																																																																																																
ALUM.	ALUMINUM	GND.	GALVANI ED RIGID	OH	OVERHEAD																																																																																																																																																																																
ARCH.	ARCHITECT	GRS	STEEL	PA	PUBLIC ADDRESS																																																																																																																																																																																
AWG	AMERICAN WIRE GAUGE	HT	HEIGHT	PB	PULL BOX																																																																																																																																																																																
BKR	BREAKER	IDF	INTERCOM	PH	POWER FACTOR PHASE																																																																																																																																																																																
C	CONDUIT	INCAND.	INTERMEDIATE DISTRIBUTION FRAME	PIR	PASSIVE INFRARED																																																																																																																																																																																
CATV	CABLE TV	JB	INCANDESCENT JUNCTION BOX	PNL	PANEL																																																																																																																																																																																
CB	CIRCUIT BREAKER	KV	KILOVOLT	PV	PHOTOVOLTAIC																																																																																																																																																																																
CCTV	CLOSED CIRCUIT TV	KVA	KILOVOLT AMPERES	PWR	POWER																																																																																																																																																																																
CKT	CIRCUIT	KW	KILOWATT	R	EXISTING TO BE REMOVED																																																																																																																																																																																
CL	CENTER LINE	LCP	LIGHTING CONTROL PANEL	RP	REMOVABLE POLE RECEPTACLES																																																																																																																																																																																
CLG	CEILING	LV	LOW VOLTAGE	RE D	RECEIVED																																																																																																																																																																																
CO	CONDUIT ONLY	MTS	THOUSAND	RE: MTS	REQUIREMENT SHEET																																																																																																																																																																																
CTR	CENTER	MTG	MOUNTING	SHT	SHEET																																																																																																																																																																																
DIM	DIMMER	N	NOT IN CONTRACT	S.L.D.	SINGLE LINE DIAGRAM																																																																																																																																																																																
DIST	DISTRIBUTION	NEC	NOT IN ELECTRICAL CODE	STC	SYSTEMS TERMINATION CABINET																																																																																																																																																																																
E	EXISTING	MECH.	MECHANICAL	SW	SWITCH																																																																																																																																																																																
EC	ELECTRICAL CONTRACTOR	MH	MAIN LUGS ONLY	SWBD	SWITCHBOARD																																																																																																																																																																																
EL	EVENING LIGHT	MLO	MAIN POINT OF ENTRANCE	TTB	TELEPHONE TERMINAL BOARD																																																																																																																																																																																
EM	EMERGENCY ELECTRICAL	MPOE	MOUNTED MOUNTING	TP	TYPICAL																																																																																																																																																																																
EMT	METALLIC TUBING	MTD	MOUNTING	UON	UNLESS OTHERWISE NOTED																																																																																																																																																																																
EQUIP	EQUIPMENT	NEW	NEW	UG	UNDERGROUND																																																																																																																																																																																
FA	FIRE ALARM	NIC	NOT IN ELECTRICAL CONTRACT	V	VOLT																																																																																																																																																																																
FACP	FIRE ALARM CONTROL PANEL	N	NOT IN ELECTRICAL CONTRACT	W	WATT																																																																																																																																																																																
FIN	FINISH	NL	NIGHT LIGHT	WP	WEATHERPROOF																																																																																																																																																																																
FL	FLOOR	NOM	NOMINAL	XPFR	TRANSFORMER																																																																																																																																																																																
FLUOR.	FLUORESCENT	NTS	NOT TO SCALE																																																																																																																																																																																		
F	FUTURE																																																																																																																																																																																				
GC	GENERAL CONTRACTOR																																																																																																																																																																																				

## GENERAL DEMOLITION NOTES

- CONTRACTOR SHALL FIELD VERIFY EXTENT OF ELECTRICAL DEMOLITION AND QUANTITIES OF ELECTRICAL TO BE REMOVED AS DICTATED BY THE REQUIREMENTS OF THE PROJECT.
- REMOVAL SHALL INCLUDE WIRING, RACEWAY, BOXES, SWITCHES, LIGHT FIXTURES, ETC. AS INDICATED ON THE PLANS AND AS REQUIRED BY THESE DEMOLITION NOTES.
- RACEWAYS ASSOCIATED WITH ELECTRICAL BEING DEMOLISHED WHICH ARE CONCEALED IN EXISTING REMAINING WALLS MAY BE ABANDONED IN PLACE. REMOVE WIRING FROM CONDUIT.
- RACEWAYS ASSOCIATED WITH ELECTRICAL BEING DEMOLISHED WHICH ARE EXPOSED SHALL BE REMOVED.
- WHERE REMOVAL OF EQUIPMENT OR WIRING IS INDICATED, IT SHALL INCLUDE ALL ASSOCIATED WIRING BACK TO LAST ACTIVE REMAINING OUTLET, DEVICE, FIXTURE OR PANEL.
- ELECTRICAL CONTRACTOR SHALL INSURE THAT ALL REMAINING ACTIVE CIRCUITS, DEVICES, OUTLETS, LIGHT FIXTURES, ETC. HAVE NOT BEEN DISCONNECTED OR MADE INOPERATIVE DURING DEMOLITION. ELECTRICAL CONTRACTOR SHALL RESTORE ALL INTERRUPTED OR DISCONNECTED CIRCUITS TO OPERATION.
- ELECTRICAL CONTRACTOR SHALL REMOVE AND DISPOSE OF ALL REMOVED ELECTRICAL EQUIPMENT AND MATERIAL.
- NO REMOVED EQUIPMENT OR MATERIAL SHALL BE REUSED AS PART OF NEW WORK, U.O.N.
- EXISTING REMAINING CONCEALED RACEWAYS MAY BE REUSED FOR NEW WORK PROVIDED THEY MEET ALL REQUIREMENTS OF THE SPECIFICATION FOR NEW WORK.
- EXISTING FLUSH OUTLETS MAY BE REUSED FOR NEW WORK PROVIDED THEY MEET ALL REQUIREMENTS OF THE SPECIFICATION FOR NEW WORK, MEET THE REQUIREMENTS OF THE CURRENT C.E.C. FOR VOLUME AND CONDUIT WITH LOCATION SHOWN FOR THE NEW WORK.
- FLUSH OUTLET BOXES IN EXISTING WALLS TO REMAIN MAY BE ABANDONED IN PLACE. REMOVE DEVICES AND WIRING, PLUG OPENING AND PROVIDE AND INSTALL A BLANK DEVICE PLATE.
- EXISTING WIRING SHOWN HAS BEEN TAKEN FROM OLD PLANS AND IS ASSUMED TO BE CORRECT. ELECTRICAL CONTRACTOR SHALL FIELD VERIFY ACTUAL CONDITIONS AND MAKE ADJUSTMENTS TO SUIT ACTUAL CONDITIONS AND TO MEET THE INTENT OF THE CONTRACT DOCUMENTS.
- WHERE TELEPHONE, COMPUTER DATA, FIBER OPTICS, FIRE ALARM OR OTHER COMMUNICATIONS OUTLETS OR WIRING IS TO BE DEMOLISHED IT SHALL BE REMOVED BACK TO THE NEXT TERMINAL POINT. ELECTRICAL CONTRACTOR SHALL COORDINATE WITH OWNER OR HIS REPRESENTATIVE TO HAVE EQUIPMENT AND WIRING DESIGNATED FOR REMOVAL OR PRESERVATION PRIOR TO REMOVAL OF OUTLET BOXES, CONDUIT OR WIRING BY ELECTRICAL CONTRACTOR.
- COORDINATE WITH OWNER PRIOR TO START OF DEMOLITION TO MINIMIZE POWER INTERRUPTIONS. WORK MAY HAVE TO OCCUR DURING NON-REGULAR BUSINESS HOURS. COORDINATE IN WRITING WITH OWNER ONE WEEK PRIOR TO PLANNED POWER INTERRUPTIONS.

## APPLICABLE CODES & STANDARDS


- CODES:**
- 2013 CALIFORNIA ADMINISTRATIVE CODE C.C.R., TITLE 24, PART 1.
  - 2013 CALIFORNIA BUILDING CODE (CBC) C.C.R., TITLE 24 VOL. 1 & 2 BASED ON THE 2012 INTERNATIONAL BUILDING CODE (IBC) WITH CALIFORNIA AMENDMENTS.
  - 2013 CALIFORNIA RESIDENTIAL CODE C.C.R., TITLE 24, PART 2.5 BASED ON THE 2012 INTERNATIONAL RESIDENTIAL CODE WITH CALIFORNIA AMENDMENTS.
  - 2013 CALIFORNIA ELECTRICAL CODE (CEC) C.C.R., TITLE 24, PART 3 BASED ON THE 2011 NATIONAL ELECTRICAL CODE (NEC) WITH CALIFORNIA AMENDMENTS.
  - 2013 CALIFORNIA MECHANICAL CODE (CMC) C.C.R., TITLE 24, PART 4 BASED ON THE 2012 UNIFORM MECHANICAL CODE (UMC) WITH CALIFORNIA AMENDMENTS.
  - 2013 CALIFORNIA PLUMBING CODE (CPC) C.C.R., TITLE 24, PART 5 BASED ON THE 2012 UNIFORM PLUMBING CODE (UPC) WITH CALIFORNIA AMENDMENTS.
  - 2013 CALIFORNIA ENERGY CODE C.C.R., TITLE 24, PART 6.
  - 2013 CALIFORNIA FIRE CODE (CFC) C.C.R., TITLE 24, PART 9 BASED ON THE 2012 INTERNATIONAL FIRE CODE (IFC) WITH CALIFORNIA AMENDMENTS.
  - 2013 CALIFORNIA GREEN BUILDING STANDARDS CODE C.C.R., TITLE 24, PART 11.
  - 2013 CALIFORNIA REFERENCED STANDARDS CODE C.C.R., TITLE 24, PART 12.
  - TITLE 19 C.C.R., PUBLIC SAFETY, STATE FIRE MARSHAL REGULATIONS.
  - NATIONAL FIRE ALARM CODE (NFPA) 72-2013.
  - CITY OF SALINAS ORDINANCES, CODES, AND REGULATIONS.
- STANDARDS:**
- AMERICAN NATIONAL STANDARDS INSTITUTE (ANSI)
  - ELECTRONICS INDUSTRIES ASSOCIATION (EIA)
  - INSTITUTE OF ELECTRICAL AND ELECTRONIC ENGINEERS (IEEE)
  - NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION (NEMA)
  - NATIONAL ELECTRICAL TESTING ASSOCIATION (NETA)
  - UNDERWRITER LABORATORIES (UL)
  - CALIFORNIA OCCUPATIONAL SAFETY AND HEALTH ACT STANDARDS (CAL OSHA)

## SHEET INDEX

E001	SYMBOLS, ABBREVIATIONS, LIGHT FIXTURE SCHEDULE, CODES, STANDARDS - SHEET INDEX.
E200	ELECTRICAL OVERALL PLAN.
E201	FITNESS CENTER ELECTRICAL PLANS.
E202	MEN'S - WOMEN'S RESTROOM ELECTRICAL PLANS.
E203	LOBBY ELECTRICAL PLANS.

**AURUM CONSULTING ENGINEERS**  
MONTEREY BAY, INC.  
Project No. 14233.04  
60 Garden Road, Suite 210, Monterey, CA 93940  
T. 831.646.3330 • F. 831.646.3336 • www.aurumce.com

These drawings are instruments of service and are the property of AURUM CONSULTING ENGINEERS MONTEREY BAY, INC. All designs and other information in the drawings are for use on the specified project and shall not be used otherwise without the expressed written permission of AURUM CONSULTING ENGINEERS MONTEREY BAY, INC.

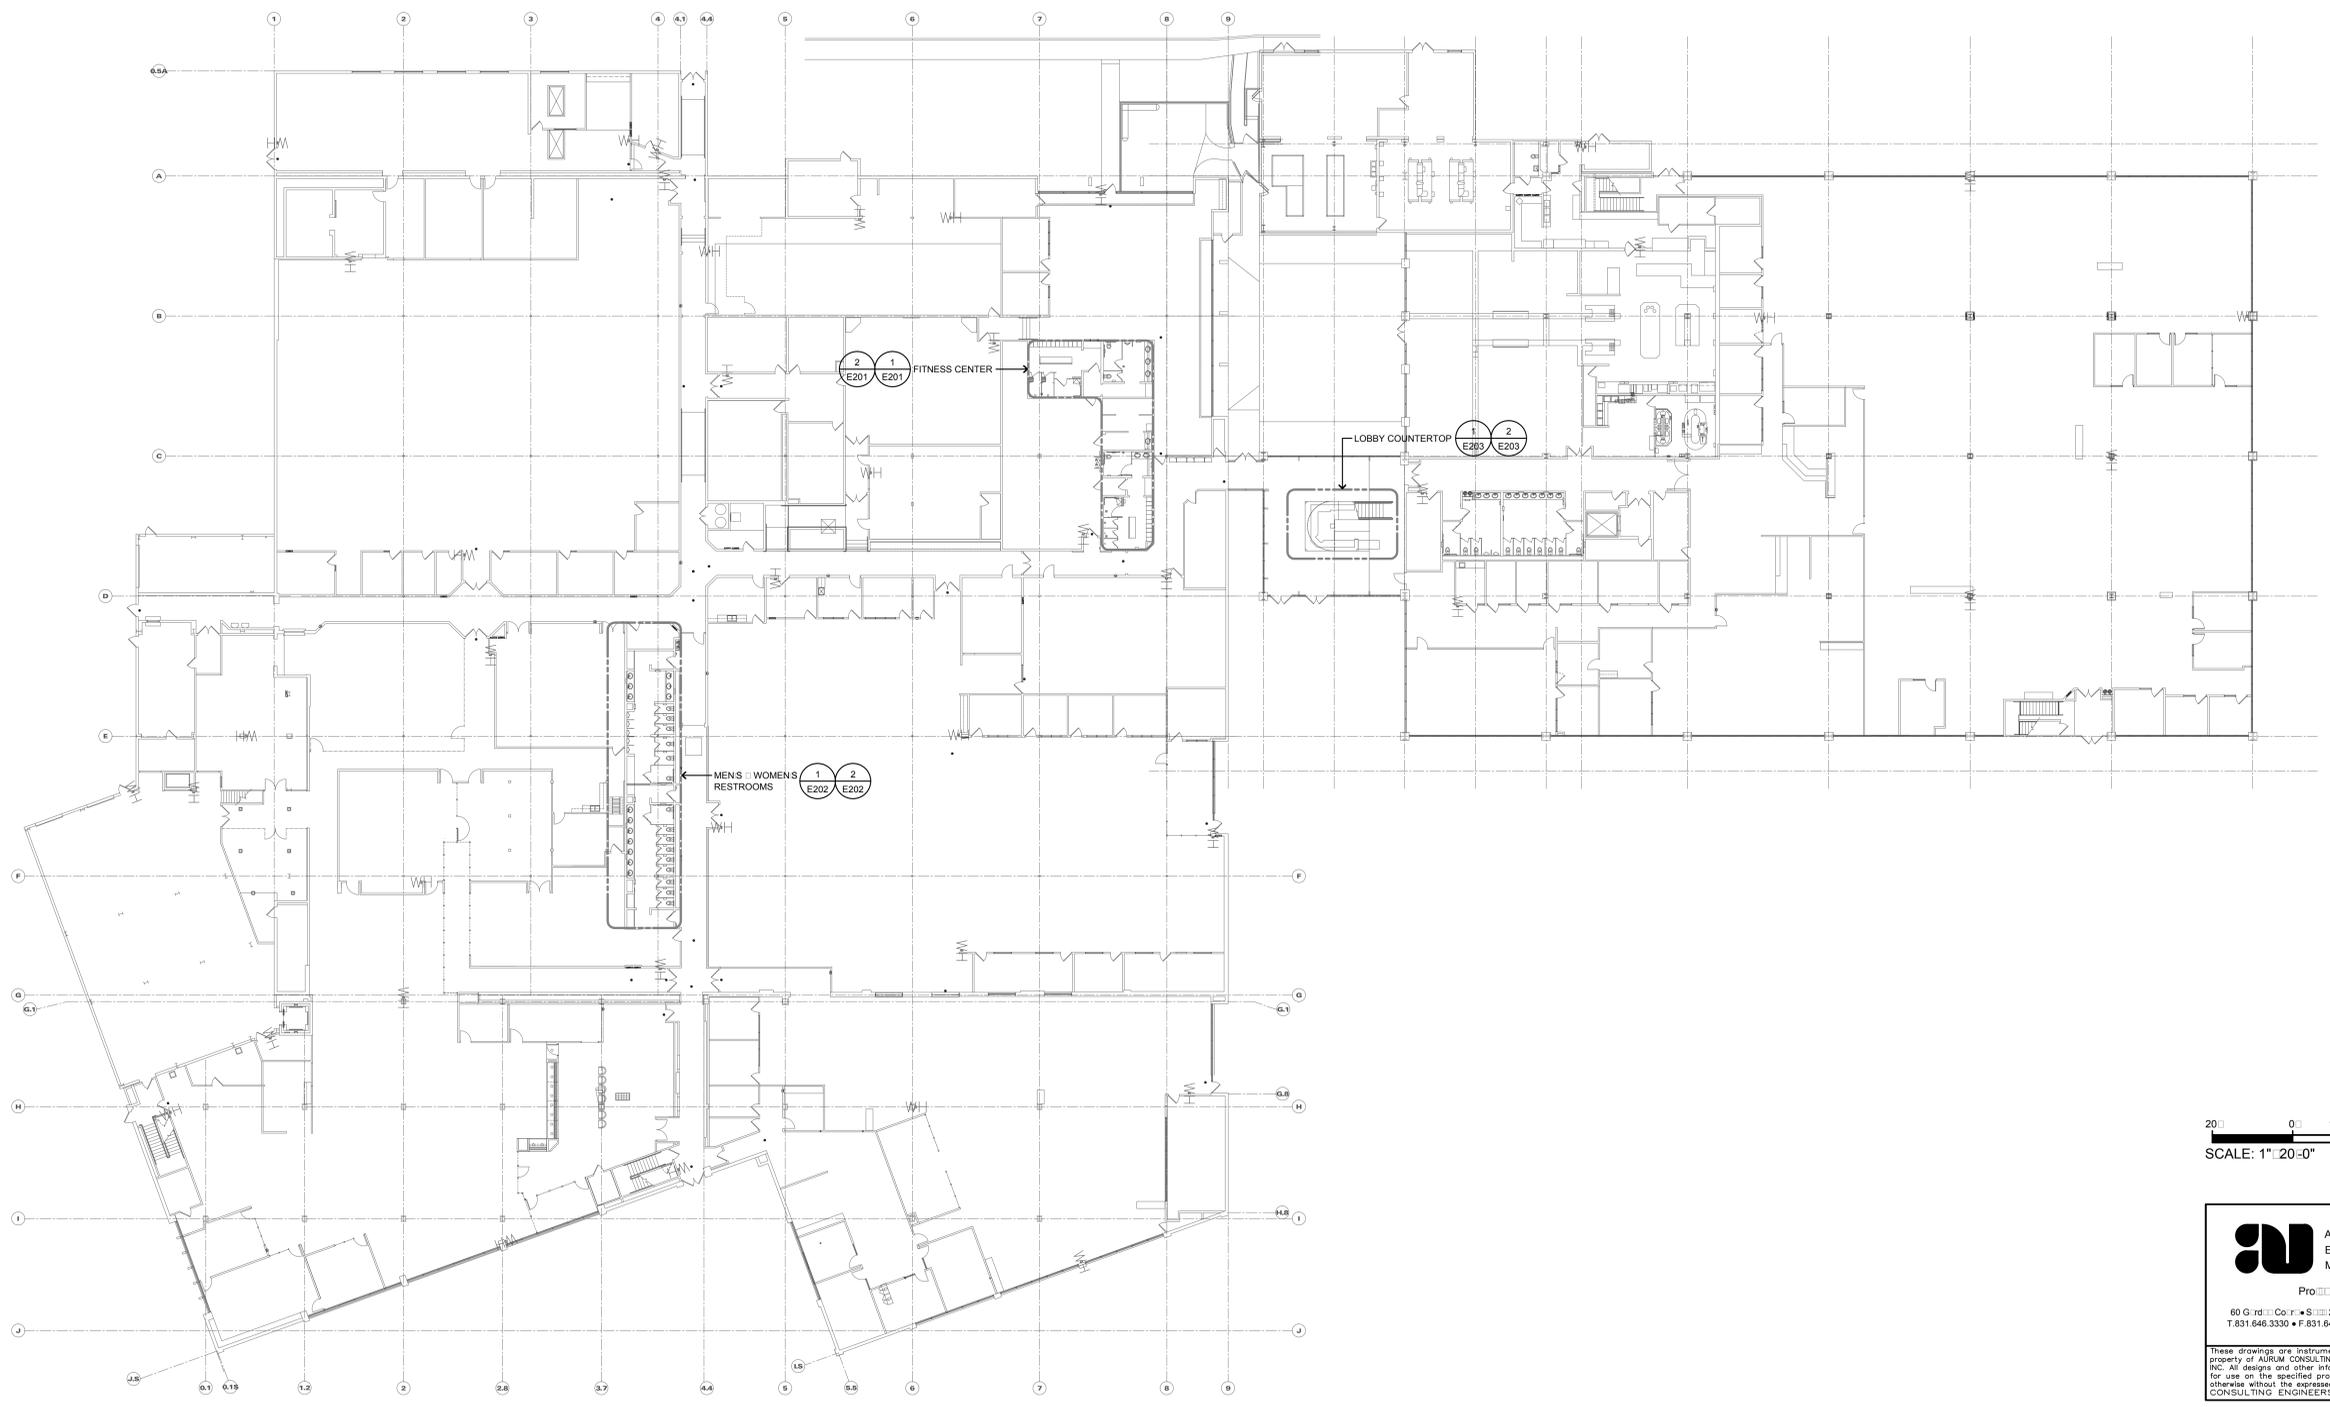

MONTEREY COUNTY GOVERNMENT CENTER  
SCHILLING PLACE - ADA UPGRADES  
ALTERNATE No. 3  
MONTEREY COUNTY GOVERNMENT CENTER  
1441 SCHILLING PLACE  
SALINAS, CA 93901  
A.P.N. NO.: 177-181-024

JOB NO:  
14105.1  
PRINT DATE:  
PLOT DATE: 2.1.2016  
DRAWN BY: CADD  
CHECKED BY: F.P.  
SET ISSUED:




**AURUM CONSULTING ENGINEERS**  
MONTEREY BAY, INC.  
Project No. 14233.04  
60 G. rd. Co. r. • S. 210 • Mo. BAY, CA 93940  
T. 831.646.3330 • F. 831.646.3336 • [www.aurum.com](http://www.aurum.com)


These drawings are instruments of service and are the property of AURUM CONSULTING ENGINEERS MONTEREY BAY, INC. All designs and other information in the drawings are for use on the specified project and shall not be used otherwise without the expressed written permission of AURUM CONSULTING ENGINEERS MONTEREY BAY, INC.

SHEET NAME:  
**ELECTRICAL OVERALL PLAN**  
SHEET NO.:  
**E200**

- SHEET NOTES**
1. RELOCATE EXISTING HORN STROBE ALONG WITH ASSOCIATED CONDUIT AND CONDUCTORS.
  2. RELOCATE EXISTING J-BOX AND CONDUCTORS FOR PAPER TOWEL DISPENSER.
  3. REPLACE EXISTING RECEPTACLE WITH GFCI TYPE.
  4. RELOCATE EXISTING RECEPTACLE FOR UNDER COUNTER REFRIGERATOR.
  5. RECONNECT NEW FIXTURE TO EXISTING LIGHTING CIRCUIT.
  6. CONNECT TO SPARE 20A CIRCUIT AT PANEL.
  7. LOCATE FOR WALL MOUNTED HAND DRYER.
  8. RECONNECT J-BOX TO EXISTING PAPER TOWEL DISPENSER CIRCUIT.
  9. PROVIDE  INSTALL CEILING MOUNTED STROBE. CONNECT TO NEAREST FIRE ALARM ANNUNCIATION DEVICE.

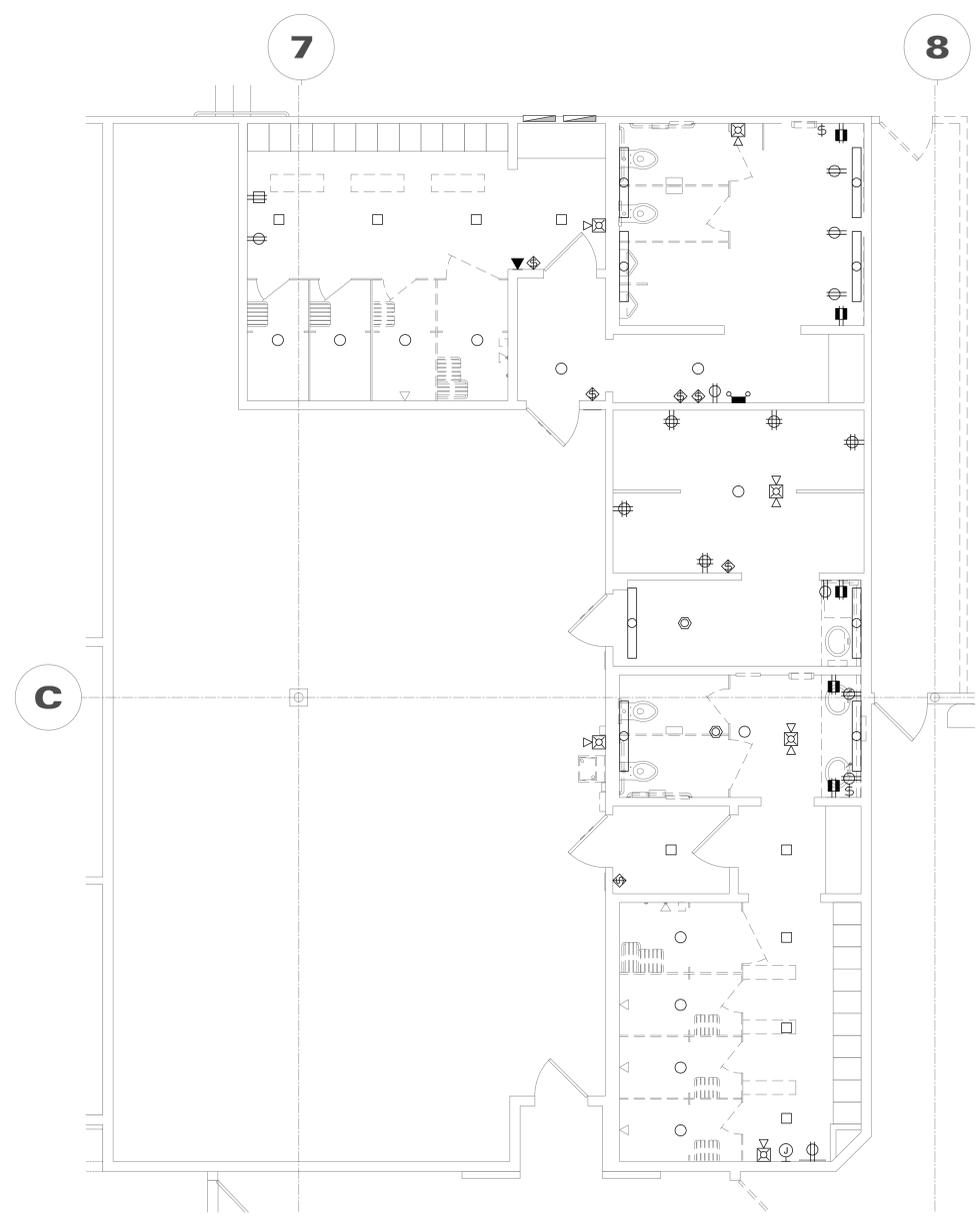

**1 FITNESS CENTER DEMOLITION PLAN**  
SCALE: 1/4" = 1'-0"  
NORTH

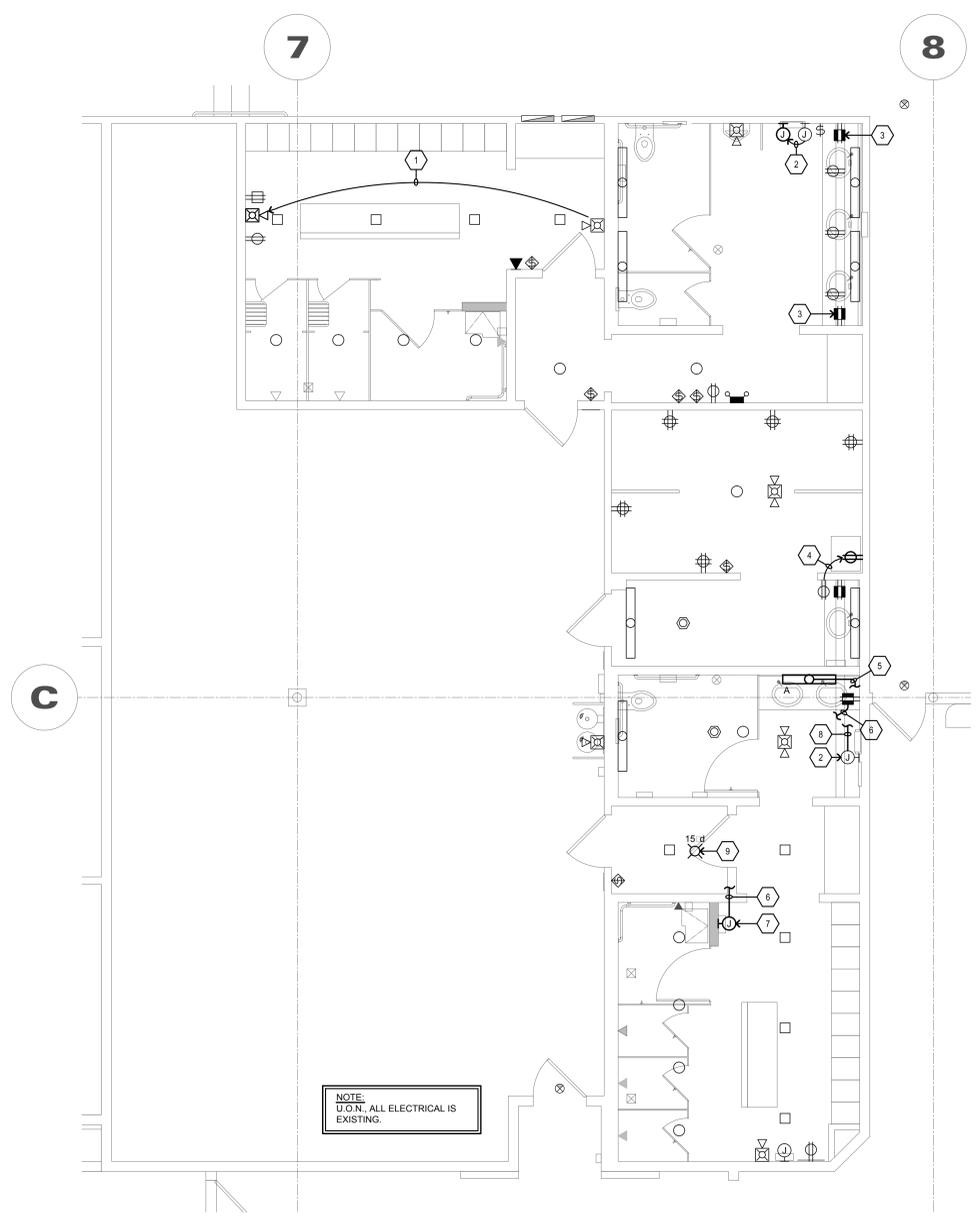

**2 FITNESS CENTER ELECTRICAL PLAN**  
SCALE: 1/4" = 1'-0"  
NORTH

NOTE:  
U.O.N., ALL ELECTRICAL IS EXISTING.

**AURUM CONSULTING ENGINEERS**  
MONTEREY BAY, INC.  
Project No. 14233.04  
60 G. rd. Co. r. • S. 210 • Mo. 93940  
T. 831.646.3330 • F. 831.646.3336 • G. 831.646.3336

These drawings are instruments of service and are the property of AURUM CONSULTING ENGINEERS MONTEREY BAY, INC. All designs and other information in the drawings are for use on the specified project and shall not be used otherwise without the expressed written permission of AURUM CONSULTING ENGINEERS MONTEREY BAY, INC.

**MONTEREY COUNTY GOVERNMENT CENTER  
SCHILLING PLACE - ADA UPGRADES**  
ALTERNATE No. 3  
MONTEREY COUNTY GOVERNMENT CENTER  
1441 SCHILLING PLACE  
SALINAS, CA 93901  
A.P.N. NO.: 177-181-024

JOB NO.  
**14105.1**  
PRINT DATE:  
PLOT DATE: 2.1.2016  
DRAWN BY: CADD  
CHECKED BY: F.P.  
SET ISSUED:


SHEET NAME:  
**FITNESS CENTER ELECTRICAL PLANS**  
SHEET NO.:

**E201**




**SHEET NOTES**

1. RAISE EXISTING RECEPTACLE TO .15" AFF TO BOTTOM OF BOX.
2. PROVIDE □ INSTALL CEILING MOUNTED STROBE. CONNECT TO NEAREST FIRE ALARM ANNUNCIATION DEVICE.

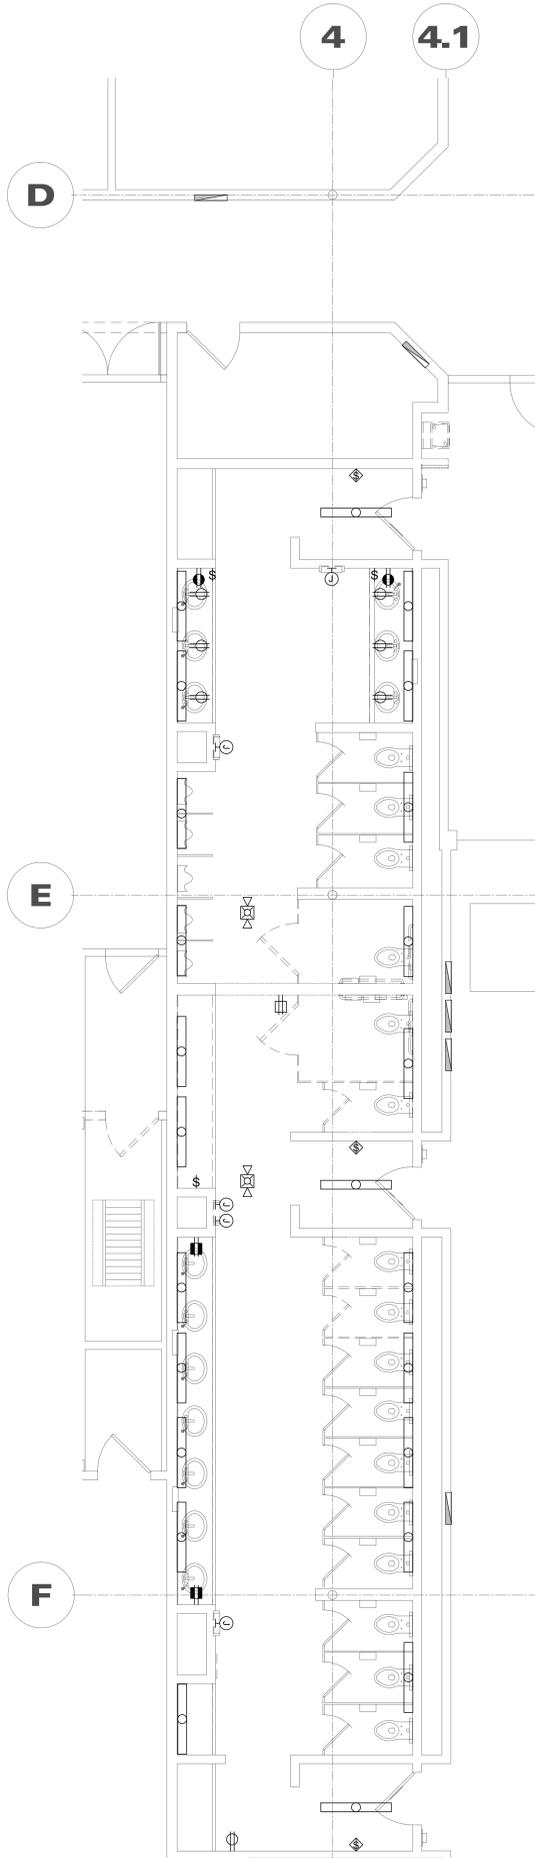

**1** MEN'S □ WOMEN'S RESTROOM DEMOLITION PLAN  
SCALE: 1/4"=1'-0"  
NORTH

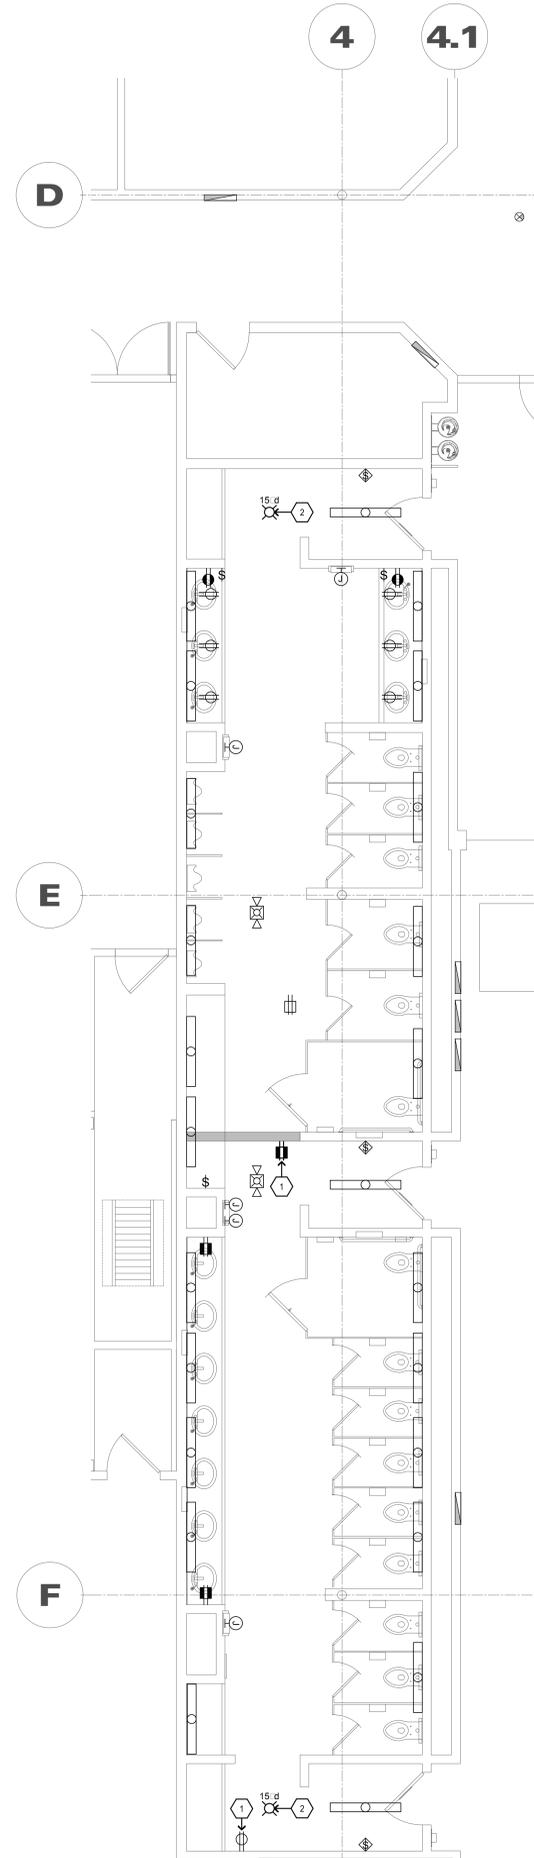

**2** MEN'S □ WOMEN'S RESTROOM ELECTRICAL PLAN  
SCALE: 1/4"=1'-0"  
NORTH

MONTEREY COUNTY GOVERNMENT CENTER  
SCHILLING PLACE - ADA UPGRADES  
ALTERNATE No. 3  
MONTEREY COUNTY GOVERNMENT CENTER  
1441 SCHILLING PLACE  
SALINAS, CA 93901  
A.P.N. NO.: 177-181-024

JOB NO: 14105.1  
PRINT DATE: 2.1.2016  
PLOT DATE: 2.1.2016  
DRAWN BY: CADD  
CHECKED BY: F.P.  
SET ISSUED:

SHEET NAME:  
MEN'S & WOMEN'S RESTROOM ELECTRICAL PLANS  
SHEET NO.:



Project No. 14233.04  
60 G. rd. Co. r. S. 210 • Mo. 93940  
T. 831.646.3330 • F. 831.646.3336


These drawings are instruments of service and are the property of AURUM CONSULTING ENGINEERS MONTEREY BAY, INC. All designs and other information in the drawings are for use on the specified project and shall not be used otherwise without the expressed written permission of AURUM CONSULTING ENGINEERS MONTEREY BAY, INC.

**E202**


THE USE OF THE PLANS AND SPECIFICATIONS IS RESTRICTED TO THE ORIGINAL SITE FOR WHICH THEY WERE PREPARED AND PUBLICATION THEREOF IS EXPRESSLY LIMITED TO SUCH USE. REUSE, REPRODUCTION OR PUBLICATION BY ANY METHOD IN WHOLE OR IN PART IS PROHIBITED. TITLE TO THE PLANS AND SPECIFICATIONS REMAINS WITH THE ARCHITECT AND VISUAL CONTACT WITH THEM CONSTITUTES PRIMA FACIE EVIDENCE OF THE ACCEPTANCE OF THESE RESTRICTIONS.

SHEET NOTES

- 1. CONNECT TO NEAREST POWER CIRCUIT.

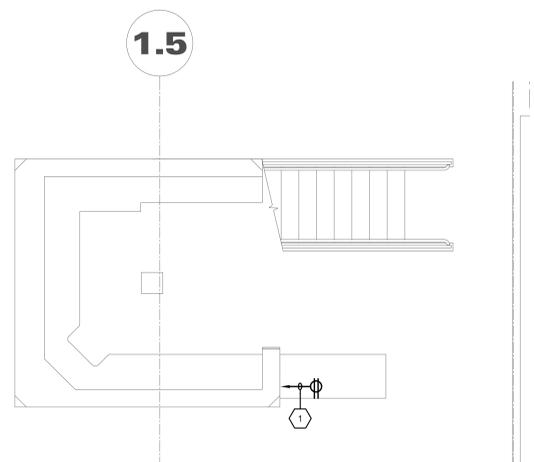

2 LOBBY ELECTRICAL PLAN  
SCALE: 1/4"=1'-0"

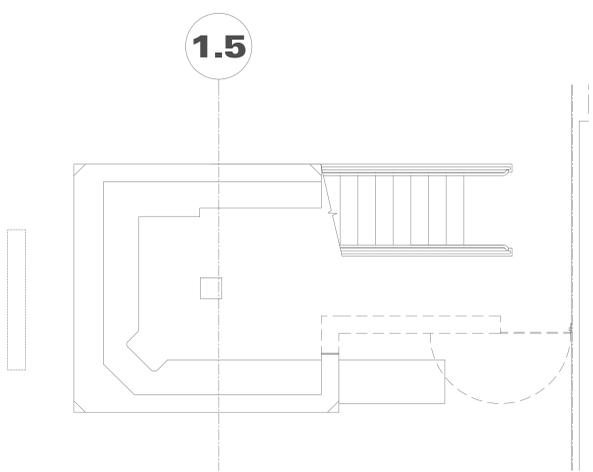

1 LOBBY DEMOLITION PLAN  
SCALE: 1/4"=1'-0"



MONTEREY COUNTY GOVERNMENT CENTER  
SCHILLING PLACE - ADA UPGRADES  
ALTERNATE No. 3  
MONTEREY COUNTY GOVERNMENT CENTER  
1441 SCHILLING PLACE  
SALINAS, CA 93901  
A.P.N. NO.: 177-181-024

JOB NO:  
14105.1  
PRINT DATE:  
PLOT DATE: 2.1.2016  
DRAWN BY: CADD  
CHECKED BY: F.P.  
SET ISSUED:

SHEET NAME:  
LOBBY  
ELECTRICAL  
PLANS

SHEET NO.:

E203



Project No. 14233.04  
60 G. rd. Co. r. S. 210 • Mo. CA 93940  
T. 831.646.3330 • F. 831.646.3336 • G. O.

These drawings are instruments of service and are the property of AURUM CONSULTING ENGINEERS MONTEREY BAY, INC. All designs and other information in the drawings are for use on the specified project and shall not be used otherwise without the expressed written permission of AURUM CONSULTING ENGINEERS MONTEREY BAY, INC.



THE USE OF THE PLANS AND SPECIFICATIONS IS RESTRICTED TO THE ORIGINAL SITE FOR WHICH THEY WERE PREPARED, AND PUBLICATION THEREOF IS EXPRESSLY LIMITED TO SUCH USE. ANY REPRODUCTION OR PUBLICATION BY ANY METHOD IN WHOLE OR IN PART IS PROHIBITED. TITLE TO THE PLANS AND SPECIFICATIONS REMAINS WITH THE ARCHITECT, AND VISUAL CONTACT WITH THEM CONSTITUTES PRIMA FACIE EVIDENCE OF THE ACCEPTANCE OF THESE RESTRICTIONS.

MONTEREY COUNTY GOVERNMENT CENTER SCHILLING PLACE - ADA UPGRADES

MONTEREY COUNTY 1441 SCHILLING PLACE SALINAS, CALIFORNIA 93901

A.P.N. NO.: 177-181-024

JOB NO. 14105.1

PRINT DATE: 02/01/16

PLOT DATE: 02/01/16

DRAWN BY: CAD

CHECKED BY: RSS

SET ISSUED: 02/01/2016 100% CD

SHEET NAME: LEGEND, SYMBOLS AND NOTES - PLUMBING SHEET NO.:

P-001

ALTERNATE NO. 01

PLUMBING LEGEND table with columns: SYMBOL, ABBRV., IDENTIFICATION, ABBRV., IDENTIFICATION. Lists various plumbing symbols and their corresponding abbreviations and full names.


PLUMBING SPECIFICATION

- 1. SCOPE: PROVIDE PLUMBING SYSTEMS, INCLUDING ALL LABOR, EQUIPMENT, MATERIALS AND SERVICES.
2. COORDINATION: COORDINATE WITH GENERAL CONTRACTOR AND ALL OTHER TRADES.
3. CODES: THIS WORK SHALL CONFORM TO ALL LOCAL CODES, CALIFORNIA BUILDING CODE, CALIFORNIA MECHANICAL CODE AND CALIFORNIA PLUMBING CODE.
4. FEES: CONTRACTOR SHALL PAY ALL FEES IN CONNECTION WITH THIS WORK. CONNECTION CHARGES BY OWNER.
5. DRAWINGS: DRAWINGS ARE SCHEMATIC. ALL EQUIPMENT LOCATIONS SHALL BE VERIFIED IN THE FIELD AND APPROVED BY ARCHITECT.
6. CUTTING: REPAIR ALL SURFACES CUT IN THIS WORK TO MATCH ORIGINAL. NO CUTTING OF STRUCTURAL ELEMENTS IS ALLOWED WITHOUT PRIOR WRITTEN CONSENT OF THE STRUCTURAL ENGINEER.
7. MAINTENANCE: ALL EQUIPMENT SHALL BE ACCESSIBLE FOR MAINTENANCE.
8. GUARANTEE: ALL WORKMANSHIP, EQUIPMENT AND MATERIALS SHALL BE GUARANTEED FOR ONE YEAR AFTER DATE OF ACCEPTANCE.
9. SUBMITTALS: WITHIN 15 DAYS AFTER SIGNING A CONTRACT, PROVIDE SUBMITTALS ON ALL PLUMBING EQUIPMENT.
10. STRUCTURAL: CONTRACTOR SHALL CONSULT AND OBTAIN DIRECTION FROM THE STRUCTURAL ENGINEER ON STRUCTURAL SUPPORT OF ALL PLUMBING EQUIPMENT.
11. TESTING, ADJUSTING, AND CLEANING: TEST ALL PIPING, VALVES, CLEAN OUTS, ETC. AS LISTED BELOW AND PROVIDE THE ARCHITECT WITH CERTIFIED COPIES OF TEST RESULTS. THE INSPECTION AUTHORITY HAVING JURISDICTION AND THE SUPERVISING ARCHITECT SHALL BE NOTIFIED AT LEAST 24 HOURS PRIOR TO PERFORMANCE OF ALL TESTS SO THAT THEY MAY BE WITNESSED.
ALL GAS PIPING SHALL BE TESTED AT 60 PSIG FOR 2 HOURS WITHOUT DROP IN PRESSURE. EQUIPMENT AND PERSONNEL SHALL BE PROTECTED FROM THIS TEST PRESSURE.
ALL PARTS OF THE SOIL, WASTE AND DRAINAGE SYSTEM SHALL BE TESTED HYDRAULICALLY BY FILLING TO THE HIGHEST VENT POINT WITH WATER. PIPING MAY BE TESTED IN SECTIONS BUT SHALL BE SUBJECTED TO A HEAD NOT LESS THAN 10 FEET. STAND PIPE INSTALLED FOR A HEAD TEST SHALL BE 2 INCH MINIMUM. TEST PRESSURE SHALL BE HELD FOR 15 MINUTES BEFORE INSPECTION STARTS AND WATER LEVEL SHALL REMAIN STATIONARY FOR NOT LESS THAN 1 HOUR.
ADJUST AND REGULATE ALL FAUCETS, VALVES, WATER HEATING EQUIPMENT, ETC. AND TURN OVER TO THE OWNER IN PERFECT WORKING ORDER.
FLOOR DRAIN STRAINERS AND CLEAN OUT COVERS SHALL BE FREED, CLEANED AND POLISHED.
UPON COMPLETION OF THE WORK, CLEAN ALL EQUIPMENT AND PIPING INSTALLED UNDER THIS SECTION AND THOROUGHLY WASH AND POLISH ALL PLUMBING FIXTURES, FITTINGS AND TRIM, REMOVING LABELS THEREFROM.
12. VERIFICATION OF EXISTING CONDITIONS: IT SHALL BE ONE OF THE RESPONSIBILITIES UNDER THIS SECTION TO EXAMINE THE SITE OF WORK AND, AFTER INVESTIGATION, TO DETERMINE THE CHARACTER OF THE MATERIALS TO BE ENCOUNTERED AND THE EXISTING CONDITIONS AFFECTING THE WORK.
13. EXCAVATION AND BACKFILLING: EXCAVATION SHALL BE UNCLASSIFIED AND SHALL INCLUDE THE REMOVAL OF ALL BURIED OBSTRUCTIONS WITHIN THE AREA TO BE EXCAVATED. TRENCH TO REQUIRED DEPTHS. TRENCH TO BE FREE OF WATER.
TAMP BOTTOM OF TRENCH. EXCAVATE BELL HOLES SO PIPE SHALL REST FOR ENTIRE LENGTH ON SOLID GROUND. REMOVE ALL ROCKS AND TAMP AND COMPACT 1/2" TO 1-1/2" BROKEN STONE OR GRAVEL SAND ON BOTTOM OF TRENCH BEFORE LAYING PIPE. INSTALLED PIPING TO BE TESTED, INSPECTED AND APPROVED FOR BACKFILL MATERIAL. MATERIAL: IMPORTED SANDY SOIL IN LAYERS NOT EXCEEDING 8". MOISTEN AND MACHINE TAMP TO ORIGINAL CONDITION. BACKFILL SHALL BE COMPACTED TO A DENSITY OF 95% AS DETERMINED BY THE LABORATORY TEST PROCEDURE IN ASTM D1557.
14. STERILIZATION: BEFORE BEING PLACED IN SERVICE, ALL DOMESTIC COLD WATER DISTRIBUTION SYSTEMS SHALL BE STERILIZED IN ACCORDANCE WITH THE AWWA STANDARD SPECIFICATION, LATEST EDITION AND AMENDMENTS. AFTER STERILIZATION, THE SYSTEM SHALL BE FLUSHED WITH POTABLE WATER UNTIL THE STERILIZATION RESIDUE IS WITHIN THE TOLERABLE LIMITS FOR DOMESTIC WATER.
15. MATERIALS: SOIL, WASTE, DRAIN AND VENT PIPE SHALL BE SERVICE WEIGHT HUBLESS CAST IRON WITH NEOPRENE SLEEVE AND STAINLESS STEEL CLAMPS WITH A STAINLESS STEEL SHIELD, WHICH SHALL COMPLETELY COVER WITH NEOPRENE. BALANCE OF WASTE, DRAIN AND VENT PIPE (EXCEPT THAT INSTALLED UNDERGROUND) MAY BE GALVANIZED STEEL WATER PIPING.
WATER PIPING: HARD COPPER WATER TUBE, CONFORMING TO ASTM B88 TYPE "L" ABOVE GROUND, WITH WROUGHT COPPER FITTINGS.
PIPE INSULATION: INSULATE ALL DOMESTIC HOT WATER AND HOT WATER RETURN PIPING WITH FIBERGLASS 1 INCH NOMINAL THICKNESS OWENS-CORNING TYPE ASJ STAPLED IN PLACE WITH VAPOR BARRIER. ALL ELBOWS AND FITTINGS SHALL BE FACTORY PRE FABRICATED PVC COVERS. ON ALL EXPOSED HOT WATER DROPS, COVER INSULATION WITH PVC COVERING AND SEAL PER MANUFACTURER'S RECOMMENDATIONS.
GAS PIPING: STANDARD WEIGHT BLACK STEEL PIPE, SCHEDULE 40, A-53 WITH 150# BLACK MALLEABLE IRON FITTINGS.
16. ADHESIVES, SEALANTS AND CAULKS USED INDOORS SHALL NOT EXCEED THE FOLLOWING VOC LIMITS PER TITLE 24, PART 11, SECTION 5.504.
• PVC WELDING < 510 G/L
• CPVC WELDING < 490 G/L
• ABS WELDING < 325 G/L
• MASTICS > 100 G/L
• ZINC-RICH PRIMERS < 340 G/L
• FIRE RESISTANT COATINGS < 350 G/L
17. PLUMBING FIXTURES SHALL NOT EXCEED THE MAXIMUM FLOW AT 20% REDUCTION RATES LISTED IN TABLE 5.303.2.3 OF TITLE 24, PART 11.

MINIMUM HANGER SIZES table with columns: PIPE SIZE INCHES, ROD SIZE DIAMETER. Rows: 1/2" - 4", 3/8"; 5" - 8", 1/2"

MAXIMUM HANGER SPACING table with columns: MATERIALS, TYPE OF JOINTS, HORIZONTAL, VERTICAL. Lists spacing requirements for various materials and joint types.

1 MINIMUM PIPE HANGER SIZE AND MAXIMUM SPACING (UNLESS SPECIFIED)

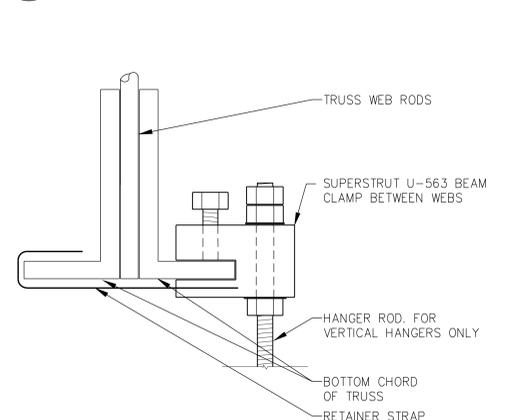

2 VERTICAL HANGER CONNECTION TO STEEL (NO SCALE)

PLUMBING CONNECTIONS/FIXTURE LIST table with columns: FIXT. NO., FIXTURE, MAKE & MODEL, MIN BRANCH SIZE (W, V, CW, HW), TRAP, CARRIER, SEAT, FLUSH VALVE, STOP/SUPPLY, FAUCET OR CONTROL, ACCESSIBLE INSUL. KIT, DRAIN ASSEMBLY, MOUNTING STD ADA, REMARKS. Lists various fixtures and their specifications.

1 WITH 1.5 GPM FLOW RATE RESTRICTOR, INTEGRAL CHECK STOPS.

THE USE OF THESE PLANS AND SPECIFICATIONS SHALL BE RESTRICTED TO THE ORIGINAL SITE FOR WHICH THEY WERE PREPARED, AND PUBLICATION THEREOF IS EXPRESSLY LIMITED TO SUCH USE. ANY REPRODUCTION OR PUBLICATION BY ANY METHOD, IN WHOLE OR IN PART, IS PROHIBITED. TITLE TO THE PLANS AND SPECIFICATIONS REMAINS WITH THE ENGINEER WITHOUT PREJUDICE. VISUAL CONTACT WITH THESE PLANS AND SPECIFICATIONS SHALL CONSTITUTE PRIMA FACIE EVIDENCE OF THE ACCEPTANCE OF THESE RESTRICTIONS. AWWA ENGINEERS, INC. - LEE & ASSOCIATES CONSULTING ENGINEERS



Lee & Associates, Inc. (831) 649-8000, Fax (831) 649-8038, Email: mail@axiomengineers.com

AXIOM ENGINEERS LEE & ASSOCIATES CONSULTING ENGINEERS

22 Lower Regalade Dr., Suite A Monterey, California 93940-3788

THE USE OF THESE PLANS AND SPECIFICATIONS SHALL BE RESTRICTED TO THE ORIGINAL SITE FOR WHICH THEY WERE PREPARED AND PUBLICATION THEREOF IS EXPRESSLY LIMITED TO SUCH USE. RE-USE, REPRODUCTION, OR PUBLICATION BY ANY METHOD, IN WHOLE OR IN PART, IS PROHIBITED. TITLE TO THE PLANS AND SPECIFICATIONS REMAINS WITH THE ENGINEER WITHOUT PREJUDICE. VISUAL CONTACT WITH THESE PLANS AND SPECIFICATIONS SHALL CONSTITUTE PRIMA FACIE EVIDENCE OF THE ACCEPTANCE OF THESE RESTRICTIONS. AXIOM ENGINEERS, INC. - I.E. & ASSOCIATES CONSULTING ENGINEERS  
 22 LOWE ROAD, SUITE 4 MONTEREY, CALIFORNIA 93940-5188  
 PHONE: (831) 649-8000 FAX: (831) 649-8008  
 WWW.AXIOMENGINEERS.COM



**NORTH BUILDING PLAN - PLUMBING**  
 SCALE: 1/16" = 1'-0"

**DEMOLITION NOTES:**

- ① REMOVE (E) DRINKING FOUNTAIN. PROTECT (E) CW, WASTE AND VENT PIPING FOR REUSE WITH NEW FIXTURE.
- ② REMOVE (E) WC AND ASSOCIATED CARRIER. CAP (E) CW, WASTE AND VENT PIPING.
- ③ REMOVE (E) URINAL AND ASSOCIATED CARRIER. CAP (E) CW, WASTE AND VENT PIPING.
- ④ REMOVE (E) COUNTER MOUNTED LAVATORY. PROTECT (E) CW, HW, WASTE AND VENT FOR REUSE WITH NEW FIXTURE.
- ⑤ REMOVE (E) SHOWER MIXING VALVE, RISER PIPE, AND SHOWER HEAD. PROTECT (E) HW AND CW PIPING FOR REUSE WITH NEW FIXTURE.

**PLUMBING NOTES:**

- ① INSTALL NEW BI-LEVEL DRINKING FOUNTAIN (DF-1). CONNECT TO (E) CW, WASTE AND VENT PIPING.
- ② INSTALL NEW WATER CLOSET. EXTEND (E) CW, WASTE AND VENT PIPING TO SERVE FIXTURE IN NEW LOCATION.
- ③ INSTALL NEW URINAL. EXTEND (E) CW, WASTE AND VENT PIPING TO SERVE FIXTURE IN NEW LOCATION.
- ④ INSTALL NEW WALL HUNG LAVATORY. CONNECT TO (E) HW, CW, WASTE, AND VENT PIPING.
- ⑤ INSTALL NEW SHOWER MIXING VALVE, RISER PIPE, AND SHOWER HEAD. EXTEND (E) HW AND CW PIPING TO SERVE FIXTURE IN NEW LOCATION.
- ⑥ INSTALL NEW COUNTER MOUNTED SINK. CONNECT TO (E) HW, CW, WASTE AND VENT PIPING.
- ⑦ INSTALL NEW WALL HUNG LAVATORY. EXTEND (E) HW, CW, WASTE AND VENT PIPING TO SERVE FIXTURE IN NEW LOCATION.
- ⑧ INSTALL NEW BI-LEVEL DRINKING FOUNTAIN. EXTEND (E) CW, WASTE AND VENT PIPING TO SERVE FIXTURE IN NEW LOCATION.

THE USE OF THESE PLANS AND SPECIFICATIONS IS RESTRICTED TO THE ORIGINAL SITE FOR WHICH THEY WERE PREPARED AND PUBLICATION THEREOF IS EXPRESSLY LIMITED TO SUCH USE. RE-USE, REPRODUCTION, OR PUBLICATION BY ANY METHOD, IN WHOLE OR IN PART, IS PROHIBITED. TITLE TO THE PLANS AND SPECIFICATIONS REMAINS WITH THE ARCHITECT AND VISUAL CONTACT WITH THESE PLANS SHALL CONSTITUTE PRIMA FACIE EVIDENCE OF THE ACCEPTANCE OF THESE RESTRICTIONS.

**MONTEREY COUNTY GOVERNMENT CENTER  
 SCHILLING PLACE - ADA UPGRADES**

MONTEREY COUNTY  
 1441 SCHILLING PLACE  
 SALINAS, CALIFORNIA 93901  
 A.P.N. NO.: 177-181-024

JOB NO.  
**14105.1**

PRINT DATE: 02/01/16  
 PLOT DATE: 02/01/16  
 DRAWN BY: CAD  
 CHECKED BY: RSS  
 SET ISSUED:

02/01/2016 100% CD

**SHEET NAME:  
 NORTH  
 BUILDING PLAN -  
 PLUMBING**

SHEET NO.:


**P-101**

ALTERNATE No. 301



AXIOM ENGINEERS  
 LEE & ASSOCIATES  
 CONSULTING ENGINEERS  
 EXP. JUNE 30, 2016  
 22 LOWE ROAD, SUITE 4  
 MONTEREY, CALIFORNIA 93940-5188  
 PHONE: (831) 649-8000  
 FAX: (831) 649-8008  
 EMAIL: mail@axiomengineers.com  
 AE Project #: 20150297

THE USE OF THESE PLANS AND SPECIFICATIONS SHALL BE RESTRICTED TO THE ORIGINAL SITE FOR WHICH THEY WERE PREPARED AND PUBLICATION THEREOF IS EXPRESSLY LIMITED TO SUCH USE. RE-USE, REPRODUCTION, OR PUBLICATION BY ANY METHOD, IN WHOLE OR IN PART, IS PROHIBITED. TITLE TO THE PLANS AND SPECIFICATIONS REMAINS WITH THE ENGINEER WITHOUT PREJUDICE. VISUAL CONTACT WITH THESE PLANS AND SPECIFICATIONS SHALL CONSTITUTE PRIMA FACIE EVIDENCE OF THE ACCEPTANCE OF THESE RESTRICTIONS. Axiom Engineers, Lee & Associates Consulting Engineers, Inc. - LEE & ASSOCIATES CONSULTING ENGINEERS  
 22 LOWE ROAD, SUITE 400, MONTEREY, CALIFORNIA 93940-5108  
 PHONE: (831) 649-8008 FAX: (831) 649-8038 WWW.AXIOMENGINEERS.COM

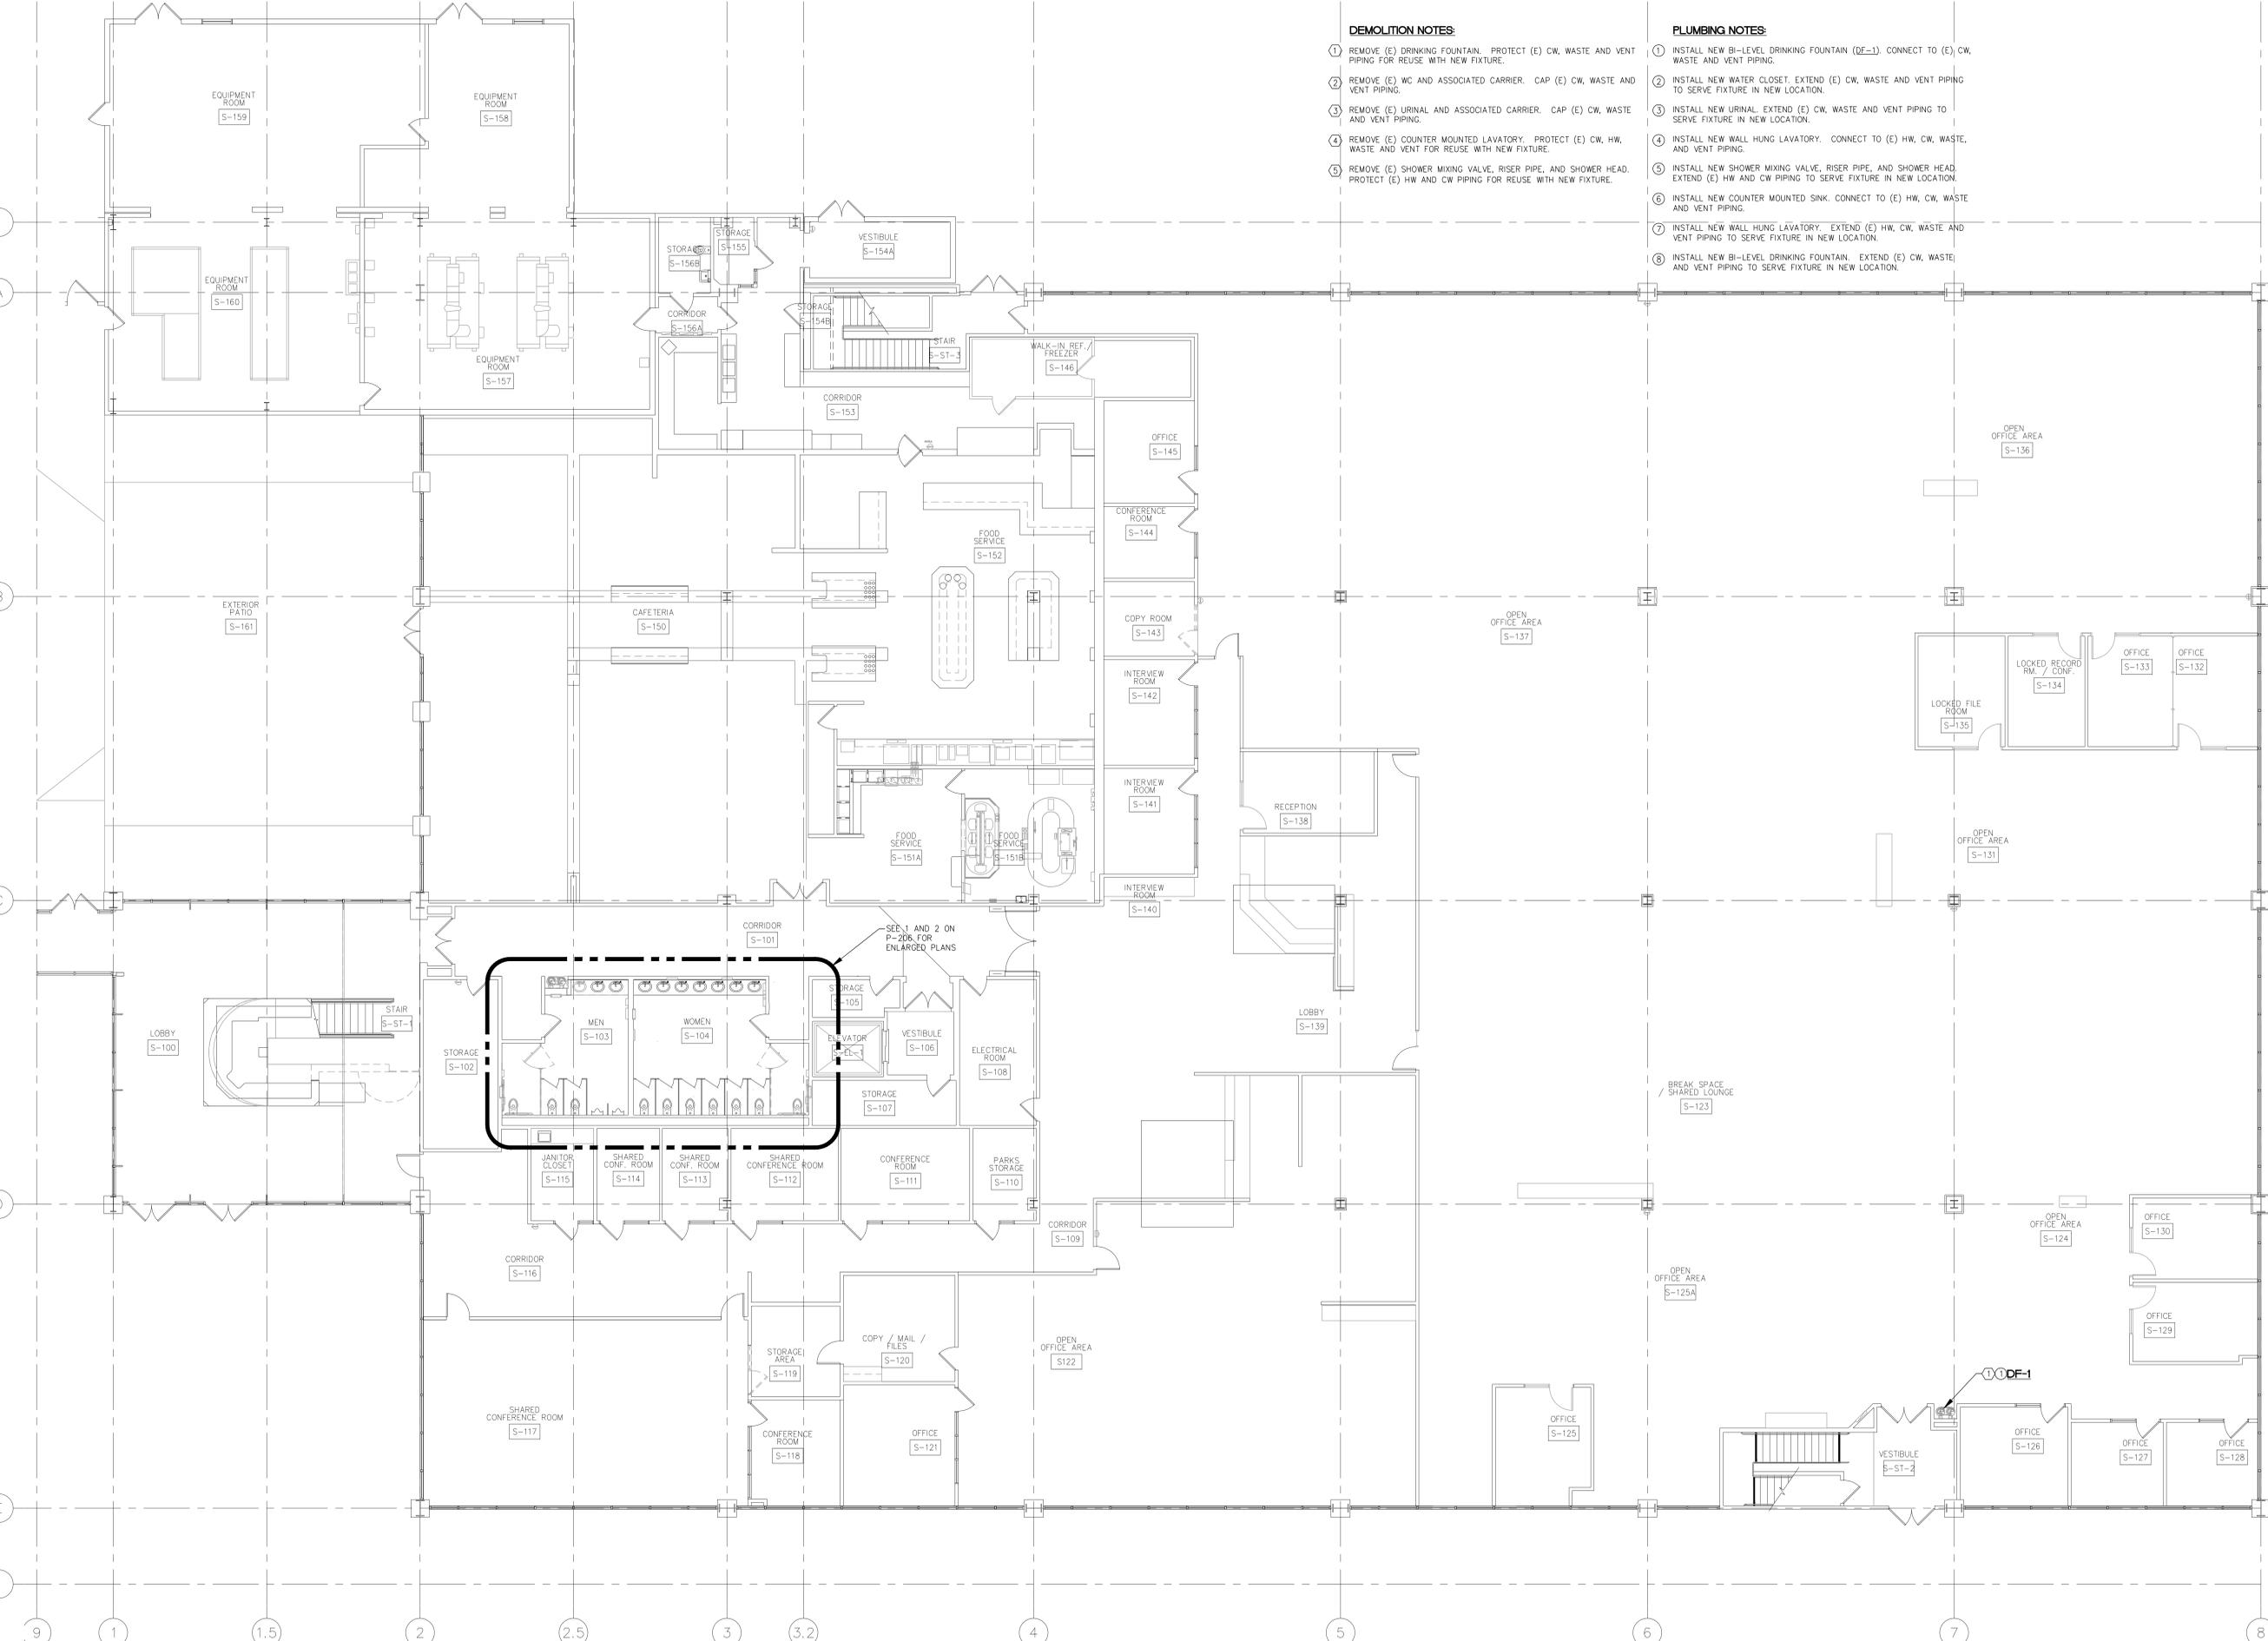

**DEMOLITION NOTES:**

- 1 REMOVE (E) DRINKING FOUNTAIN. PROTECT (E) CW, WASTE AND VENT PIPING FOR REUSE WITH NEW FIXTURE.
- 2 REMOVE (E) WC AND ASSOCIATED CARRIER. CAP (E) CW, WASTE AND VENT PIPING.
- 3 REMOVE (E) URINAL AND ASSOCIATED CARRIER. CAP (E) CW, WASTE AND VENT PIPING.
- 4 REMOVE (E) COUNTER MOUNTED LAVATORY. PROTECT (E) CW, HW, WASTE AND VENT FOR REUSE WITH NEW FIXTURE.
- 5 REMOVE (E) SHOWER MIXING VALVE, RISER PIPE, AND SHOWER HEAD. PROTECT (E) HW AND CW PIPING FOR REUSE WITH NEW FIXTURE.

**PLUMBING NOTES:**

- 1 INSTALL NEW BI-LEVEL DRINKING FOUNTAIN (DE-1) CONNECT TO (E) CW, WASTE AND VENT PIPING.
- 2 INSTALL NEW WATER CLOSET. EXTEND (E) CW, WASTE AND VENT PIPING TO SERVE FIXTURE IN NEW LOCATION.
- 3 INSTALL NEW URINAL. EXTEND (E) CW, WASTE AND VENT PIPING TO SERVE FIXTURE IN NEW LOCATION.
- 4 INSTALL NEW WALL HUNG LAVATORY. CONNECT TO (E) HW, CW, WASTE, AND VENT PIPING.
- 5 INSTALL NEW SHOWER MIXING VALVE, RISER PIPE, AND SHOWER HEAD. EXTEND (E) HW AND CW PIPING TO SERVE FIXTURE IN NEW LOCATION.
- 6 INSTALL NEW COUNTER MOUNTED SINK. CONNECT TO (E) HW, CW, WASTE AND VENT PIPING.
- 7 INSTALL NEW WALL HUNG LAVATORY. EXTEND (E) HW, CW, WASTE AND VENT PIPING TO SERVE FIXTURE IN NEW LOCATION.
- 8 INSTALL NEW BI-LEVEL DRINKING FOUNTAIN. EXTEND (E) CW, WASTE, AND VENT PIPING TO SERVE FIXTURE IN NEW LOCATION.

**SOUTH BUILDING 1ST FLOOR PLAN - PLUMBING**  
 SCALE: 1/8" = 1'-0"



v: (831) 649-8000  
 f: (831) 649-8038  
 email: mail@axiomengineers.com  
**AXIOM ENGINEERS**  
 LEE & ASSOCIATES  
 CONSULTING ENGINEERS  
 22 LOWE ROAD, SUITE 400  
 MONTEREY, CALIFORNIA 93940-5108

JOB NO.  
**14105.1**  
 PRINT DATE:  
 PLOT DATE: 02/01/16  
 DRAWN BY: CAD  
 CHECKED BY: RSS  
 SET ISSUED:  
 02/01/2016 100% CD

THE USE OF THESE PLANS AND SPECIFICATIONS SHALL BE RESTRICTED TO THE ORIGINAL JOB FOR WHICH THEY WERE PREPARED AND PUBLICATION THEREOF IS EXPRESSLY LIMITED TO SUCH USE. RE-USE, REPRODUCTION, OR PUBLICATION BY ANY METHOD, IN WHOLE OR IN PART, IS PROHIBITED. TITLE TO THE PLANS AND SPECIFICATIONS REMAINS WITH THE ENGINEER WITHOUT PREJUDICE. VISUAL CONTACT WITH THESE PLANS AND SPECIFICATIONS SHALL CONSTITUTE PRIMA FACIE EVIDENCE OF THE ACCEPTANCE OF THESE RESTRICTIONS. Axiom Engineers, Inc. - LEE & ASSOCIATES CONSULTING ENGINEERS  
 22 LOWE ROAD, SUITE 200, MONTEREY, CALIFORNIA 93940-5108  
 PHONE: 831.649.4642 FAX: 831.649.3530 WWW.WR&DARCH.COM


THE USE OF THE PLANS AND SPECIFICATIONS IS RESTRICTED TO THE ORIGINAL SITE FOR WHICH THEY WERE PREPARED AND PUBLICATION THEREOF IS EXPRESSLY LIMITED TO SUCH USE. RE-USE, REPRODUCTION, OR PUBLICATION BY ANY METHOD, IN WHOLE OR IN PART, IS PROHIBITED. TITLE TO THE PLANS AND SPECIFICATIONS REMAINS WITH THE ARCHITECT, AND VISUAL CONTACT WITH THEM CONSTITUTES PRIMA FACIE EVIDENCE OF THE ACCEPTANCE OF THESE RESTRICTIONS.

**DEMOLITION NOTES:**

- ① REMOVE (E) DRINKING FOUNTAIN. PROTECT (E) CW, WASTE AND VENT PIPING FOR REUSE WITH NEW FIXTURE.
- ② REMOVE (E) WC AND ASSOCIATED CARRIER. CAP (E) CW, WASTE AND VENT PIPING.
- ③ REMOVE (E) URINAL AND ASSOCIATED CARRIER. CAP (E) CW, WASTE AND VENT PIPING.
- ④ REMOVE (E) COUNTER MOUNTED LAVATORY. PROTECT (E) CW, HW, WASTE AND VENT FOR REUSE WITH NEW FIXTURE.
- ⑤ REMOVE (E) SHOWER MIXING VALVE, RISER PIPE, AND SHOWER HEAD. PROTECT (E) HW AND CW PIPING FOR REUSE WITH NEW FIXTURE.

**PLUMBING NOTES:**

- ① INSTALL NEW BI-LEVEL DRINKING FOUNTAIN (DF-1). CONNECT TO (E) CW, WASTE AND VENT PIPING.
- ② INSTALL NEW WATER CLOSET. EXTEND (E) CW, WASTE AND VENT PIPING TO SERVE FIXTURE IN NEW LOCATION.
- ③ INSTALL NEW URINAL. EXTEND (E) CW, WASTE AND VENT PIPING TO SERVE FIXTURE IN NEW LOCATION.
- ④ INSTALL NEW WALL HUNG LAVATORY. CONNECT TO (E) HW, CW, WASTE, AND VENT PIPING.
- ⑤ INSTALL NEW SHOWER MIXING VALVE, RISER PIPE, AND SHOWER HEAD. EXTEND (E) HW AND CW PIPING TO SERVE FIXTURE IN NEW LOCATION.
- ⑥ INSTALL NEW COUNTER MOUNTED SINK. CONNECT TO (E) HW, CW, WASTE AND VENT PIPING.
- ⑦ INSTALL NEW WALL HUNG LAVATORY. EXTEND (E) HW, CW, WASTE AND VENT PIPING TO SERVE FIXTURE IN NEW LOCATION.
- ⑧ INSTALL NEW BI-LEVEL DRINKING FOUNTAIN. EXTEND (E) CW, WASTE AND VENT PIPING TO SERVE FIXTURE IN NEW LOCATION.

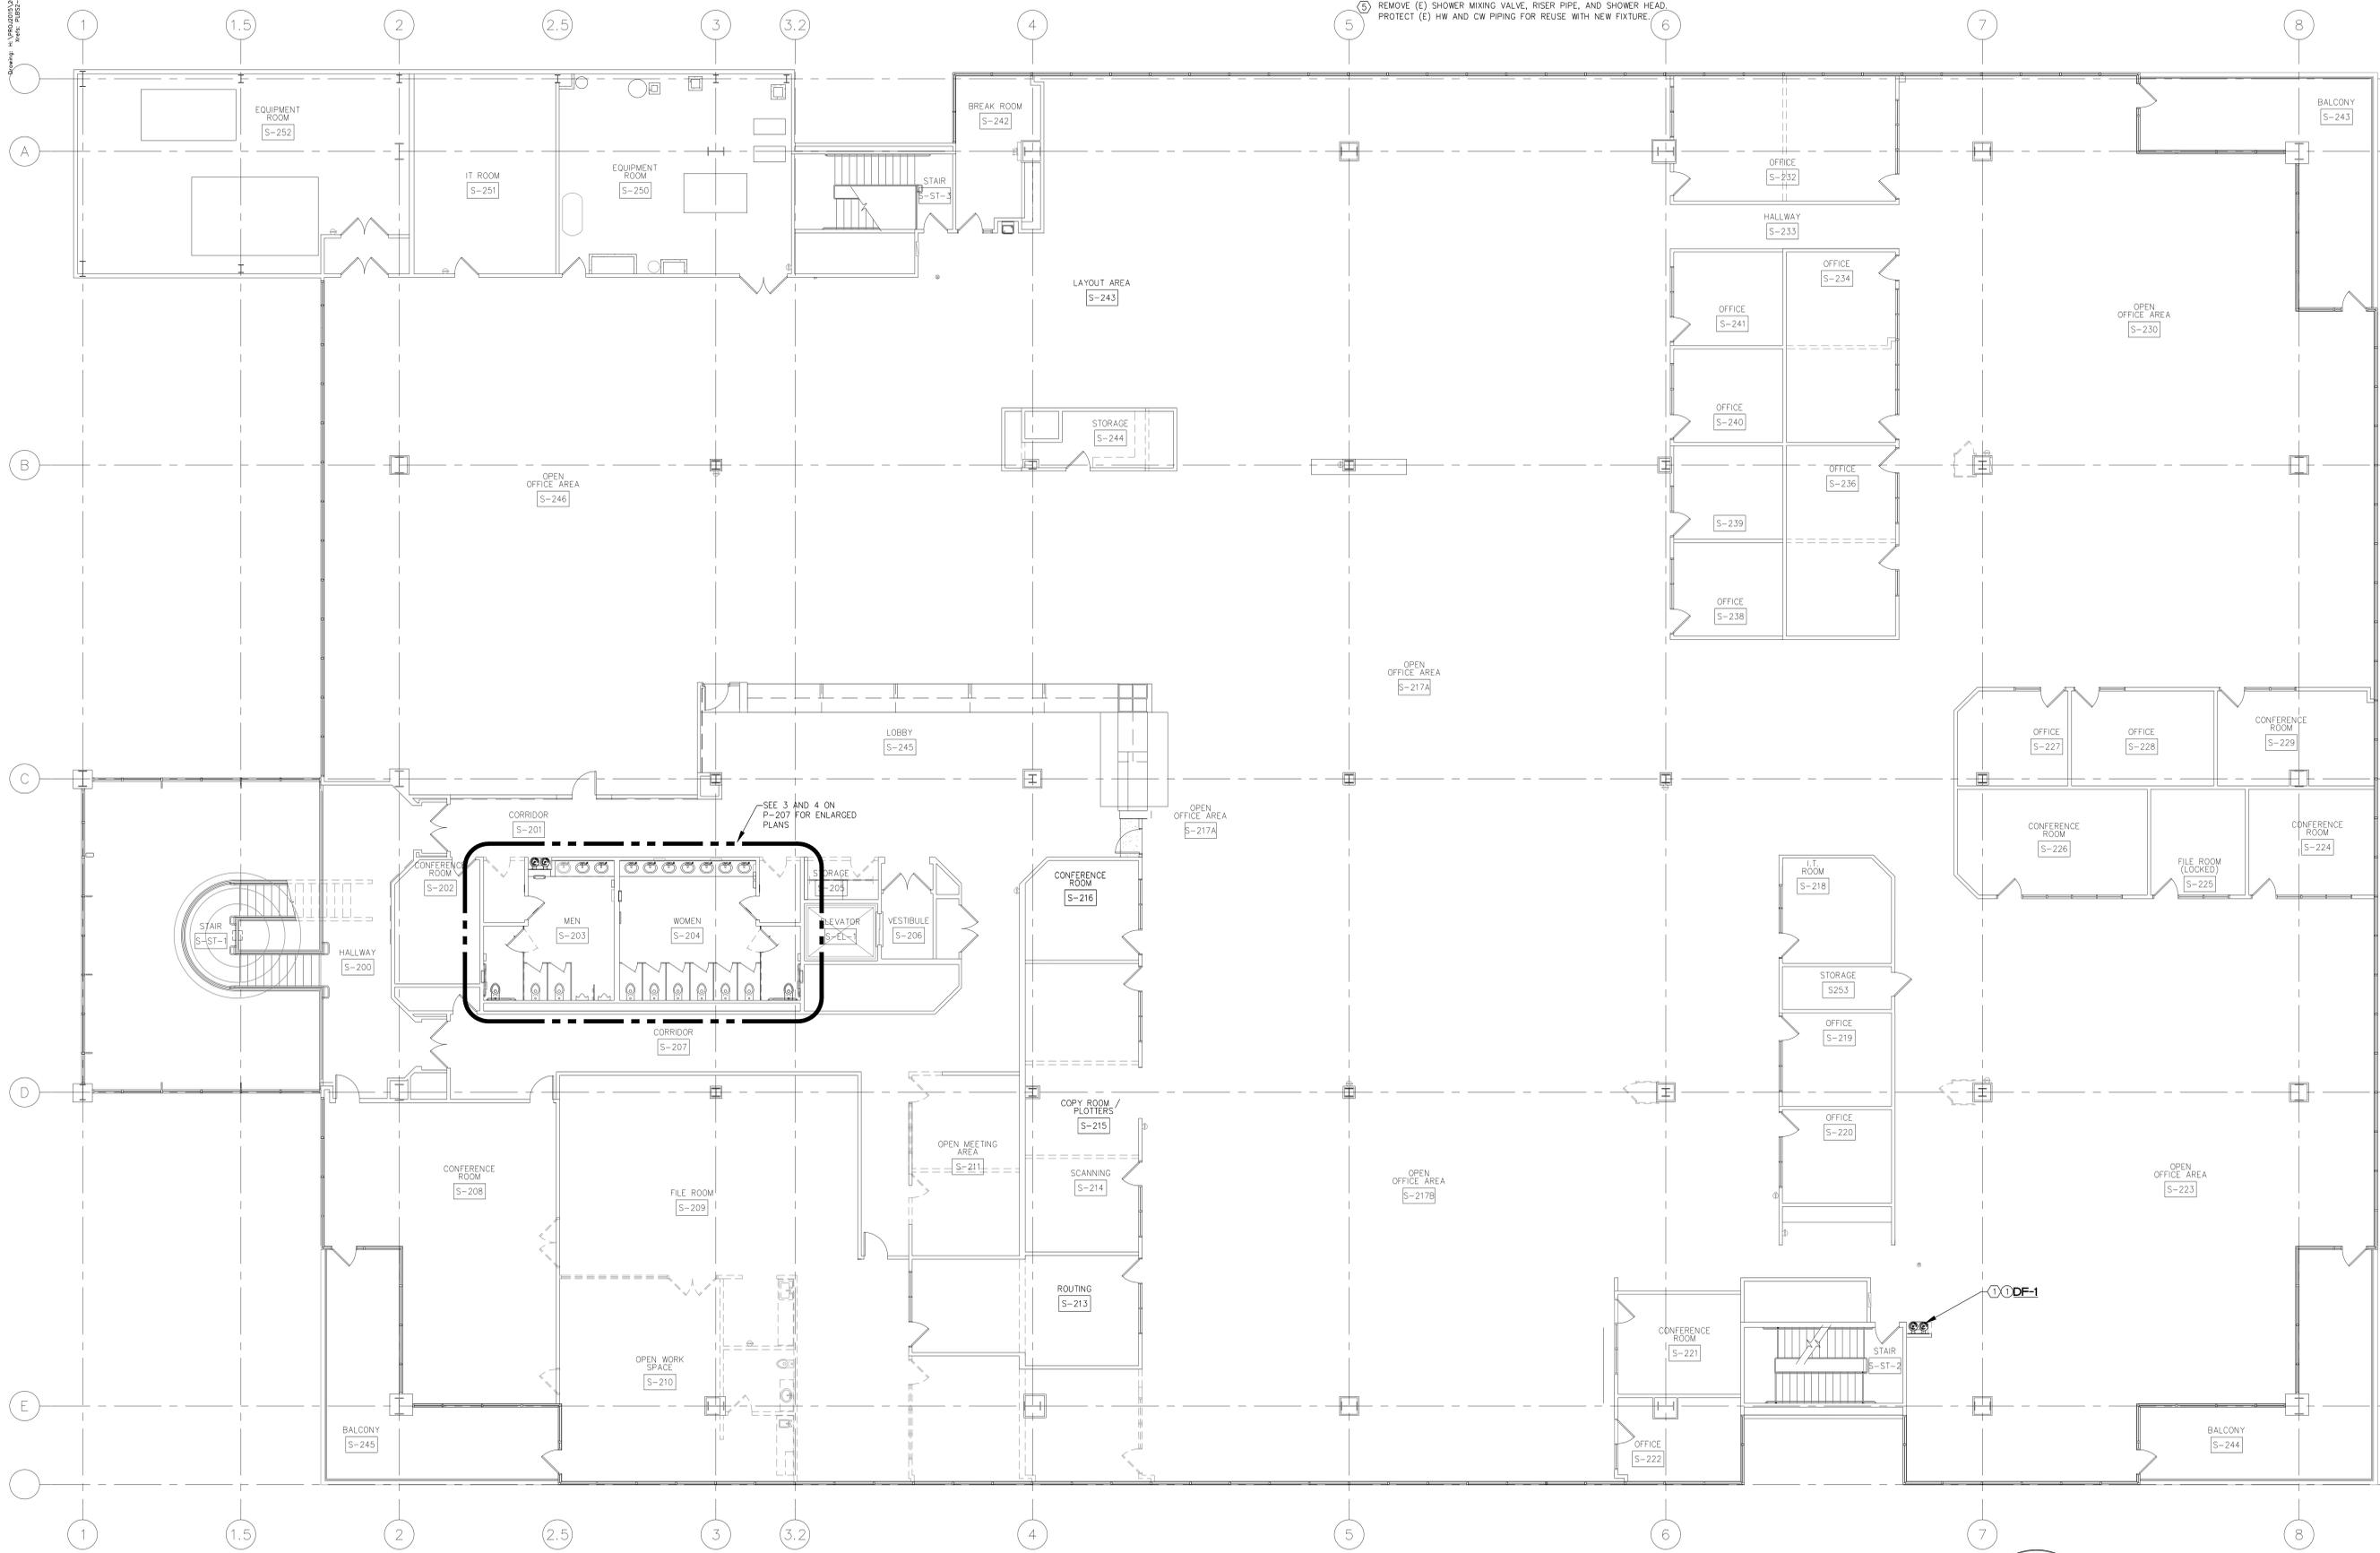

**MONTEREY COUNTY GOVERNMENT CENTER**  
**SCHILLING PLACE - ADA UPGRADES**  
 MONTEREY COUNTY  
 1441 SCHILLING PLACE  
 SALINAS, CALIFORNIA 93901  
 A.P.N. NO.: 177-181-024

JOB NO.  
**14105.1**  
 PRINT DATE:  
 PLOT DATE: 02/01/16  
 DRAWN BY: CAD  
 CHECKED BY: RSS  
 SET ISSUED:  
 02/01/2016 100% CD

SHEET NAME:  
**SOUTH BUILDING**  
**2nd FLOOR PLAN -**  
**PLUMBING**

SHEET NO.:

**SOUTH BUILDING 2ND FLOOR PLAN - PLUMBING**  
 SCALE: 1/8" = 1'-0"



v: (831) 649-8000  
 f: (831) 649-8038  
 email: mol@axiomengineers.com  
**AXIOM ENGINEERS**  
 LEE & ASSOCIATES  
 CONSULTING ENGINEERS  
 22 LOWE ROAD, SUITE 200  
 MONTEREY, CALIFORNIA 93940-5108  
 AE Project #: 20150097


THE USE OF THESE PLANS AND SPECIFICATIONS SHALL BE RESTRICTED TO THE ORIGINAL SITE FOR WHICH THEY WERE PREPARED AND PUBLICATION THEREOF IS EXPRESSLY LIMITED TO SUCH USE. RE-USE, REPRODUCTION, OR PUBLICATION BY ANY METHOD, IN WHOLE OR IN PART, IS PROHIBITED. TITLE TO THE PLANS AND SPECIFICATIONS REMAINS WITH THE ENGINEER WITHOUT PREJUDICE. VISUAL CONTACT WITH THESE PLANS AND SPECIFICATIONS SHALL CONSTITUTE PRIMA FACIE EVIDENCE OF THE ACCEPTANCE OF THESE RESTRICTIONS. AXIOM ENGINEERS, INC. - LEE & ASSOCIATES CONSULTING ENGINEERS  
 22 Lower Regalade Dr., Suite A  
 Monterey, California 93940-5188  
 Phone: (831) 649-8000  
 Fax: (831) 649-8038  
 www.axiomengineers.com

**DEMOLITION NOTES:**


- 1 REMOVE (E) DRINKING FOUNTAIN. PROTECT (E) CW, WASTE AND VENT PIPING FOR REUSE WITH NEW FIXTURE.
- 2 REMOVE (E) WC AND ASSOCIATED CARRIER. CAP (E) CW, WASTE AND VENT PIPING.
- 3 REMOVE (E) URINAL AND ASSOCIATED CARRIER. CAP (E) CW, WASTE AND VENT PIPING.
- 4 REMOVE (E) COUNTER MOUNTED LAVATORY. PROTECT (E) CW, HW, WASTE AND VENT FOR REUSE WITH NEW FIXTURE.
- 5 REMOVE (E) SHOWER MIXING VALVE, RISER PIPE, AND SHOWER HEAD. PROTECT (E) HW AND CW PIPING FOR REUSE WITH NEW FIXTURE.

**PLUMBING NOTES:**

- 1 INSTALL NEW BI-LEVEL DRINKING FOUNTAIN (DF-1). CONNECT TO (E) CW, WASTE AND VENT PIPING.
- 2 INSTALL NEW WATER CLOSET. EXTEND (E) CW, WASTE AND VENT PIPING TO SERVE FIXTURE IN NEW LOCATION.
- 3 INSTALL NEW URINAL. EXTEND (E) CW, WASTE AND VENT PIPING TO SERVE FIXTURE IN NEW LOCATION.
- 4 INSTALL NEW WALL HUNG LAVATORY. CONNECT TO (E) HW, CW, WASTE, AND VENT PIPING.
- 5 INSTALL NEW SHOWER MIXING VALVE, RISER PIPE, AND SHOWER HEAD. EXTEND (E) HW AND CW PIPING TO SERVE FIXTURE IN NEW LOCATION.
- 6 INSTALL NEW COUNTER MOUNTED SINK. CONNECT TO (E) HW, CW, WASTE AND VENT PIPING.
- 7 INSTALL NEW WALL HUNG LAVATORY. EXTEND (E) HW, CW, WASTE AND VENT PIPING TO SERVE FIXTURE IN NEW LOCATION.
- 8 INSTALL NEW BI-LEVEL DRINKING FOUNTAIN. EXTEND (E) CW, WASTE AND VENT PIPING TO SERVE FIXTURE IN NEW LOCATION.

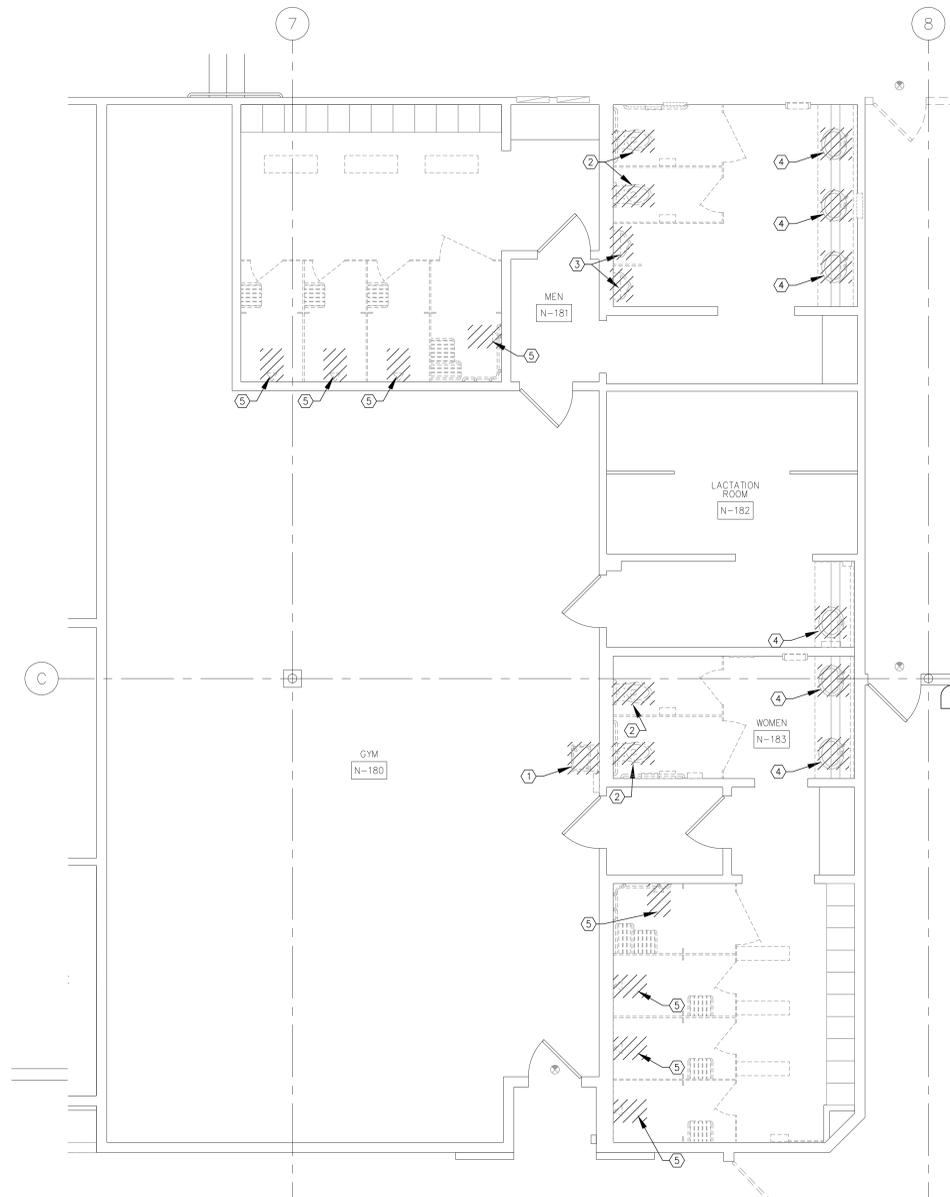

1 NORTH BUILDING DEMOLITION PLAN - PLUMBING  
 P-204 SCALE: 1/4" = 1'-0"

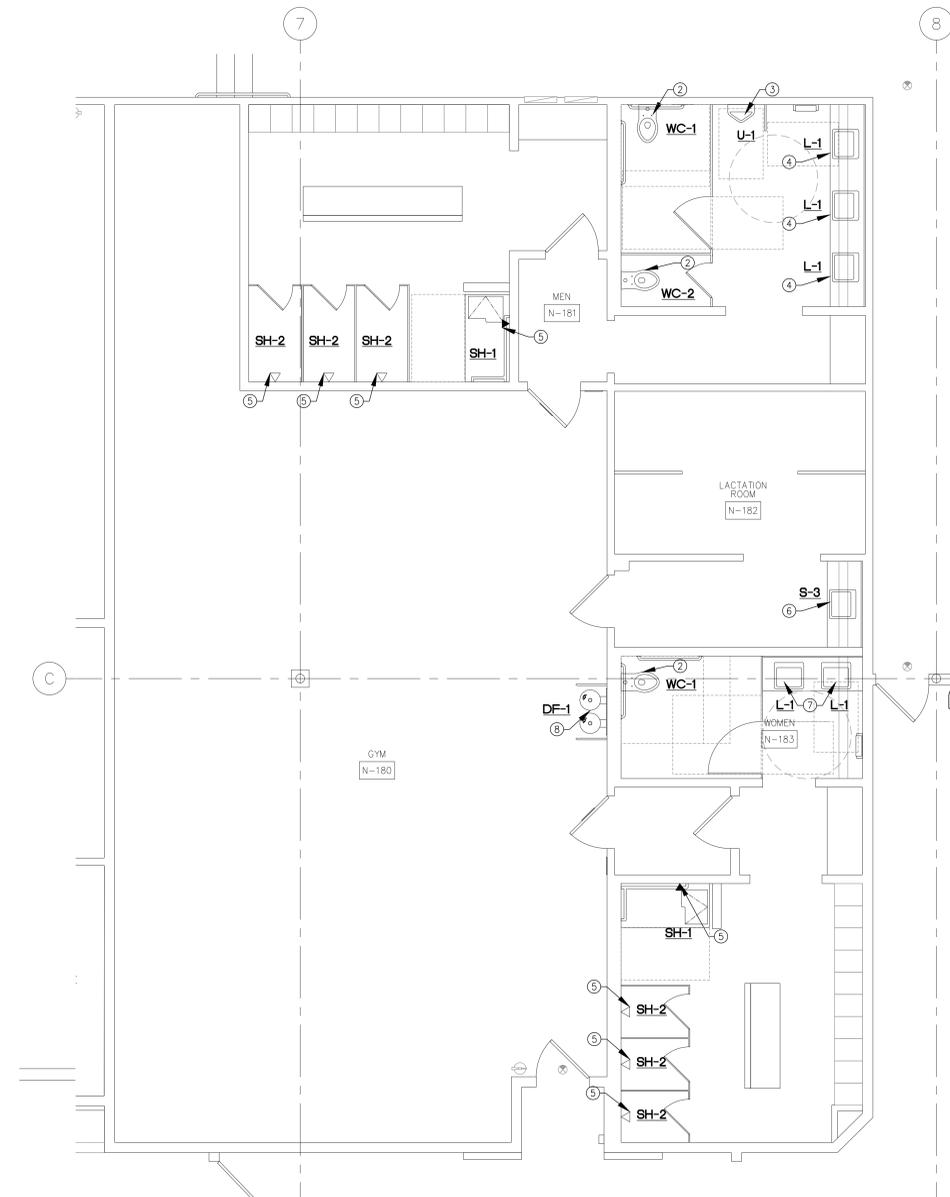

1 NORTH BUILDING ENLARGED PLAN - PLUMBING  
 P-204 SCALE: 1/4" = 1'-0"

JOB NO.	14105.1
PRINT DATE:	02/01/16
PLOT DATE:	02/01/16
DRAWN BY:	CAD
CHECKED BY:	RSS
SET ISSUED:	
02/01/2016	100% CD


SHEET NAME:  
 NORTH  
 BUILDING  
 ENLARGED PLAN  
 - PLUMBING  
 SHEET NO.:

AXIOM ENGINEERS  
**LEE & ASSOCIATES**  
CONSULTING ENGINEERS

W: (831) 649-8000  
F: (831) 649-8038  
email: mail@axiomengineers.com

06/16/2016 10:00 AM  
 1441 SCHILLING PLACE - ADA UPGRADES  
 PLUMBING  
 1441 SCHILLING PLACE - ADA UPGRADES  
 PLUMBING  
 1441 SCHILLING PLACE - ADA UPGRADES  
 PLUMBING


THE USE OF THESE PLANS AND SPECIFICATIONS SHALL BE RESTRICTED TO THE ORIGINAL SITE FOR WHICH THEY WERE PREPARED AND PUBLICATION THEREOF IS EXPRESSLY LIMITED TO SUCH USE. RE-USE, REPRODUCTION, OR PUBLICATION IN WHOLE OR IN PART, IS PROHIBITED. TITLE TO THE PLANS AND SPECIFICATIONS REMAINS WITH THE ENGINEER WITHOUT PREJUDICE. VISUAL CONTACT WITH THESE PLANS AND SPECIFICATIONS SHALL CONSTITUTE PRIMA FACIE EVIDENCE OF THE ACCEPTANCE OF THESE RESTRICTIONS. AXIOM ENGINEERS, INC. - LEE & ASSOCIATES CONSULTING ENGINEERS  
 22 Lower Regalade Dr., Suite A  
 Monterey, California 93940-3708  
 (831) 649-8000  
 (831) 649-8008  
 email: mail@axiomengineers.com

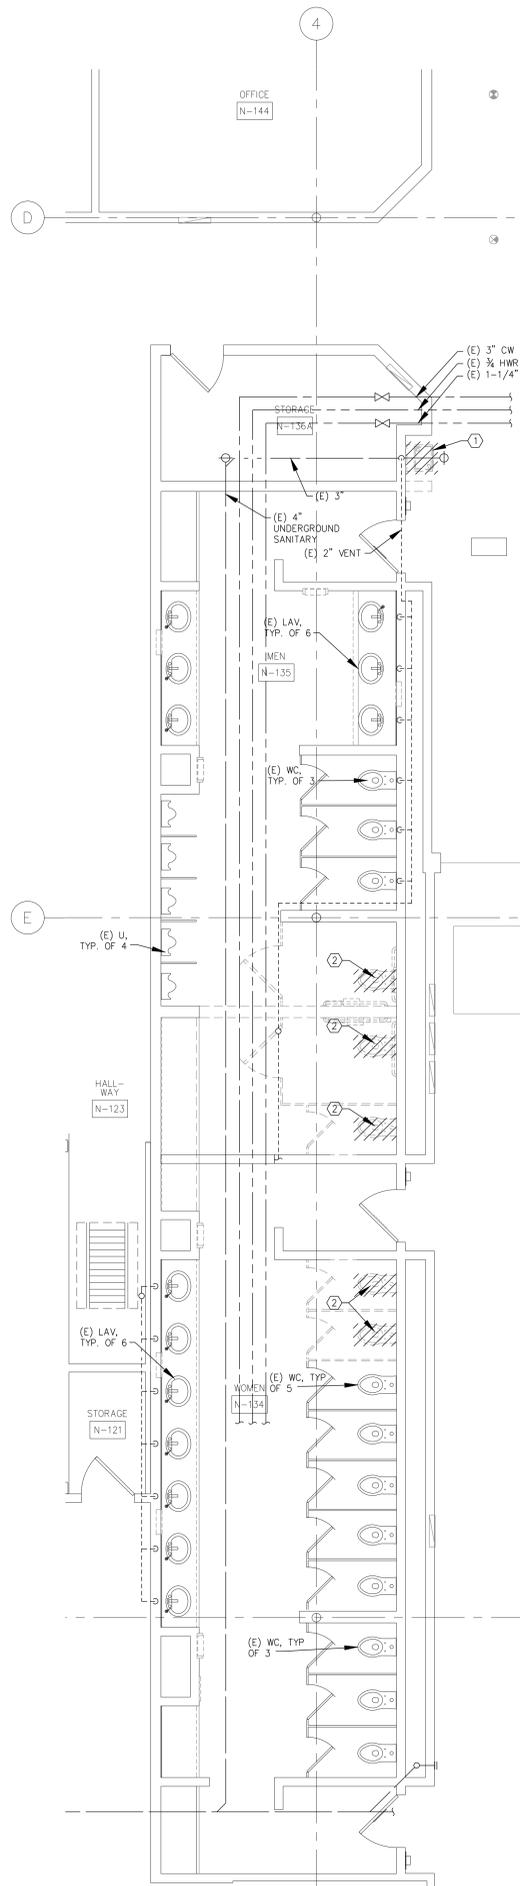

**NORTH BUILDING DEMOLITION PLAN - PLUMBING**  
 SCALE: 1/4" = 1'-0"

**DEMOLITION NOTES:**

- 1 REMOVE (E) DRINKING FOUNTAIN. PROTECT (E) CW, WASTE AND VENT PIPING FOR REUSE WITH NEW FIXTURE.
- 2 REMOVE (E) WC AND ASSOCIATED CARRIER. CAP (E) CW, WASTE AND VENT PIPING.
- 3 REMOVE (E) URINAL AND ASSOCIATED CARRIER. CAP (E) CW, WASTE AND VENT PIPING.
- 4 REMOVE (E) COUNTER MOUNTED LAVATORY. PROTECT (E) CW, HW, WASTE AND VENT FOR REUSE WITH NEW FIXTURE.
- 5 REMOVE (E) SHOWER MIXING VALVE, RISER PIPE, AND SHOWER HEAD. PROTECT (E) HW AND CW PIPING FOR REUSE WITH NEW FIXTURE.

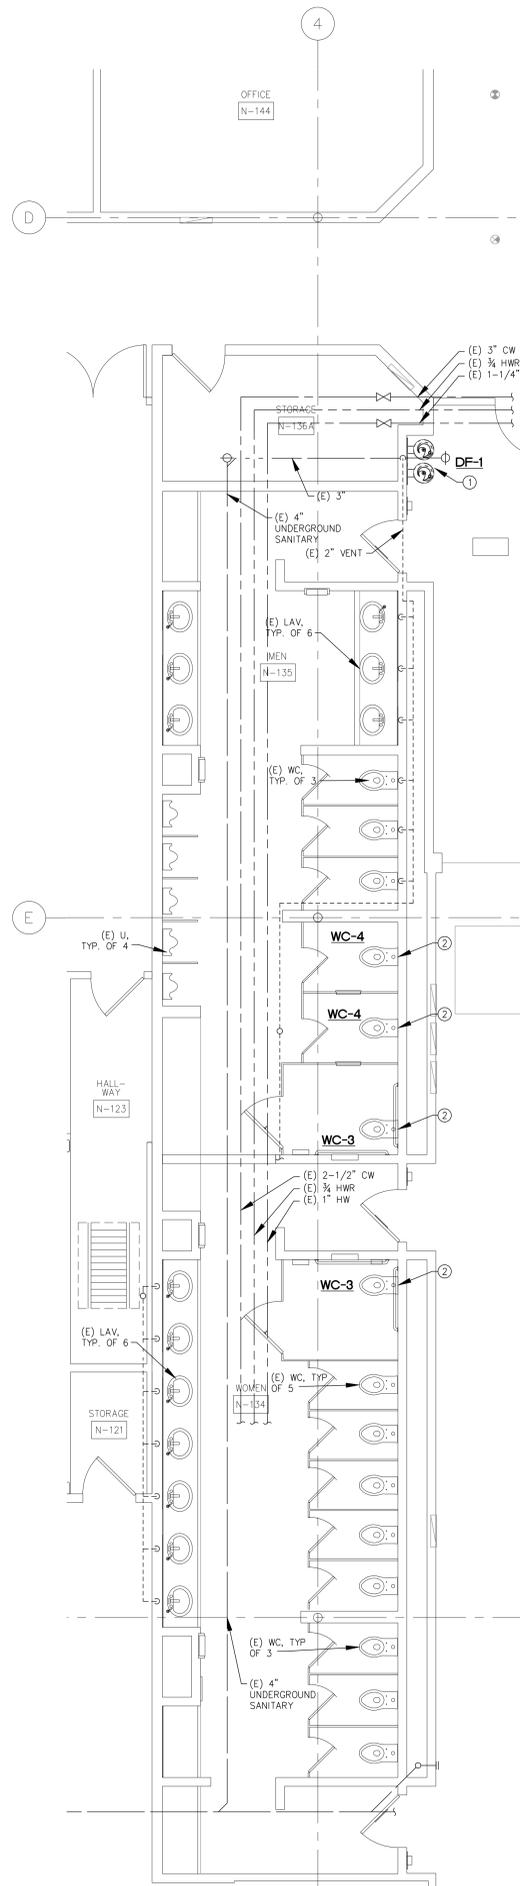

**NORTH BUILDING ENLARGED PLAN - PLUMBING**  
 SCALE: 1/4" = 1'-0"

**PLUMBING NOTES:**

- 1 INSTALL NEW BI-LEVEL DRINKING FOUNTAIN (DF-1). CONNECT TO (E) CW, WASTE AND VENT PIPING.
- 2 INSTALL NEW WATER CLOSET. EXTEND (E) CW, WASTE AND VENT PIPING TO SERVE FIXTURE IN NEW LOCATION.
- 3 INSTALL NEW URINAL. EXTEND (E) CW, WASTE AND VENT PIPING TO SERVE FIXTURE IN NEW LOCATION.
- 4 INSTALL NEW WALL HUNG LAVATORY. CONNECT TO (E) HW, CW, WASTE, AND VENT PIPING.
- 5 INSTALL NEW SHOWER MIXING VALVE, RISER PIPE, AND SHOWER HEAD. EXTEND (E) HW AND CW PIPING TO SERVE FIXTURE IN NEW LOCATION.
- 6 INSTALL NEW COUNTER MOUNTED SINK. CONNECT TO (E) HW, CW, WASTE AND VENT PIPING.
- 7 INSTALL NEW WALL HUNG LAVATORY. EXTEND (E) HW, CW, WASTE AND VENT PIPING TO SERVE FIXTURE IN NEW LOCATION.
- 8 INSTALL NEW BI-LEVEL DRINKING FOUNTAIN. EXTEND (E) CW, WASTE AND VENT PIPING TO SERVE FIXTURE IN NEW LOCATION.



v: (831) 649-8000  
 f: (831) 649-8008  
 email: mail@axiomengineers.com  
**AXIOM ENGINEERS**  
 LEE & ASSOCIATES  
 CONSULTING ENGINEERS  
 22 Lower Regalade Dr., Suite A  
 Monterey, California 93940-3708  
 AE Project #: 20150097

JOB NO.  
**14105.1**  
 PRINT DATE:  
 PLOT DATE: 02/01/16  
 DRAWN BY: CAD  
 CHECKED BY: RSS  
 SET ISSUED:  
 02/01/2016 100% CD

SHEET NAME:  
**NORTH BUILDING ENLARGED PLAN - PLUMBING**  
 SHEET NO.:


THE USE OF THESE PLANS AND SPECIFICATIONS SHALL BE RESTRICTED TO THE ORIGINAL SITE FOR WHICH THEY WERE PREPARED AND PUBLICATION THEREOF IS EXPRESSLY LIMITED TO SUCH USE. RE-USE, REPRODUCTION, OR PUBLICATION BY ANY METHOD, IN WHOLE OR IN PART, IS PROHIBITED. TITLE TO THE PLANS AND SPECIFICATIONS REMAINS WITH THE ENGINEER WITHOUT PREJUDICE. VISUAL CONTACT WITH THESE PLANS AND SPECIFICATIONS SHALL CONSTITUTE PRIMA FACIE EVIDENCE OF THE ACCEPTANCE OF THESE RESTRICTIONS. AXIOM ENGINEERS, INC. - LEE & ASSOCIATES CONSULTING ENGINEERS  
 22 LOWE ROSSADE DR., SUITE A MONTEREY, CALIFORNIA 93940-3788  
 TEL: (831) 649-8000 FAX: (831) 649-8038  
 WWW.AXIOMENGINEERS.COM

**DEMOLITION NOTES:**


- 1 REMOVE (E) DRINKING FOUNTAIN. PROTECT (E) CW, WASTE AND VENT PIPING FOR REUSE WITH NEW FIXTURE.
- 2 REMOVE (E) WC AND ASSOCIATED CARRIER. CAP (E) CW, WASTE AND VENT PIPING.
- 3 REMOVE (E) URINAL AND ASSOCIATED CARRIER. CAP (E) CW, WASTE AND VENT PIPING.
- 4 REMOVE (E) COUNTER MOUNTED LAVATORY. PROTECT (E) CW, HW, WASTE AND VENT FOR REUSE WITH NEW FIXTURE.
- 5 REMOVE (E) SHOWER MIXING VALVE, RISER PIPE, AND SHOWER HEAD. PROTECT (E) HW AND CW PIPING FOR REUSE WITH NEW FIXTURE.

**PLUMBING NOTES:**


- 1 INSTALL NEW BI-LEVEL DRINKING FOUNTAIN (DF-1). CONNECT TO (E) CW, WASTE AND VENT PIPING.
- 2 INSTALL NEW WATER CLOSET. EXTEND (E) CW, WASTE AND VENT PIPING TO SERVE FIXTURE IN NEW LOCATION.
- 3 INSTALL NEW URINAL. EXTEND (E) CW, WASTE AND VENT PIPING TO SERVE FIXTURE IN NEW LOCATION.
- 4 INSTALL NEW WALL HUNG LAVATORY. CONNECT TO (E) HW, CW, WASTE, AND VENT PIPING.
- 5 INSTALL NEW SHOWER MIXING VALVE, RISER PIPE, AND SHOWER HEAD. EXTEND (E) HW AND CW PIPING TO SERVE FIXTURE IN NEW LOCATION.
- 6 INSTALL NEW COUNTER MOUNTED SINK. CONNECT TO (E) HW, CW, WASTE AND VENT PIPING.
- 7 INSTALL NEW WALL HUNG LAVATORY. EXTEND (E) HW, CW, WASTE AND VENT PIPING TO SERVE FIXTURE IN NEW LOCATION.
- 8 INSTALL NEW BI-LEVEL DRINKING FOUNTAIN. EXTEND (E) CW, WASTE AND VENT PIPING TO SERVE FIXTURE IN NEW LOCATION.

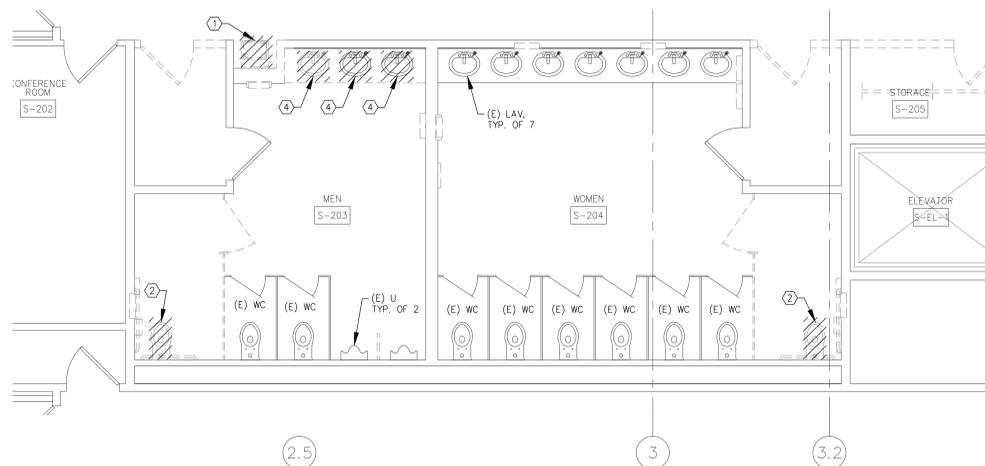


**3 SOUTH BUILDING 2ND FLOOR DEMOLITION PLAN - PLUMBING**  
 SCALE: 1/4" = 1'-0"

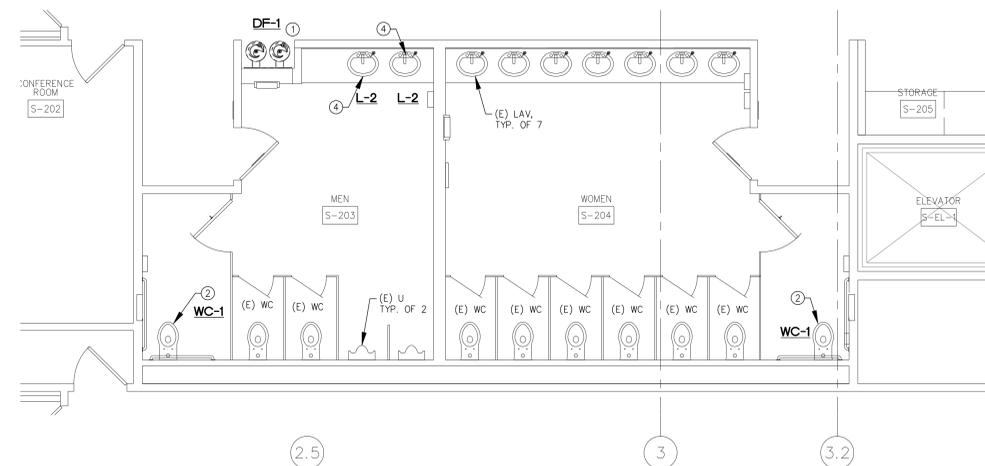

**4 SOUTH BUILDING 2ND FLOOR ENLARGED PLAN - PLUMBING**  
 SCALE: 1/4" = 1'-0"

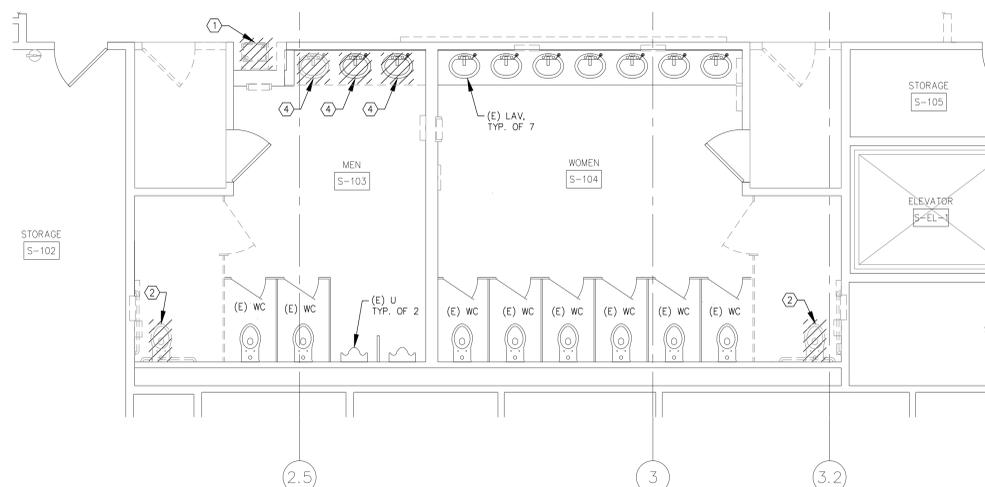

**1 SOUTH BUILDING 1ST FLOOR DEMOLITION PLAN - PLUMBING**  
 SCALE: 1/4" = 1'-0"

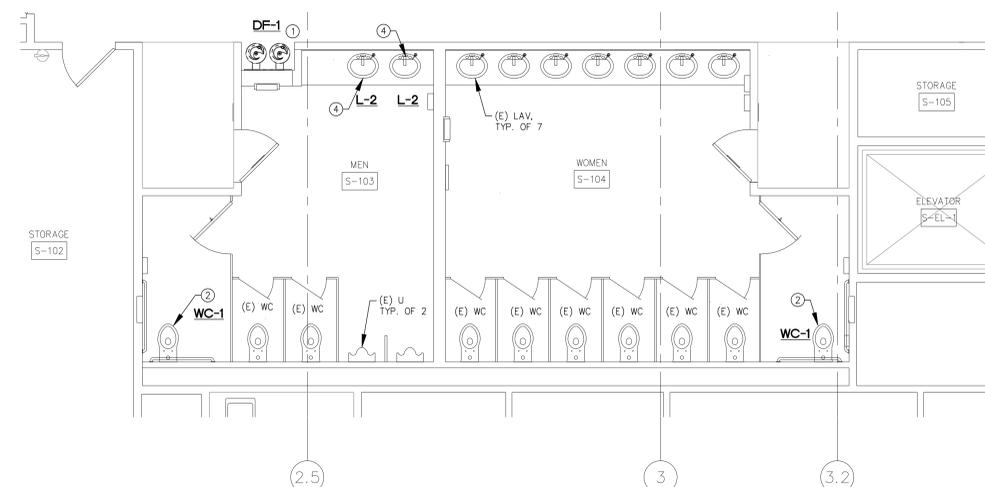

**2 SOUTH BUILDING 1ST FLOOR ENLARGED PLAN - PLUMBING**  
 SCALE: 1/4" = 1'-0"

THE USE OF THE PLANS AND SPECIFICATIONS IS RESTRICTED TO THE ORIGINAL SITE FOR WHICH THEY WERE PREPARED AND PUBLICATION THEREOF IS EXPRESSLY LIMITED TO SUCH USE. RE-USE, REPRODUCTION, OR PUBLICATION BY ANY METHOD, IN WHOLE OR IN PART, IS PROHIBITED. TITLE TO THE PLANS AND SPECIFICATIONS REMAINS WITH THE ARCHITECT AND VISUAL CONTACT WITH THEM CONSTITUTES PRIMA FACIE EVIDENCE OF THE ACCEPTANCE OF THESE RESTRICTIONS.

JOB NO.  
**14105.1**  
 PRINT DATE:  
 PLOT DATE: 02/01/16  
 DRAWN BY: CAD  
 CHECKED BY: RSS  
 SET ISSUED:  
 02/01/2016 100% CD

SHEET NAME:  
 SOUTH BUILDING  
 1st AND 2nd  
 FLOOR ENLARGED  
 PLANS - PLUMBING  
 SHEET NO.:



AXIOM ENGINEERS  
 LEE & ASSOCIATES  
 CONSULTING ENGINEERS  
 22 LOWE ROSSADE DR., SUITE A  
 MONTEREY, CALIFORNIA 93940-3788  
 TEL: (831) 649-8000  
 FAX: (831) 649-8038  
 EMAIL: MAIL@AXIOMENGINEERS.COM

AXIOM ENGINEERS  
 LEE & ASSOCIATES  
 CONSULTING ENGINEERS  
 22 LOWE ROSSADE DR., SUITE A  
 MONTEREY, CALIFORNIA 93940-3788  
 TEL: (831) 649-8000  
 FAX: (831) 649-8038  
 EMAIL: MAIL@AXIOMENGINEERS.COM