

Salinas Valley Basin August Trough 2024


Lines of Equal Groundwater Elevation
in the 180-Ft and East Side Shallow
Aquifers

- 10-ft Groundwater Elevation Contours
- - - Potential Fault Zone



0 1 2 4 Miles

Date: 10/29/2024

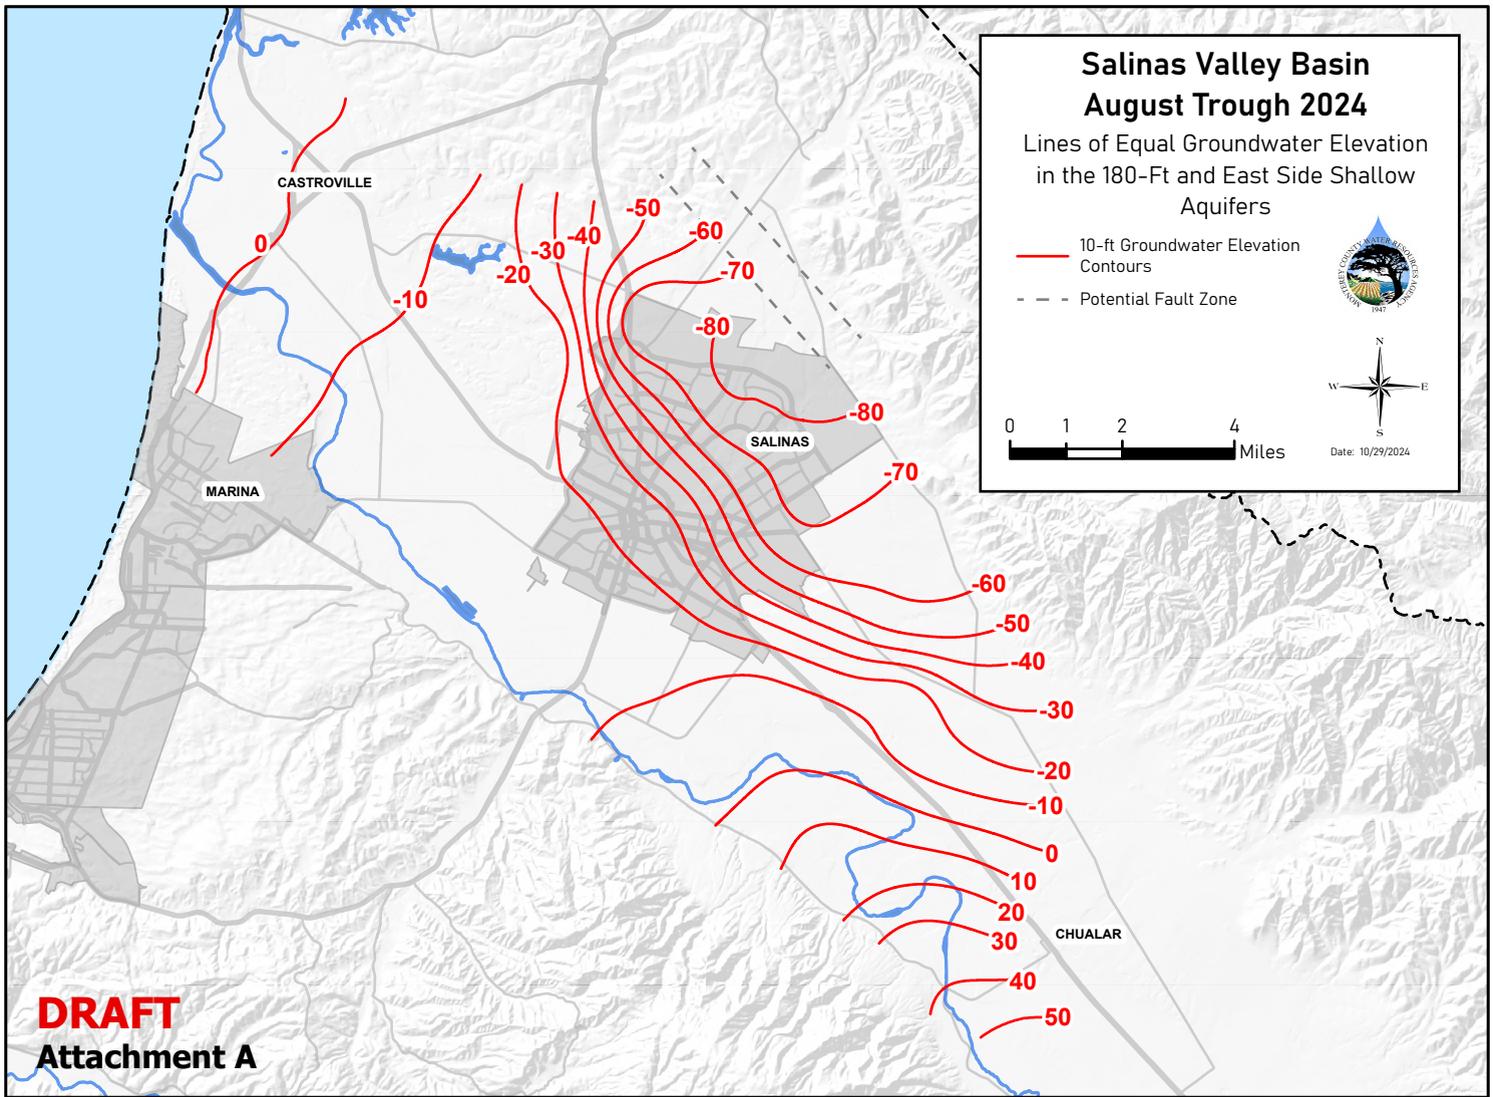

DRAFT
Attachment A