

GENERAL NOTES

- ALL WORK DEPICTED ON THESE DRAWINGS IS REQUIRED TO COMPLY WITH:
 - 2022 CALIFORNIA BUILDING CODES (CBC)
 - 2022 RESIDENTIAL CODE (CRC)CONSTRUCTION IS TO COMPLY WITH ALL VOLUMES, SECTIONS, AND SUBSECTIONS OF THAT CODE. IT IS THE CONTRACTOR'S RESPONSIBILITY TO BE FAMILIAR WITH THE STANDARD REQUIREMENTS FOR CONSTRUCTION AND TO MAINTAIN A COPY OF THE 2022 CBC AND 2022 CRC AT ALL TIMES. THE CODE IS TO BE CONSIDERED TO BE PART OF THE SET.
- THE CONTRACTOR TO PROVIDE ALL WORK AND MATERIALS IN ACCORDANCE WITH OR AS REQUIRED BY THE:
 - 2022 CALIFORNIA PLUMBING CODE (CPC),
 - 2022 CALIFORNIA MECHANICAL CODE (CMC),
 - 2022 CALIFORNIA ELECTRICAL CODE (CEC),
 - 2022 CALIFORNIA ENERGY CODE (T24-6),
 - 2022 CALIFORNIA FIRE CODE,AND ALL OTHER APPLICABLE STATE, FEDERAL, AND LOCAL CODES.
- THESE DRAWINGS AND SPECIFICATIONS ARE THE PROPERTY AND COPYRIGHT OF THE DESIGNER AND SHALL NOT BE USED ON ANY OTHER PROJECT EXCEPT BY WRITTEN AGREEMENT WITH THE DESIGNER.
- THE CONTRACTOR IS RESPONSIBLE FOR:
 - PLANS
 - NOTES
 - DETAILS
 - ELEVATIONS
 - CONSULTANT REPORTS
 - SUPPORTING DOCUMENTS PRIOR TO COMMENCEMENT OF ANY WORK THOROUGH REVIEW AND FAMILIARITY OF THESE DOCUMENTS IS REQUIRED AND ANY DISCREPANCY IN THESE DOCUMENTS IS TO BE BROUGHT TO THE IMMEDIATE ATTENTION OF THE DESIGNER.
- IF SPECIFICATIONS VARY WITHIN THE SET, THE MOST STRINGENT IS SAID TO APPLY UNLESS CLARIFIED IN WRITING BY THE DESIGNER.
- IF ANY DETAILS ARE NOTED TO BE MISSING OR INCOMPLETE, WRITTEN QUESTIONS ARE TO BE DIRECTED TO THE DESIGNER FOR CLARIFICATION PRIOR TO THE SIGNING OF ANY CONTRACT FOR CONSTRUCTION
- THE GENERAL CONTRACTOR IS REQUIRED TO NOTIFY THE DESIGNER IN WRITING OF:
 - SUBSTITUTION
 - REVISION
 - PROPOSED ALTERNATESAT LEAST TWO WEEKS PRIOR TO THE EXPECTED DATE OF ORDER OR INSTALLATION OF SAID ALTERNATE IN ORDER TO ALLOW ADEQUATE TIME OF COORDINATION AND APPROVALS BY THE DESIGNER, ANY PROFESSIONAL CONSULTANT, AS WELL AS THE LOCAL CODE ENFORCEMENT AGENCY. A TWO WEEK RESPONSE PERIOD IS NOT GUARANTEED, SO THE GREATER THE NOTICE PERIOD THE BETTER.
- THE GENERAL CONTRACTOR SHALL BE RESPONSIBLE FOR SCHEDULING AND BEING PRESENT FOR ALL REQUIRED INSPECTIONS.
- WRITTEN DIMENSIONS SHALL TAKE PRECEDENCE OVER SCALED DIMENSIONS AND SHALL BE VERIFIED ON THE JOB SITE. WHERE APPROPRIATE, ALIGNMENTS TO EXISTING WALLS AND FINISHES SHOULD GOVERN. ANY DISCREPANCY SHALL BE IMMEDIATELY BROUGHT TO THE ATTENTION OF THE DESIGNER PRIOR TO THE COMMENCEMENT OF ANY WORK. THE GENERAL CONTRACTOR SHALL KEEP A SET OF THESE PLANS AND SPECIFICATIONS ON THE JOB SITE AS REFERENCE AT ALL TIMES. THE GENERAL CONTRACTOR AND FRAMING CONTRACTOR ARE RESPONSIBLE FOR WORKING TO COORDINATE SHEAR WALL LENGTHS AND HOLD-DOWN LOCATIONS WITH PLUMBING AND MECHANICAL INFRASTRUCTURE. FURRING AND SOFFITS SHOULD BE FRAMED AS REQUIRED AND WITH VERIFICATION OF OWNER OR DESIGNER.
- THE CONSTRUCTION CONTRACTOR AND HIS SUBCONTRACTORS AGREE THAT IN ACCORDANCE WITH GENERALLY ACCEPTED CONSTRUCTION PRACTICES, THE CONTRACTOR AND THEIR SUBCONTRACTORS WILL BE REQUIRED TO ASSUME SOLE AND COMPLETE RESPONSIBILITY FOR JOB SITE CONDITIONS DURING THE COURSE OF CONSTRUCTION OF THE PROJECT, INCLUDING THE SAFETY OF ALL PERSONS AND PROPERTY. THIS REQUIREMENT SHALL BE MADE TO APPLY CONTINUOUSLY AND LIMITED TO NORMAL WORKING HOURS. THE CONSTRUCTION CONTRACTOR AND THEIR SUBCONTRACTORS FURTHER AGREE TO DEFEND, INDEMNIFY, AND HOLD THE DESIGNER HARMLESS FROM ANY AND ALL LIABILITY, REAL OR ALLEGED, IN CONNECTION WITH THE PERFORMANCE OF THE WORK ON THE PROJECT, EXCEPT LIABILITY ARISING FROM THE SOLE NEGLIGENCE OF THE DESIGNER.
- THE GENERAL CONTRACTOR IS REQUIRED TO DESIGNATE A CONTACT PERSON FOR THE PROJECT TO RECEIVE ALL INFORMATION RELATED TO THE JOB SITE INFORMATION. THE CONTACT'S NAME AND PHONE NUMBER ARE TO BE GIVEN TO THE OWNER AND THE DESIGNER. UNLESS SPECIFIED BY THE OWNER, THE CONTRACTORS IS TO PROVIDE RESPONSIBLE, APPROPRIATE, AND SANCTIONED SUPERVISION ON THE JOB SITE FOR THE DURATION OF THE PROJECT. THE GENERAL CONTRACTOR IS TO PROVIDE AND MAINTAIN A JOB SITE PHONE NUMBER, EMAIL, OR FAX. THE CONTRACTOR IS RESPONSIBLE FOR ADEQUATE SUPERVISION OF ALL SUB-TRADES.
- THE CONTRACTOR SHALL CONFINE OPERATIONS TO THE SITE AREA AS PERMITTED BY LAW, ORDINANCES, PERMITS, AND THE CONTRACT DOCUMENTS AND SHALL NOT UNREASONABLY ENCUMBER THE SITE WITH ANY MATERIALS OR EQUIPMENT.
- NO PORTION OF THE WORK REQUIRING A SHOP DRAWING OR SAMPLE SUBMISSION (PER THE REQUEST OF THE OWNER, GENERAL CONTRACTOR, OR DESIGNER) SHALL BE COMMENCED UNTIL THE SUBMISSION HAS BEEN REVIEWED AND ACTED UPON BY THE SAID PARTY. ALL SUCH PORTIONS OF THE WORK SHALL BE IN ACCORDANCE WITH THE APPROVED SHOP DRAWINGS AND SAMPLES.
- THE GENERAL CONTRACTOR IS RESPONSIBLE FOR VISITING THE JOB SITE PRIOR TO BIDDING AND CONDUCTING REASONABLE INSPECTION OF EXISTING CONDITIONS FOR PURPOSES OF ACCURATELY ASSESSING THE SCOPE OF WORK, SITE CONDITIONS, AND OVERALL PROJECT INTENT. QUESTIONS ARISING FROM THE SITE VISIT ARE TO BE DIRECTED TO THE DESIGNER FOR CLARIFICATION PRIOR TO BID.
- THESE DRAWINGS ARE INTENDED TO ILLUSTRATE A COMPLETE JOB. UNLESS SPECIFIED, WORK IS TO INCLUDE ALL COMMON AND NECESSARY ACCESSORIES (I.E. TOILET ROLL HOLDERS, TOWEL BARS, MIRRORS, ETC.) AS WELL AS ALL COMPONENTS REQUIRED TO COMPLETE CURRENT CODE REQUIREMENTS IN THE JURISDICTION WHERE WORK IS BEING PERFORMED. THE CONTRACTOR IS RESPONSIBLE FOR INCLUDING SUB-STRUCTURE FURRING, INCLUDING FLOOR - WALL - OR CEILING PADDING TO ASSURE SURFACES ARE PLUMB, AND ALIGNED WITHIN A 1/4" ON AN 8' MEASURE. CONCEALMENT OF STEEL STRUCTURAL BRACKETS, BEAMS, TABS, BOLTS, AND PROTRUDING ELEMENTS ARE TO BE CONSIDERED AT THE TIME OF ROUGH FRAME BIDDING AND ARE TO BE INCLUDED IN THE CONSTRUCTION. FURRING, NOTCHING, AND ALTERNATIVE WELDING AND ANY OTHER MEANS MAY BE CONSIDERED PENDING APPROVAL OF THE STRUCTURAL ENGINEER.
- PERTAINING CERTAIN ITEMS, MATERIALS, AND FEATURES REPRESENTED WITHIN THIS SET MAY NOT BE APPROVED AS PART OF THE BUILDING DEPARTMENT. QUESTIONS REGARDING THE SPECIFICS OF APPROVAL SHALL BE DIRECTED TO THE LOCAL JURISDICTION.
- NOTICE: THIS SET HAS BEEN PRODUCED FOR THE PURPOSE OF OBTAINING A BUILDING PERMIT. THESE DRAWINGS ARE NOT TO BE CONSIDERED AS BUILDS, NOR INCLUSIVE OF ALL DETAILS, DRAWINGS, MATERIALS SPECIFICATIONS, ETC. THESE ARE INTENDED TO ADDRESS ALL POSSIBLE CONSTRUCTION ISSUES.
- NOTICE: THESE WORKING DRAWINGS ARE NOT TO BE USED IN ANY CONSTRUCTION FOR WHICH BUILDING PERMITS HAVE NOT BEEN OBTAINED. ADDITIONALLY, THE CONTRACTED BUILDERS ARE NOT RESPONSIBLE FOR THE CORRECTNESS OF ANY WORK UNDERTAKEN PREMATURELY IF IT IS BASED ON PLANS THAT HAVE NOT BEEN REVIEWED AND APPROVED BY THE BUILDING DEPARTMENT. THIS STIPULATION APPLIES TO ORIGINAL SUBMITTAL DRAWINGS AND REVISIONS. ALL DRAWINGS ARE PRELIMINARY UNTIL A PERMIT IS ISSUED.
- AS PART OF THE CONTRACT REQUIREMENTS FOR THIS PROJECT, THE GENERAL CONTRACTOR AND SUBCONTRACTORS ARE RESPONSIBLE FOR COMPLIANCE WITH THE 2022 CALIFORNIA GREEN BUILDING STANDARDS CODE.
- A BUILDING OPERATIONS MANUAL MUST BE PROVIDED TO THE OWNER PER GREEN BUILDING CODE SECTION 4.410.1.

DEMOLITION NOTES

- THE GENERAL CONTRACTOR IS TO VERIFY ANY EXISTING FEATURES AND FINISHES TO REMAIN PRIOR TO DEMOLITION. MATERIALS, FIXTURES, HARDWARE, APPLIANCES, ETC. WHICH ARE TO BE REUSED SHALL BE STORED AND PROTECTED FROM DAMAGE UNTIL THEY ARE TO BE RE-INSTALLED.
- THE GENERAL CONTRACTOR IS TO VERIFY WITH OWNERS WHETHER REMOVED OR UNUSED DOORS, WINDOWS, FIXTURES, HARDWARE, AND MISCELLANEOUS MATERIALS SHOULD BE SAVED FOR POSSIBLE FUTURE REUSE - OR DISCARDED. THE OWNER SHALL MARK A LIST OF SUCH ITEMS PRIOR TO DEMOLITION.
- THE GENERAL CONTRACTOR IS RESPONSIBLE FOR THE REPLACEMENT OF ITEMS DAMAGED BY DEMOLITION OR REMOVED IN ERROR.
- NO ASBESTOS REMOVAL IS THE BE UNDERTAKEN BY ANY PARTY EXCEPT AS ALLOWED BY LAW.
- THE GENERAL CONTRACTOR SHALL PROVIDE VISQUEEN SCREENING DURING DEMOLITION TO PROTECT EXISTING RESIDENCE, APPLIANCES AND FURNISHINGS. AS APPROPRIATE POSITIVE VENTILATION IS TO BE PROVIDED FOR DUST CONTROL.
- THE GENERAL CONTRACTOR IS RESPONSIBLE FOR ALL CONSTRUCTION DEBRIS AND ALL OTHER ORGANIC MATERIAL REMOVAL FROM THE STRUCTURE AND THE SITE. FRAMED AREAS TO BE FREE OF DEBRIS PRIOR TO SHEETROCKING, UNDERFLOOR, AND ATTIC AREA SHALL BE LEFT CLEAN AND FREE OF DEBRIS, CUT-OFFS, SCRAPS, SAWDUST, ASSOCIATED GARBAGE, ETC.
- THE DESIGN AND INSTALLATION OF ALL TEMPORARY SHORING IS THE SOLE RESPONSIBILITY OF THE GENERAL CONTRACTOR. ALL EXISTING FRAMING AND LOAD TRANSFER IS TO BE FIELD VERIFIED PRIOR TO SHORING ANY PORTION OF THE STRUCTURE.
- ALL UNUSED AND DEMOLISHED ELECTRICAL IS TO BE REMOVED BACK TO THE NEAREST UTILIZED JUNCTION. NO DEAD HOTS ARE TO REMAIN AFTER CONSTRUCTION. TEMPORARY POWER FOR THE DURATION

SITE DEVELOPMENT NOTES

- VERIFY LOCATIONS OF ALL UNDERGROUND UTILITIES PRIOR TO EXCAVATION
- THE CONTRACTORS SHALL VERIFY THE LOCATION OF ALL PROPERTY BOUNDARIES FOR THE SITE AND VERIFY ALL SETBACK AND EASEMENT LOCATIONS PRIOR TO CONSTRUCTION. THE OWNER IS RESPONSIBLE FOR PROVIDING A LICENSED SURVEY AND TITLE REPORT IF REQUIRED BY THE LOCAL JURISDICTION. ANY DISCREPANCIES SHOULD BE BROUGHT TO THE ATTENTION OF THE DESIGNER BEFORE FURTHER COMMENCEMENT OF WORK.
- THE CONTRACTOR IS RESPONSIBLE FOR NOTIFYING AND SCHEDULING THE PROJECT GEOTECHNICAL ENGINEER FOR SITE INSPECTIONS AND OBSERVATION OF EXCAVATIONS, DRILLING, DRAINAGE, BACKFILL, ETC.
- SOIL COMPACTION FOR GRADING OR BACKFILLING SHALL BE PLACED IN ACCORDANCE WITH THE SOILS ENGINEER RECOMMENDATIONS. IF THERE IS NO SOILS ENGINEER USE 6" LIFTS WITH 90% COMPACTION.
- TEMPORARY EARTH SHORING IS THE RESPONSIBILITY OF THE CONTRACTOR.

FOUNDATION AND CONCRETE NOTES

- FOR GENERAL REFERENCE SEE CRC 2022, CHAPTER 4.
- FOUNDATION VENTS PER CALIFORNIA RESIDENTIAL CODE SECTION R408.1 AND CBC 1203.3. PROVIDE VENT OPENINGS NOT LESS THAN 1 SF FOR EACH 150 SF OF CRAWL SPACE AREA. OPENINGS SHALL BE COVERED WITH CORROSION RESISTANT WIRE MESH WITH A MAXIMUM OPENING OF 1/4 INCH DIMENSION OR PER CBC 1203.3.1. WHERE MOISTURE DUES TO CLIMATE AND GROUNDWATER CONDITIONS IS NOT CONSIDERED EXCESSIVE, AND THE GROUND SURFACE IS COVERED BY A CLASS 1 VAPOR RETARDING MATERIALS, THE REQUIRED NET AREA OF VENT OPENING MAY BE REDUCED TO 1 SF PER 1500 SF PROVIDED VENT OPENINGS ARE LOCATED WITHIN 3 FEET OF EACH CORNER OF THE BUILDING, OR AS APPROVED TO PROVIDE CROSS VENTILATION OF THE SPACE PER 2022 CRC R408.2
- CRAWL SPACE ACCESS - PER 2022 CRC R408.4 AND CBC 1209.1 PROVIDE A MINIMUM OF ONE 18"x24" CRAWL SPACE TO UNDERFLOOR AREAS. PIPES DUCTS AND OTHER NON-STRUCTURAL CONSTRUCTION SHALL NOT INTERFERE WITH ACCESSIBLE CLEARANCE TO UNDERFLOOR AREA.
- CRAWL SPACE CLEARANCE PER 2022 CRC R408.6, THERE SHALL BE A CLEARANCE OF AT LEAST 18" BETWEEN THE UNDERSIDE OF WOOD FLOOR JOISTS AND THE FINISHED SURFACE OF THE GROUND BENEATH, AND AT LEAST 12" BETWEEN THE UNDERSIDE OF ANY OTHER WOOD HORIZONTAL FRAMING MEMBERS AND THE FINISHED SURFACE OF THE GROUND, WHERE SUCH CLEARANCE IS NOT PROVIDED, WOOD JOISTS, GIRDERS, SUBFLOORS) SHALL BE PRESERVATIVE TREATED, INCLUDING POSTS.
- DECAY PROTECTION PER CRC SECTION R317.1 WOOD FRAMING LESS THAN 8" FROM EARTH SHALL BE NATURALLY DURABLE OR PRESERVATIVE TREATED. PROVIDE 8 INCHES WOOD FRAMING SEPARATION FROM EXPOSED EARTH, OR, IF LESS THAN 8 INCHES USE NATURALLY DURABLE OR PRESERVATIVE TREATED WOOD. IF EARTH IS PAVED AT LEAST 18 INCHES WIDE W/ ASPHALT OR CONCRETE AND DRAINING AWAY FROM THE BUILDING BOTTOM SILLS MAY BE 6" ABOVE SUCH SLAB.
- ALL CONCRETE ROUGH OPENING SIZES, ELEVATIONS, ETC ARE TO BE VERIFIED PRIOR TO FOUNDATION POUR. LOCATIONS OF HOLDDOWNS, CURBS, STEPS, CURTAINS, PLUMBING, MECHANICAL, ETC ARE TO BE COORDINATED BY THE GENERAL CONTRACTOR. SHOULD ADDITIONAL CLARIFICATIONS TO THESE DRAWINGS BE REQUIRED, THE CONTRACTOR SHALL CONTACT THE DESIGNER AS EARLY AS POSSIBLE. OWNER IS RESPONSIBLE FOR PROVIDING FINISHED THICKNESS INFORMATION OR ALLOWANCES, GENERAL CONTRACTOR TO VERIFY PRIOR TO POUR.
- ALL COLD JOINTS TO BE CHIPPED FOR ROUGH SURFACE. SANDBLASTED CLEAN AND FREE OF SOIL OR DEBRIS. DAMPEN SURFACE IMMEDIATELY PRIOR TO CONCRETE POUR. COLD JOINTS MUST BE APPROVED BY THE STRUCTURAL ENGINEER.
- REVISIONS AND SUBSTITUTIONS ARE TO BE SUBMITTED TO THE BUILDING DEPARTMENT AND MUST BE APPROVED PRIOR TO CONTINUING WORK.
- SPECIAL INSPECTION WILL BE REQUIRED FOR WATER PROOFING BELOW GRADE. SPECIAL INSPECTIONS ARE REQUIRED PER THE STRUCTURAL ENGINEERING DRAWINGS, AND A PER THE JURISDICTIONAL APPROVAL CHECKLIST.
- SHOULD THE CONTRACTOR ELECT TO USE SHOTCRETE, SPECIAL INSPECTION WILL BE REQUIRED AND THE STRUCTURAL ENGINEER MUST BE GIVEN OPPORTUNITY TO REVISE RE-BAR SCHEDULE.

KITCHEN NOTES

- VERIFY ALL FIXTURE AND OUTLET LOCATIONS WITH OWNER PRIOR TO INSULATION.
- THE CONTRACTOR SHALL PROVIDE AND INSTALL AN APPROVED AIR GAP FOR THE DISHWASHER ON THE DISCHARGE SIDE AT OR ABOVE THE FLOOD LEVEL OF THE INK OR DRAINBOARD, WHICHEVER IS HIGHER.
- PROVIDE HIGH EFFICACY LIGHT FIXTURES FOR GENERAL LIGHTING IN THE KITCHEN AND BATHS. PER 2022 CEC T24-6 SECTION 150(K).
- A 20% WATER REDUCTION IS REQUIRED TO COMPLY WITH 2022 CA GREEN BUILDING STANDARDS CODE (CGBSC) CHAPTER 4 SECTION 4.303.
- PER 2022 CEC ARTICLE 210.52(C), RECEPTACLES ALONG THE COUNTER TOPS SHALL BE SPACED A MAXIMUM 2 FEET FROM THE SINK(S) AND 4 FEET ON-CENTER, ISLAND OR PENINSULA COUNTER TOPS 12 INCHES OR WIDER SHALL HAVE AT LEAST ONE RECEPTACLE FOR EACH 4 FEET OF COUNTER. POINT OF THE WALL MAY BE MORE THAN 24 INCHES FROM AN OUTLET. KITCHEN OUTLETS SHALL BE ON AT LEAST

FLOOR PLAN NOTES

- ALL WORK IS TO COMPLY WITH THE 2022 CA RESIDENTIAL CODE AND THE 2022 CA BUILDING CODE WITH RESPECT TO GROUP "R" OCCUPANCIES.
- VENTILATION- PER 2022 CRC SECTION R303.4, BUILDINGS SHALL BE PROVIDED WITH NATURAL VENTILATION (SECTION 1203.4) OR MECHANICAL VENTILATION PER 2022 CMC. THE MINIMUM OPENABLE AREA OF OCCUPIED SPACE TO THE OUTDOORS SHALL BE 4% OF THE FLOOR AREA BEING VENTILATED (SECTION 1203.4.1) SEE R303.1 FOR MECHANICAL VENTILATION EXCEPTIONS ALLOWED FOR WHOLE HOUSE MECHANICAL VENTILATION SYSTEMS. ROOMS CONTAINING BATHTUBS, SHOWERS, SPAS AND SIMILAR BATHING FIXTURES SHALL BE MECHANICALLY VENTILATED PER CMC. MINIMUM EXHAUST RATES SHALL BE AS SPECIFIED BY CMC TABLE 4-4.
- LIGHT- PER 2022 CRC SECTION R303.1, ALL ROOMS INTENDED FOR HUMAN OCCUPANCY SHALL BE PROVIDED WITH NATURAL LIGHT BY MEANS OF EXTERIOR GLAZED OPENINGS WITH AN AREA OF NOT LESS THAN 8% OF THE FLOOR AREA OF THE ROOM SERVED, OR ARTIFICIAL LIGHT PER SECTION 1205.3. SEE 2022 CBC SECTION 1205.2 FOR ADJOINING SPACE NATURAL LIGHT MINIMUMS. SEE ALSO DOOR AND WINDOW REQUIREMENTS THIS SHEET SECTION 8.
- ROOM EGRESS - IN ALL ROOMS USED FOR LIVING, DINING, AND SLEEPING PURPOSED (HABITABLE ROOMS) PROVIDE 2 MEANS OF EGRESS.
- SMOKE DETECTORS- INSTALL PER 2022 CRC SECTION R314 & R315 DETECTORS SHALL BE MOUNTED ON THE CEILING OR HIGH ON WALL IN EACH SLEEPING AREA AND AT A POINT LOCATED ADJACENT IN THE CORRIDOR OR AREA GIVING ACCESS TO EACH SEPARATE SLEEPING AREA, AND AT LEAST ONE ON EACH LEVEL OF THE BUILDING AS REQUIRED BY THE ABOVE NOTED 2022 CRC SECTIONS AND ALL OTHER APPLICABLE CODES. DETECTORS SHALL BE INSTALLED IN ACCORDANCE WITH APPROVED MANUFACTURER'S INSTRUCTIONS AND COMPLY WITH UL 217. SMOKE DETECTORS SHALL RECEIVE THEIR PRIMARY POWER FROM THE BUILDING WIRING (110V HARD WIRED) WITH BATTERY BACKUP POWER. SMOKE AND FIRE ALARMS SHALL BE INTERCONNECTED IN SUCH MANNER AS ACTIVATION OF ONE ALARM WILL ACTIVATE ALL THE ALARMS.
- GARAGE VENTILATION- GARAGES SHALL BE VENTILATED BY A MEANS OF 4 6"x12" VENTS WITHIN 6" OF THE FLOOR PER 2022 CRC.
- CORRIDORS AND HALLWAYS- AS REQUIRED BY THE 2022 CRC SECTION R311.6, CORRIDORS OR HALLWAYS WITHIN A DWELLING UNIT OR REQUIRED OCCUPANCY LOAD LESS THAN 50 SHALL PROVIDE A CLEAR MINIMUM 36" IN WIDTH. SEE CODE FOR OTHER OCCUPANCIES AND EXCEPTIONS.
- LANDINGS- PER 2022 CRC SECTION R311.7.6 THERE SHALL BE A FLOOR OR LANDING AT THE TOP AND BOTTOM OF EACH STAIRWAY. THE WIDTH OF THE LANDINGS SHALL NOT BE LESS THAN THE WIDTH OF THE STAIRWAYS THEY SERVICE OR MORE THAN 48" IF THE STAIRWAY IS A STRAIGHT RUN. DOORS OPENING ONTO A LANDING SHALL NOT REDUCE THE LANDING TO LESS THAN ONE HALF THE REQUIRED WIDTH OR PROJECT MORE THAN 7" INTO A LANDING. IN GROUP R-3 OCCUPANCIES, A LANDING IS NOT REQUIRED AT THE TOP OF INTERIOR STAIRS PROVIDED THE DOOR DOES NOT SWING OVER THE STAIRS.
- LANDINGS AT EXTERIOR DOORS- PER 2022 CRC SECTION R311.3 LEVEL CHANGES AT EXTERIOR DOORS SHALL NOT EXCEED 1/2" AT EXTERIOR DOORS AND 7/75" AT INSWING OR SLIDING DOORS, AS MEASURED FROM TOP OF THRESHOLD TO FINISHED SURFACE. PROVIDE RECESSED THRESHOLD, COPPER PAN, AND FLASHING TO ACCOMMODATE MANUFACTURERS DETAILS. ADJUST CURTAIN WALL DETAILS AS REQUIRED, VERIFY WITH MANUFACTURER DETAILS AND SHOP DRAWINGS.
- UNDER STAIRS FIRE PROTECTION- PER 2022 CRC R302.7 WALLS AND SOFFITS OF ENCLOSED CLOSET OR STORAGE SPACE UNDER STAIRS SHALL BE PROTECTED ON THE ENCLOSED SIDE WITH MINIMUM 1HR FIRE PROTECTION, OR USE 5/8" TYPE 'X' GYPSUM BOARD.
- DRAFT STOPS- PER 2022 CRC SECTION R302.12 DRAFT STOPS SHALL BE INSTALLED IN THE FOLLOWING LOCATIONS: FLOOR CEILING ASSEMBLIES - WHERE THERE IS USEABLE SPACE ABOVE AND BELOW THE CONCEALED SPACE OF A FLOOR/CEILING ASSEMBLY, INCLUDING SOFFITS AND INTER-FLOOR PLENUM SPACES. DRAFT STOPS SHALL BE INSTALLED SO THAT THE AREA OF THE CONCEALED SPACE DOES NOT EXCEED 1,000 SQUARE FEET AND IS DIVIDED INTO APPROXIMATELY EQUAL AREA. DRAFT STOPS ARE REQUIRED IN FLOOR/CEILING ASSEMBLIES OF BUILDINGS HAVING MORE THAN ONE DWELLING UNIT AND SHALL BE INSTALLED IN LINE WITH WALLS SEPARATING UNITS. DRAFT STOPS ARE REQUIRED IN ATTICS, OVERHANGS, MANSARDS, AND SIMILAR CONCEALED SPACES OF BUILDINGS CONTAINING MORE THAN ONE DWELLING UNIT.
- FIRESTOPS - ALL PIPE, WIRE, AND DUCT PENETRATIONS IN WALLS ARE TO BE CAULKED OR BLOCKED WITH APPROVED MATERIALS TO RESIST PASSAGE OF A FLAME. PER R302.11.
- ALL FINISHES ARE TO COMPLY WITH V.O.C. AND FORMALDEHYDE LIMITS SET FORTH IN TABLES 4.504 (1,2,3 AND 4)
- ALL JOINTS AND OPENINGS BETWEEN CONDITIONED AND UNCONDITIONED SPACES ARE TO BE CLOSED OR SEALED.

GENERAL STRUCTURAL NOTES

- SHEAR COMPONENTS - GENERAL CONTRACTOR IS RESPONSIBLE FOR HAVING A GENERAL UNDERSTANDING OF SHEAR RESISTING ELEMENTS AND COMPONENTS WITHIN A DESIGN. SHEAR TRANSFER AND HARDWARE IS TO BE INSTALLED PER MANUFACTURERS REQUIREMENTS.
- NOTE THAT STRUCTURAL DETAILING WITHIN THE STRUCTURAL SHEETS MAY INDICATE HARDWARE, BRACKETS, BOLTED CONNECTIONS AND METAL FASTENERS WITH MAY PROTRUDE FROM THE PLANE OF ROUGH FRAMING. IT IS THE FRAMING CONTRACTOR'S RESPONSIBILITY TO INCLUDE FURRING STRIPS, TAPER STRIPS, FILL WEDGES AND BLOCKING AS REQUIRED TO BRING FINISH SURFACES PAST THE PLANE OF ROUGH STRUCTURAL COMPONENTS. ALTERNATIVE DETAILING, SUCH AS WELDED RODS IN PLACE OF BOLTED CONNECTIONS MAY BE SUBSTITUTED ONLY AS APPROVED BY THE STRUCTURAL ENGINEER.
- LUMBER QUALITY- CONTRACTOR IS RESPONSIBLE FOR REVIEWING LUMBER QUALITY AT THE TIME OF EACH DELIVERY. EXCESSIVELY WET, VISUALLY CUPPED, WARPED OR KNOTTY MATERIALS IS NOT TO BE ACCEPTED ON THE JOB SITE. CONTRACTOR IS RESPONSIBLE FOR STORING MATERIALS IN A NEAT, DRY, LEVEL ENVIRONMENT WHERE DAMAGE WILL NOT OCCUR.
- STRUCTURAL DRAWINGS, AND DETAILING BY OTHERS ARE INCLUDED AS A PART OF THIS CONTRACT FOR CONSTRUCTION.
- ALL COMPONENTS SHALL BE FASTENED OR NAILED PER TABLE 2304.10.2 UNLESS PROVIDED OTHERWISE IN STRUCTURAL DRAWINGS. IT IS THE RESPONSIBILITY OF THE GENERAL CONTRACTOR TO COORDINATE REQUIREMENTS FOR NOTCHING AND BORING PER CBC 2308.4.2 AND CRC TABLES R602.6(1) AND R602.6(2) WITH ANY ASSOCIATED SUBTRADES. VERIFY FURRING AND BLOCKING, UP-SIZE FRAMING WHERE REQUIRED

DOOR, WINDOW, & SKYLIGHT NOTES

- UNLESS OTHERWISE REQUESTED BY THE OWNER, THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE VERIFICATION OF ALL DOOR AND WINDOW UNITS, ROUGH OPENING OPERATION CHARACTERISTICS, EGRESS CONDITIONS ETC. PRIOR TO FINAL ORDER OF DOORS AND WINDOWS. THE OWNER, CONTRACTOR, ARCHITECT, AND WINDOW SUPPLIER SHOULD BE GIVEN THE OPPORTUNITY TO WALK THROUGH THE ENTIRE JOB AND VERIFY EACH UNIT PRIOR TO ORDER.
- ALL NEW EXTERIOR DOORS TO BE WEATHER STRIPPED. SEE TITLE 24-6 COMPLIANCE MEASURES WITH THIS SET.
- ALL GLASS AND GLAZING SHALL COMPLY WITH 2022 CRC SECTION R308
- SAFETY GLAZING - PER 2022 CRC, SECTION R308 ALL GLAZING SHALL CONFORM WITH HUMAN IMPACT REQUIREMENTS. SAFETY-TEMPERED GLASS OR PLASTIC IS REQUIRED AT ALL GLAZED DOORS GLAZING WITHIN 24" OF DOORS, WITHIN 18" OF ANY FLOORS IN BATHTUBS, SHOWERS, HOT TUBS, WHIRLPOOLS SAUNAS, AND STEAM ROOMS. SEE 2022 CRC SECTION R308.4 FOR HAZARDOUS LOCATIONS. EACH UNIT OF SAFETY-TEMPERED GLAZING SHALL BE PERMANENTLY IDENTIFIED BY MANUFACTURER, OR BY BUILDING INSPECTOR, AT THEIR DISCRETION, MAY APPROVE A CERTIFICATE.
- EGRESS WINDOWS- PER 2022 CRC SECTION R310 ALL ESCAPE OR RESCUE OPENINGS SHALL HAVE A MINIMUM NET CLEAR OPENABLE AREA OF AT LEAST 5.7 SQUARE FEET. THE MINIMUM NET CLEAR HEIGHT DIMENSION SHALL BE 24 INCHES. THE NET CLEAR WIDTH SHALL BE 20 INCHES. WHEN WINDOWS ARE PROVIDED AS A MEANS OF EGRESS, ESCAPE OR RESCUE, THEY SHALL HAVE A FINISHED SILL HEIGHT OF NOT MORE THAN 44 INCHES ABOVE THE FLOOR PER CBC 1029.3. SEE CRC R612 FOR OPENING LIMITING DEVICE REQUIREMENTS. WINDOWS WITHIN 18" OF A WINDOW SILL IS LOCATED WITHIN 24 INCHES OF THE FINISHED FLOOR, THE WINDOW MUST BE EQUIPPED WITH A LIMITING DEVICE TO PREVENT THE PASSAGE OF A 4' SPHERE.
- SKYLIGHTS- SHALL COMPLY WITH 2022 CRC SECTION R308.6 CONTRACTOR SHALL PROVIDE ICC NUMBERS FOR PREFABRICATED SKYLIGHTS AND ASSEMBLES TO THE BUILDING INSPECTOR FOR APPROVAL PRIOR TO PURCHASE AND INSTALLATION. INDICATE GLAZING TYPE.

ROOF PLAN NOTES

- ATTIC ACCESS- PER 2022 CRC SECTION R807.1, PROVIDE MINIMUM 22X30" ACCESS OPENING TO AND FROM CLEAR HEADROOM IN THE ATTIC SPACE SHALL BE PROVIDED AT 30 SQ. FT. A 30" MINIMUM CLEAR HEADROOM IN THE ATTIC SPACE SHALL BE PROVIDED AT SOME POINT ABOVE THE ACCESS OPENING, MEASURED FROM THE BOTTOM OF CEILING MEMBERS.
- ATTIC AND ENCLOSED RAFTER VENTILATION PER 2022 CRC SECTION R806. THE NET FREE VENTILATING AREA SHALL NOT BE LESS THAN 1/300 OF THE AREA OF SPACE VENTILATED, WITH 50% OF THE REQUIRED VENTILATING AREA PROVIDED BY VENTILATORS LOCATED IN THE UPPER PORTION OF THE SPACE AT LEAST 3 FEET ABOVE EAVE OR CORNICE VENTS. THERE SHALL BE A MINIMUM OF 1" OF CLEAR SPACE FOR VENTING BETWEEN ROOF SHEATHING AND ATTIC INSULATION. UNVENTED ATTIC ASSEMBLIES (COMPLETELY CONTAINED WITHIN THE BUILDING THERMAL ENVELOPE) ARE PERMITTED WHEN ALL CONDITIONS OF CRC SECTION R806.4 ARE MET.
- CONVENTIONAL LIGHT WOOD FRAMING PER 2022 CRC SECTION R802. PROVIDE A CONTINUOUS TIE ACROSS THE BUILDING, WHEN CEILING JOISTS ARE NOT PARALLEL TO RAFTERS. EQUIVALENT RAFTER TIES SHALL BE INSTALLED AT A SPACING OF NOT MORE THAN 4'-0" O.C.
- STRUTS SHALL BE INSTALLED PER 2022 CRC. THE UNBRACED LENGTH SHALL NOT EXCEED 8 FEET AND THE MINIMUM SLOPE OF THE STRUTS SHALL NOT BE LESS THAN 45 DEGREES FROM THE HORIZONTAL.

STAIRWAY, HANDRAIL, & GUARDRAIL NOTES

- STAIRWAYS- STAIRWAYS SHALL MEET EGRESS REQUIREMENTS AS DESCRIBED FOR SPECIFIC TYPE WITHIN THE 2022 CRC SECTION R311.7. GENERALLY, RESIDENTIAL STAIRWAYS SHALL NOT BE LESS THAN 36 INCHES IN WIDTH. THE RISE SHALL NOT BE LESS THAN 4 INCHES OR GREATER THAN 7.75 INCHES, THE RUN SHALL NOT BE LESS THAN 10 INCHES AS MEASURED HORIZONTALLY BETWEEN VERTICAL PLANES OF THE FOREMOST PROJECTION OF THE ADJACENT TREADS. THE LARGEST RISER AND/OR TREAD DEPTH SHALL NOT EXCEED THE SMALLEST BY MORE THAN 3/8 INCH. FOR CURVED STAIRS, THE MINIMUM TREAD DEPTH (WINDER) SHALL BE 6 INCHES WITH A MINIMUM 10 INCH TREAD DEPTH AT THE WALK LINE (12" FROM NARROWEST PORTION OF TREAD). SEE 2022 CRC, SECTION R311.7.10 FOR ADDITIONAL INFORMATION AND/OR EXCEPTION REGARDING CURVED OR SPIRAL STAIRWAYS AND FOR STAIRWAYS SERVING AN OCCUPANT LOAD FACTOR GREATER THAN 10, WHERE THE TREAD DEPTH IS LESS THAN 11", A NOSING MUST PROVIDE A MINIMUM 3/4" AND A MAXIMUM 1-1/4". PER R311.7.5, ANY RADIUS AT THE LEADING EDGE OF THE TREADS MAY NOT EXCEED 9/16".
- MANUFACTURED STAIRS- CONTRACTOR SHALL PROVIDE SHOP DRAWINGS AND ICC NUMBER OF ANY MANUFACTURED STAIR TO THE BUILDING INSPECTOR FOR APPROVAL PRIOR TO INSTALLATION. CONTRACTOR TO VERIFY IA STAIRWAY DETAILS WITH THE ARCHITECT PRIOR TO INSTALLATION. CONTRACTOR TO VERIFY ALL STAIRWAYS DETAILS WITH THE ARCHITECT PRIOR TO FRAMING STAIRWELL. SUBMIT SHOP DRAWINGS BY STAIR MANUFACTURER IF APPLICABLE.
- STAIRWAY HEADROOM- PER 2022 CRC SECTION R311.7.2 EVERY STAIRWAY SHALL HAVE A HEADROOM CLEARANCE OF 80 INCHES MEASURED VERTICALLY FROM A LINE CONNECTING THE EDGE OF THE NOSING. HEADROOM SHALL BE CONTINUOUS TO THE POINT WHERE THE LINE INTERSECTS THE LANDING BELOW, ONE TREAD DEPTH BEYOND THE BOTTOM RISER, THE MINIMUM CLEARANCE SHALL BE MAINTAINED THE FULL WIDTH OF THE STAIRWAY AND LANDING. EXCEPTIONS: SEE EXCEPTION #2 FOR ALLOWABLE 4'-3/4" ENCRoACHMENT AT THROUGH-FLOOR OPENING.
- HANDRAILS- PER 2022 CRC SECTION R311.7.8 HAND RAILS SHALL BE 34 INCHES TO 38 INCHES ABOVE THE NOSING OF TREADS. ENDS OF HANDRAILS SHALL BE RETURNED OR SHALL TERMINATE IN NEVEL POSTS OR SAFETY TERMINALS. HANDRAIL PROJECTING FROM A WALL SHALL HAVE A CLEAR SPACE OF NOT LESS THAN 1-1/2 INCHES BETWEEN THE WALL AND THE HANDRAIL
- HANDGRIPS- PER 2022 CRC SECTION R311.7.8.5 CIRCULAR HANDRAILS SHALL BE NOT LESS THAN 1-1/4 INCHES OR MORE THAN 2 INCHES IN DIAMETER, AND SHALL HAVE A SMOOTH GRIPPING SURFACE WITH NO SHARP CORNERS. SEE THE ABOVE MENTIONED CODE SECTION FOR ADDITIONAL INFORMATION REGARDING ALTERNATIVE (TYPE II) HANDRAIL REQUIREMENTS.
- GUARDRAILS- PER 2022 CRC SECTION R312, RESIDENTIAL GUARDRAIL SHALL BE A MINIMUM OF 42 INCHES IN HEIGHT. OPEN GUARD RAILS SHALL HAVE INTERMEDIATE RAILS OR ORNAMENTAL PATTERN SUCH THAT A 4 INCH DIAMETER SPHERE CANNOT PASS THROUGH (SEC 1013.3) SEE EXCEPTIONS 1 AND 2 FOR ALLOWABLE EXCEPTIONS BETWEEN 38INCHES AND 42 INCHES AND TRIANGULAR OPENINGS ABOVE STAIR TREADS.
- SUPPORT- HANDRAILS AND GUARDRAILS TO BE CAPABLE OF SUPPORTING 200LB. CONCENTRATED LOAD AT ANY ANGLE TO THE TOP RAIL.

MECHANICAL NOTES

- ALL WORK SHALL COMPLY WITH THE 2022 CALIFORNIA MECHANICAL CODE (CMC) AND ALL APPLICABLE FEDERAL, STATE, AND LOCAL CODES. MECHANICAL WORK IS TO BE BID DESIGN/BUILD AND PROVIDED COMPLETE TO CODE.
- MECHANICAL LAYOUT- LAYOUT SHOWN IS SCHEMATIC AND IS SHOWN FOR DESIGN INTENT ONLY. MECHANICAL CONTRACTOR TO COORDINATE WITH THE GENERAL CONTRACTOR TO DESIGN AND INSTALL SUITABLE MECHANICAL DISTRIBUTION SYSTEM PER TITLE 24-6.
- MECHANICAL SYSTEM DESIGN - MECHANICAL CONTRACTOR TO ACCEPT SOLE RESPONSIBILITY FOR PROPER DESIGN AND INSTALLATION OF MECHANICAL SYSTEMS. MECHANICAL CONTRACTOR TO COORDINATE WITH THE GENERAL CONTRACTOR TO DESIGN AND INSTALL SUITABLE MECHANICAL SYSTEMS PER TITLE 24-6. SEE SHEET INDEX FOR LOCATION OF TITLE 24-6 CONFORMANCE WORKSHEETS AND ENERGY COMPLIANCE NOTES WITHIN THIS SET.
- HEATING- PER 2022 CRC SECTION R303.10 HEATING SHALL BE CAPABLE OF MAINTAINING A ROOM TEMPERATURE OF 68 DEGREES FAHRENHEIT AT A POINT 3 FEET ABOVE THE FLOOR.
- FURNACE CLEARANCE- PROVIDE A MINIMUM 6 INCH CLEAR SPACE IN FRONT OF FURNACES. FURNACES SHALL BE INSTALLED PER MANUFACTURER'S SPECIFICATION AND SHALL MEET REQUIREMENTS OF THE 2022 CMC SECTION 911.0. VERIFY ALL CLEARANCE AND INSTALLATION REQUIREMENTS PER 2022 CMC SECTION 304 PRIOR TO ORDERING OR INSTALLING EQUIPMENT.
- ATTIC FURNACES- FOR FURNACES INSTALLED IN ATTICS PROVIDE MINIMUM 30"x30" ACCESS OPENING, WITH A LEVEL PLATFORM, CONVENIENCE DUPLEX OUTLET, AND AREA LIGHT SWITCHED FROM ATTIC OPENING. SEE 2022 CMC SECTION 304.
- FOR STOVES WITH INDOOR BARBEQUE UNITS, AN EXHAUST DUCT AND FAN HAVING A MINIMUM CAPACITY OF 100CFM PER SQUARE FOOT OF HOOD INTAKE SHALL BE INSTALLED, AS WIDE AS THE UNIT AND CENTERED OVER THE UNIT, WHEN THE DUCT PENETRATES A CEILING OR FLOOR, IT SHALL BE ENCLOSED IN A FIRE-RESISTIVE SHAFT COVERED ON ONE SIDE AS REQUIRED FOR ONE-HOUR FIRE-RESISTIVE CONSTRUCTION, WITH THE DUCT SEPARATED FROM THE SHAFT WITH A MINIMUM 1" AIRSPACE, AND TERMINATE MINIMUM 18" ABOVE THE ROOF SURFACE.
- APPLIANCES DESIGNED TO BE FIXED IN POSITION SHALL BE SECURELY FASTENED IN PLACE. SUPPORT FOR APPLIANCES SHALL BE DESIGNED AND CONSTRUCTED TO SUSTAIN VERTICAL AND HORIZONTAL LOADS AS REQUIRED BY THE 2022 CMC SECTION 303.4.
- GARAGE APPLIANCE PROTECTION - GARAGE APPLIANCES WITH GLOW, SPARK, OR FLAME IGNITION SHALL HAVE IGNITER 18" ABOVE FLOOR SHALL BE PROTECTED FROM AUTO IMPACT. (2022 CMC SECTION 307)

ELECTRICAL NOTES

- ALL WORK SHALL COMPLY WITH THE 2022 CALIFORNIA ELECTRICAL CODE (CEC) AND ALL APPLICABLE FEDERAL STATE AND LOCAL JURISDICTIONAL ORDINANCES.
- ALL UNUSED AND DEMOLISHED ELECTRICAL IS TO BE REMOVED BACK TO THE NEAREST JUNCTION. NO "DEAD HOTS" TO REMAIN AFTER CONSTRUCTION. JUNCTION BOXES MUST BE ACCEPTABLE.
- ALL ELECTRICAL LOAD SHEETS AND CALCULATIONS REQUIRED BY THE BUILDING DEPARTMENT SHALL BE THE RESPONSIBILITY OF THE ELECTRICAL CONTRACTOR.
- LOW VOLTAGE OUTLETS AND WIRING TO BE COORDINATED BY THE OWNER. CONTRACTOR TO VERIFY THE LOCATION OF ALL TELEPHONE AND LOW VOLTAGE OUTLETS, WITH OWNER, PRIOR TO THE INSTALLATION OF SHEETROCK.
- ELECTRICAL OPENINGS (SWITCHES, RECEPTACLES, ETC.) ON OPPOSITE SIDES OF FIRE RATED WALLS SHALL BE MAINTAINED AT LEAST 24 INCHES APART.
- PER 2022 CEC ARTICLE 680.43(B)(1)(C)(1) AND (2), LIGHTING FIXTURES, LIGHTING OUTLETS AND FANS LOCATED OVER AN INDOOR SPA OR HOT TUB LESS THAN 7'-6" ABOVE THE MAXIMUM WATER LEVEL AND SHALL REQUIRE THE PROTECTION OF AN GROUND FAULT CIRCUIT INTERRUPTER AND INSTALLED AS FOLLOWS:
 - EXCEPTION 1: LIGHTING FIXTURES LIGHTING FIXTURES, LIGHTING OUTLETS AND FANS LOCATED 12' OR MORE ABOVE THE MAXIMUM WATER LEVEL AND SHALL NOT REQUIRE THE PROTECTION OF A GROUND FAULT CIRCUIT INTERRUPTER.
 - EXCEPTION 2: LIGHTING FIXTURES MEETING THE REQUIREMENTS OF ITEMS 'A' OR 'B' (LOW VOLTAGE) AND PROTECTED BY A GROUND FAULT CIRCUIT INTERRUPTER SHALL BE PERMITTED TO BE INSTALLED LESS THAN 7'-0" OVER A SPA OR HOT TUB
 - RECESSED FIXTURES WITH A GLASS OR PLASTIC LENS AND A NON-METALLIC OR ELECTRICALLY ISOLATED METAL RIM SUITABLE FOR USE IN DAMP LOCATIONS.
 - SURFACE MOUNTED FIXTURES WITH A GLASS OR PLASTIC GLOBE AND A NON-METALLIC BODY OR A METALLIC BODY ISOLATED FROM CONTACT AND SUITABLE FOR USE IN DAMP LOCATIONS.
- PER 2022 CEC ARTICLE 210.52(A), RECEPTACLE SPACING SHALL NOT EXCEED 12 FEET MEASURED HORIZONTALLY ALONG THE WALL. NO WALL SPACE MAY BE MORE THAN 6 FEET FROM AN OUTLET.
- PER 2022 CEC ARTICLE 210.52(C), RECEPTACLES ALONG THE COUNTER TOPS SHALL BE SPACED A MAXIMUM 2 FEET FROM THE SINK(S) AND 4 FEET ON-CENTER, ISLAND OR PENINSULA COUNTER TOPS 12 INCHES OR WIDER SHALL HAVE AT LEAST ONE RECEPTACLE FOR EACH 4 FEET OF COUNTERTOP. NO POINT OF THE WALL MAY BE MORE THAN 24 INCHES FROM AN OUTLET. KITCHEN OUTLETS SHALL BE ON AT LEAST TWO SEPARATE CIRCUITS WITH GROUND FAULT CIRCUIT INTERRUPT PROTECTION.
- PER 2022 CEC ARTICLE 210-70 AT LEAST ONE WALL-SWITCH CONTROLLED LIGHTING OUTLET SHALL BE INSTALLED IN EVERY HABITABLE ROOM, IN BATHROOMS, IN HALLWAYS, STAIRWAYS, ATTACHED GARAGES, AND DETACHED GARAGES WITH ELECTRICAL POWER, AND AT OUTDOOR ENTRANCES OR EXITS.
- VERIFY ALL FIXTURE LOCATIONS WITH OWNER PRIOR TO INSULATION. ALL RECESSED FIXTURES TO BE APPROVED BY OWNER. COORDINATE LOCATIONS OF RECESSED FIXTURES WITH FRAMING. PROVIDE OWNER AN OPPORTUNITY TO WALK AT "BOX-OUT" AND INCLUDE RELOCATIONS AS REQUESTED. DECORATIVE FIXTURES ARE TO BE SUPPLIED BY OWNER.
- ELECTRICAL SUBCONTRACTOR IS TO DETERMINE SERVICE REQUIREMENTS FOR THE NEW WORK PRIOR TO BID. VERIFY THAT EXISTING SERVICE IS SUFFICIENT TO HANDLE INCREASED LOADS. LOCATE NEW SUBPANELS AS DIRECTED BY OWNER. ALL CIRCUIT PANELS ARE TO BE LABELED.
- RESIDENTIAL LIGHTING SHALL COMPLY WITH FORM CF-6R-LTG-01. INSTALLER IS RESPONSIBLE FOR COMPLIANCE AND CERTIFICATION. FIXTURE TYPE, LOCATION, AND SWITCHING LOCATIONS ONLY ARE NOTED ON THESE PLANS. TITLE 24-6 REQUIREMENTS MUST BE MET INDIVIDUALLY FOR EACH INSTALLATION, SPECIFIC TO EACH DEVICE, CONTROL, AND LOCATION.

GENERAL NOTES

Project No:
2549

Sheet No:

T-1.1

2 of 11

WARREN DESIGN

879 E. CAMPBELL AVE., CAMPBELL, CA 95008 P. 650.469.3780


[Signature]

SAN JUAN RESIDENCE - LOT C
NEW RESIDENCE
1907 SAN JUAN ROAD
AROMAS
CALIFORNIA



Date: 08/18/2025

Drawn By: DW

Revisions:




TOPOGRAPHIC MAPPING BASED UPON A FIELD SURVEY BY DATED 2-16-21, NAVD 1988 DATUM. BOUNDARY LINES COMPILED FROM RECORD INFORMATION. THIS IS NOT A BOUNDARY SURVEY.

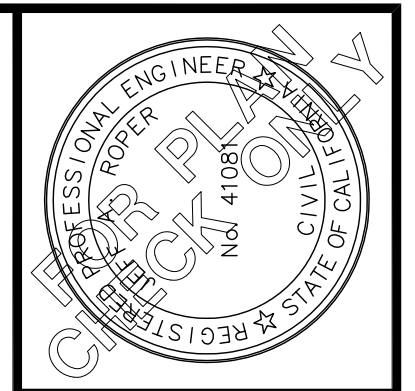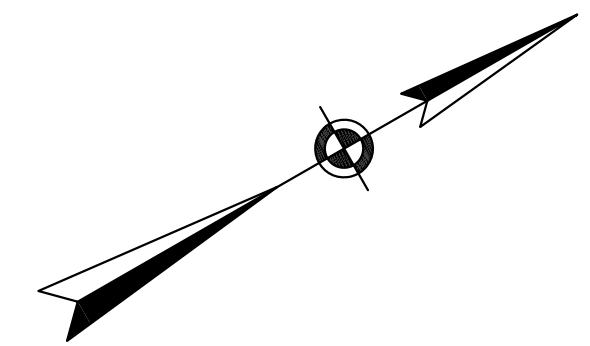


UNLESS SIGNED BY THE ENGINEER, THIS PLAN IS FOR REFERENCE ONLY. THE SIGNED PLAN IS THE ONLY PLAN TO BE USED FOR CONSTRUCTION.

ROPER ENGINEERING
CIVIL ENGINEERING & LAND SURVEYING
 48 MANN AVENUE CORRALITOS, CA 95076
 (831) 724-5300 jeff@roperengineering.com

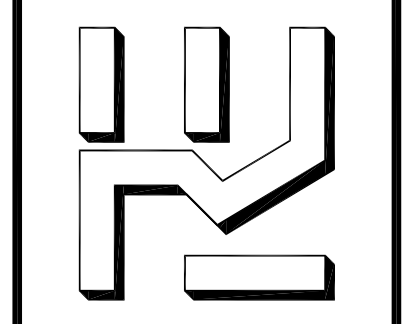


NEW RESIDENCE FOR KAMILAH DEYN DEVELOPMENT LLC
 1907 SAN JUAN ROAD ROYAL OAKS APN 267-041-022
CIVIL SITE PLAN

SCALE: AS NOTED
 DESIGNED BY: JR
 DRAWN BY: JR
 DATE: SEPT. 7, 2021
 REVISED: FEB. 13, 2025
 JOB NO.: 21006
 SHEET
C1
 OF 5 SHEETS

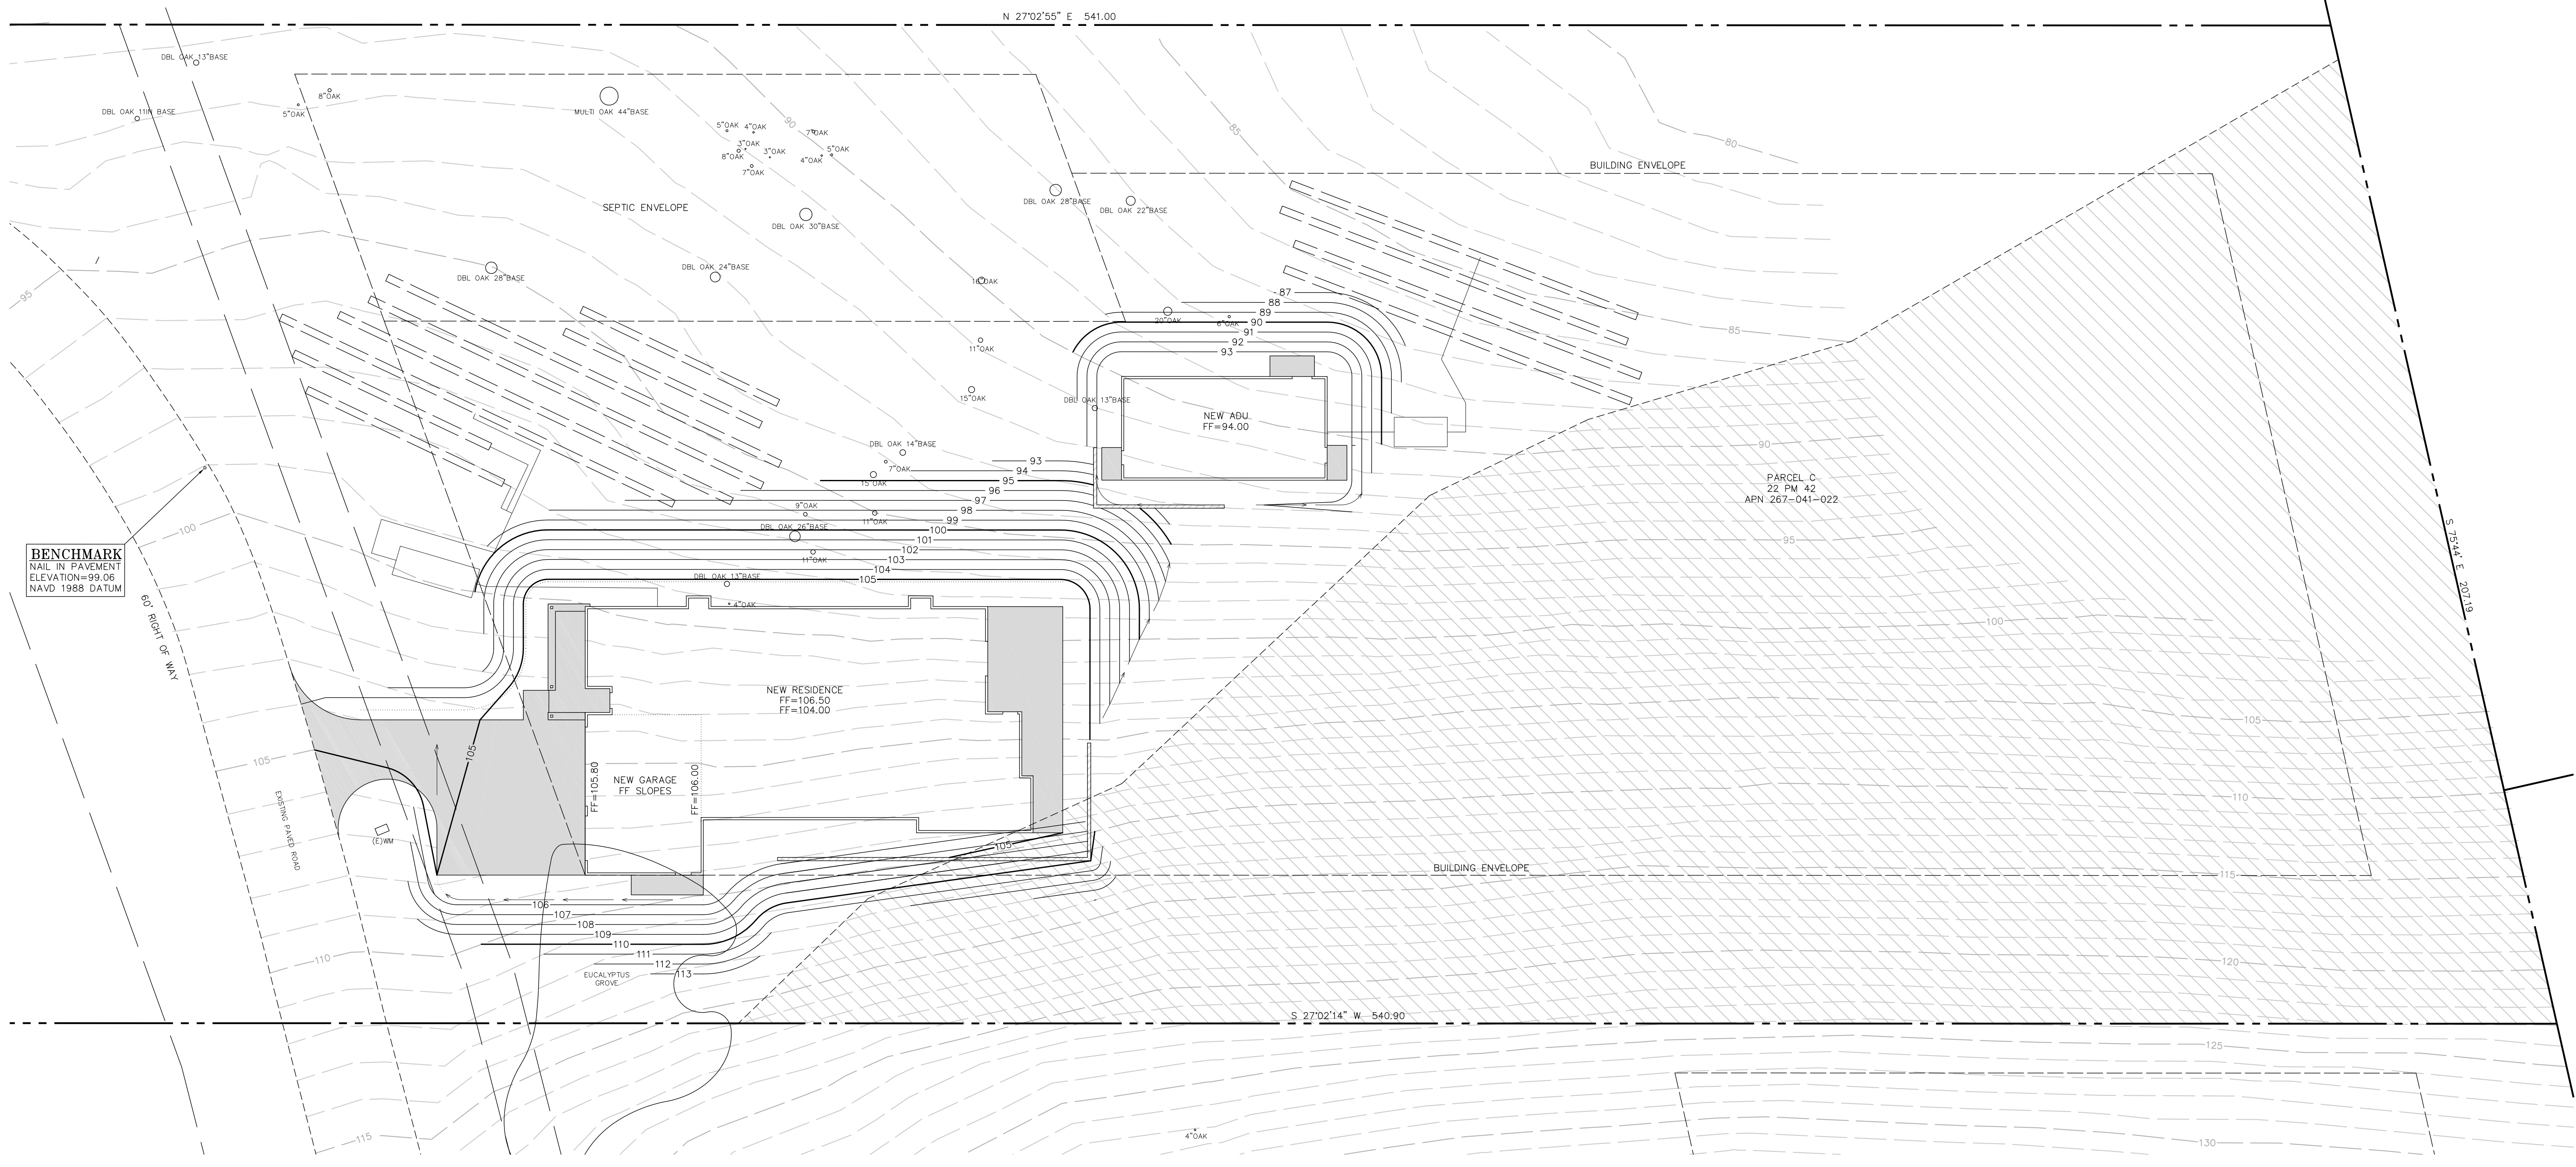

BENCHMARK
 NAIL IN PAVEMENT
 ELEVATION=99.06
 NAVD 1988 DATUM

CIVIL SITE PLAN

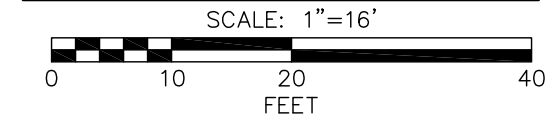

ESTIMATED EARTHWORK
 STRIPPINGS : 200 ± C.Y.
 EXCAVATION : 950 ± C.Y.
 FILL : 950 ± C.Y.


IMPERVIOUS SURFACES
 NEW BUILDINGS : 4889 SF
 NEW ASPHALT : 6024 SF
 NEW CONCRETE : 2205 SF
 TOTAL : 10118 SF

25% SLOPES
 TOTAL PARCEL AREA : 109,336 SF
 TOTAL AREA > 25% SLOPE : 38,419 SF
 TOTAL GRADING AREA : 15,613 SF
 > 25% SLOPE W/IN GRADING LIMITS : 1,357 SF
 GRADING IN AREA > 25% SLOPE : 8.7%

LEGEND


- NEW CONCRETE
- NEW ASPHALT CONCRETE
- AREA OVER 25% SLOPE
- EXISTING CONTOUR
- FINISH CONTOUR
- EXISTING GRADE
- FINISH GRADE
- FLOWLINE
- FENCE
- PROPERTY LINE
- NEW RETAINING WALL

ITEM	INSPECTED BY	WHEN	INSPECTED BY	DATE
1 Pre-Grading Meeting/Retrieve Soil Sample	Geotechnical Engineer/Representative	Prior to Start of Grading		
2 Fill/Out Slope Construction				
-Observe Keyway Excavation	Geotechnical Engineer/Representative	When Excavated, Prior to Placing Fill		
-Test Fill Material	Geotechnical Engineer/Representative	On Going		
-Observe Cut Slopes for Compliance with Gradients		When Excavated		
3 Building Pad Preparation				
-Observe Bottom of Over-Excavation at Building Pad	Geotechnical Engineer/Representative	When Excavated, Prior to Placing Fill		
-Observe Stabilization Fabric Placement	Geotechnical Engineer/Representative	Prior to Placing Fill		
-Observe and Test Fill Material	Geotechnical Engineer/Representative	On Going		
-Observe Foundation Excavations at Structure	Geotechnical Engineer/Representative	Prior to Placing Reinforcement		
4 Retaining Wall Construction				
-Observe Foundation Excavations	Geotechnical Engineer/Representative	Prior to Placing Reinforcement		
-Observe Retaining Wall Drain and Outlet	Geotechnical Engineer/Representative	After Pipe is in Place, Prior to Backfilling		
-Observe and Test Retaining Wall Backfill	Geotechnical Engineer/Representative	During Fill Placement, On Going		
-Observe Subdrain Construction	Geotechnical Engineer/Representative	After Pipe is in Place, Prior to Backfilling		
5 Driveway Construction				
-Observe Overexcavation	Geotechnical Engineer/Representative	When Excavated, Prior to Placing Fill		
-Test Subgrade	Geotechnical Engineer/Representative	During Fill Placement and Prior to Placing Basecourse		
-Test Basecourse	Geotechnical Engineer/Representative	Immediately After Compaction, Prior to Paving		
6 Utility Trenches				
-Test trench backfill	Geotechnical Engineer/Representative	On going		
8 Site Drainage	Geotechnical Engineer/Representative	Prior to Final		

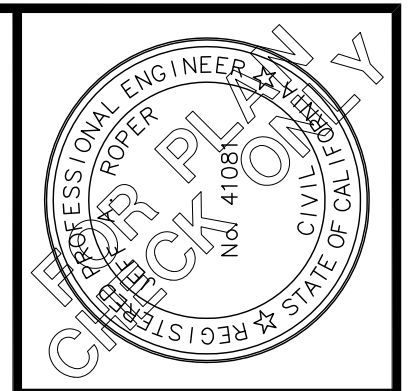

UNLESS SIGNED BY THE ENGINEER, THIS PLAN IS FOR REFERENCE ONLY. THE SIGNED PLAN IS THE ONLY PLAN TO BE USED FOR CONSTRUCTION.

ROPER ENGINEERING
CIVIL ENGINEERING & LAND SURVEYING
48 MANN AVENUE CORRALITOS, CA 95076
(831) 724-5300 jeff@roperengineering.com

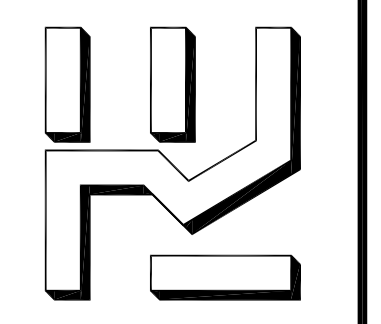


**NEW RESIDENCE FOR
KAMILAH DEYN DEVELOPMENT LLC**
1907 SAN JUAN ROAD ROYAL OAKS APN 267-041-022
GRADING & DRAINAGE PLAN


SCALE:	AS NOTED
DESIGNED BY:	JR
DRAWN BY:	JR
DATE:	SEPT. 7, 2021
REVISED:	FEB. 13, 2025
JOB NO.:	21006
SHEET	


C2

OF 5 SHEETS

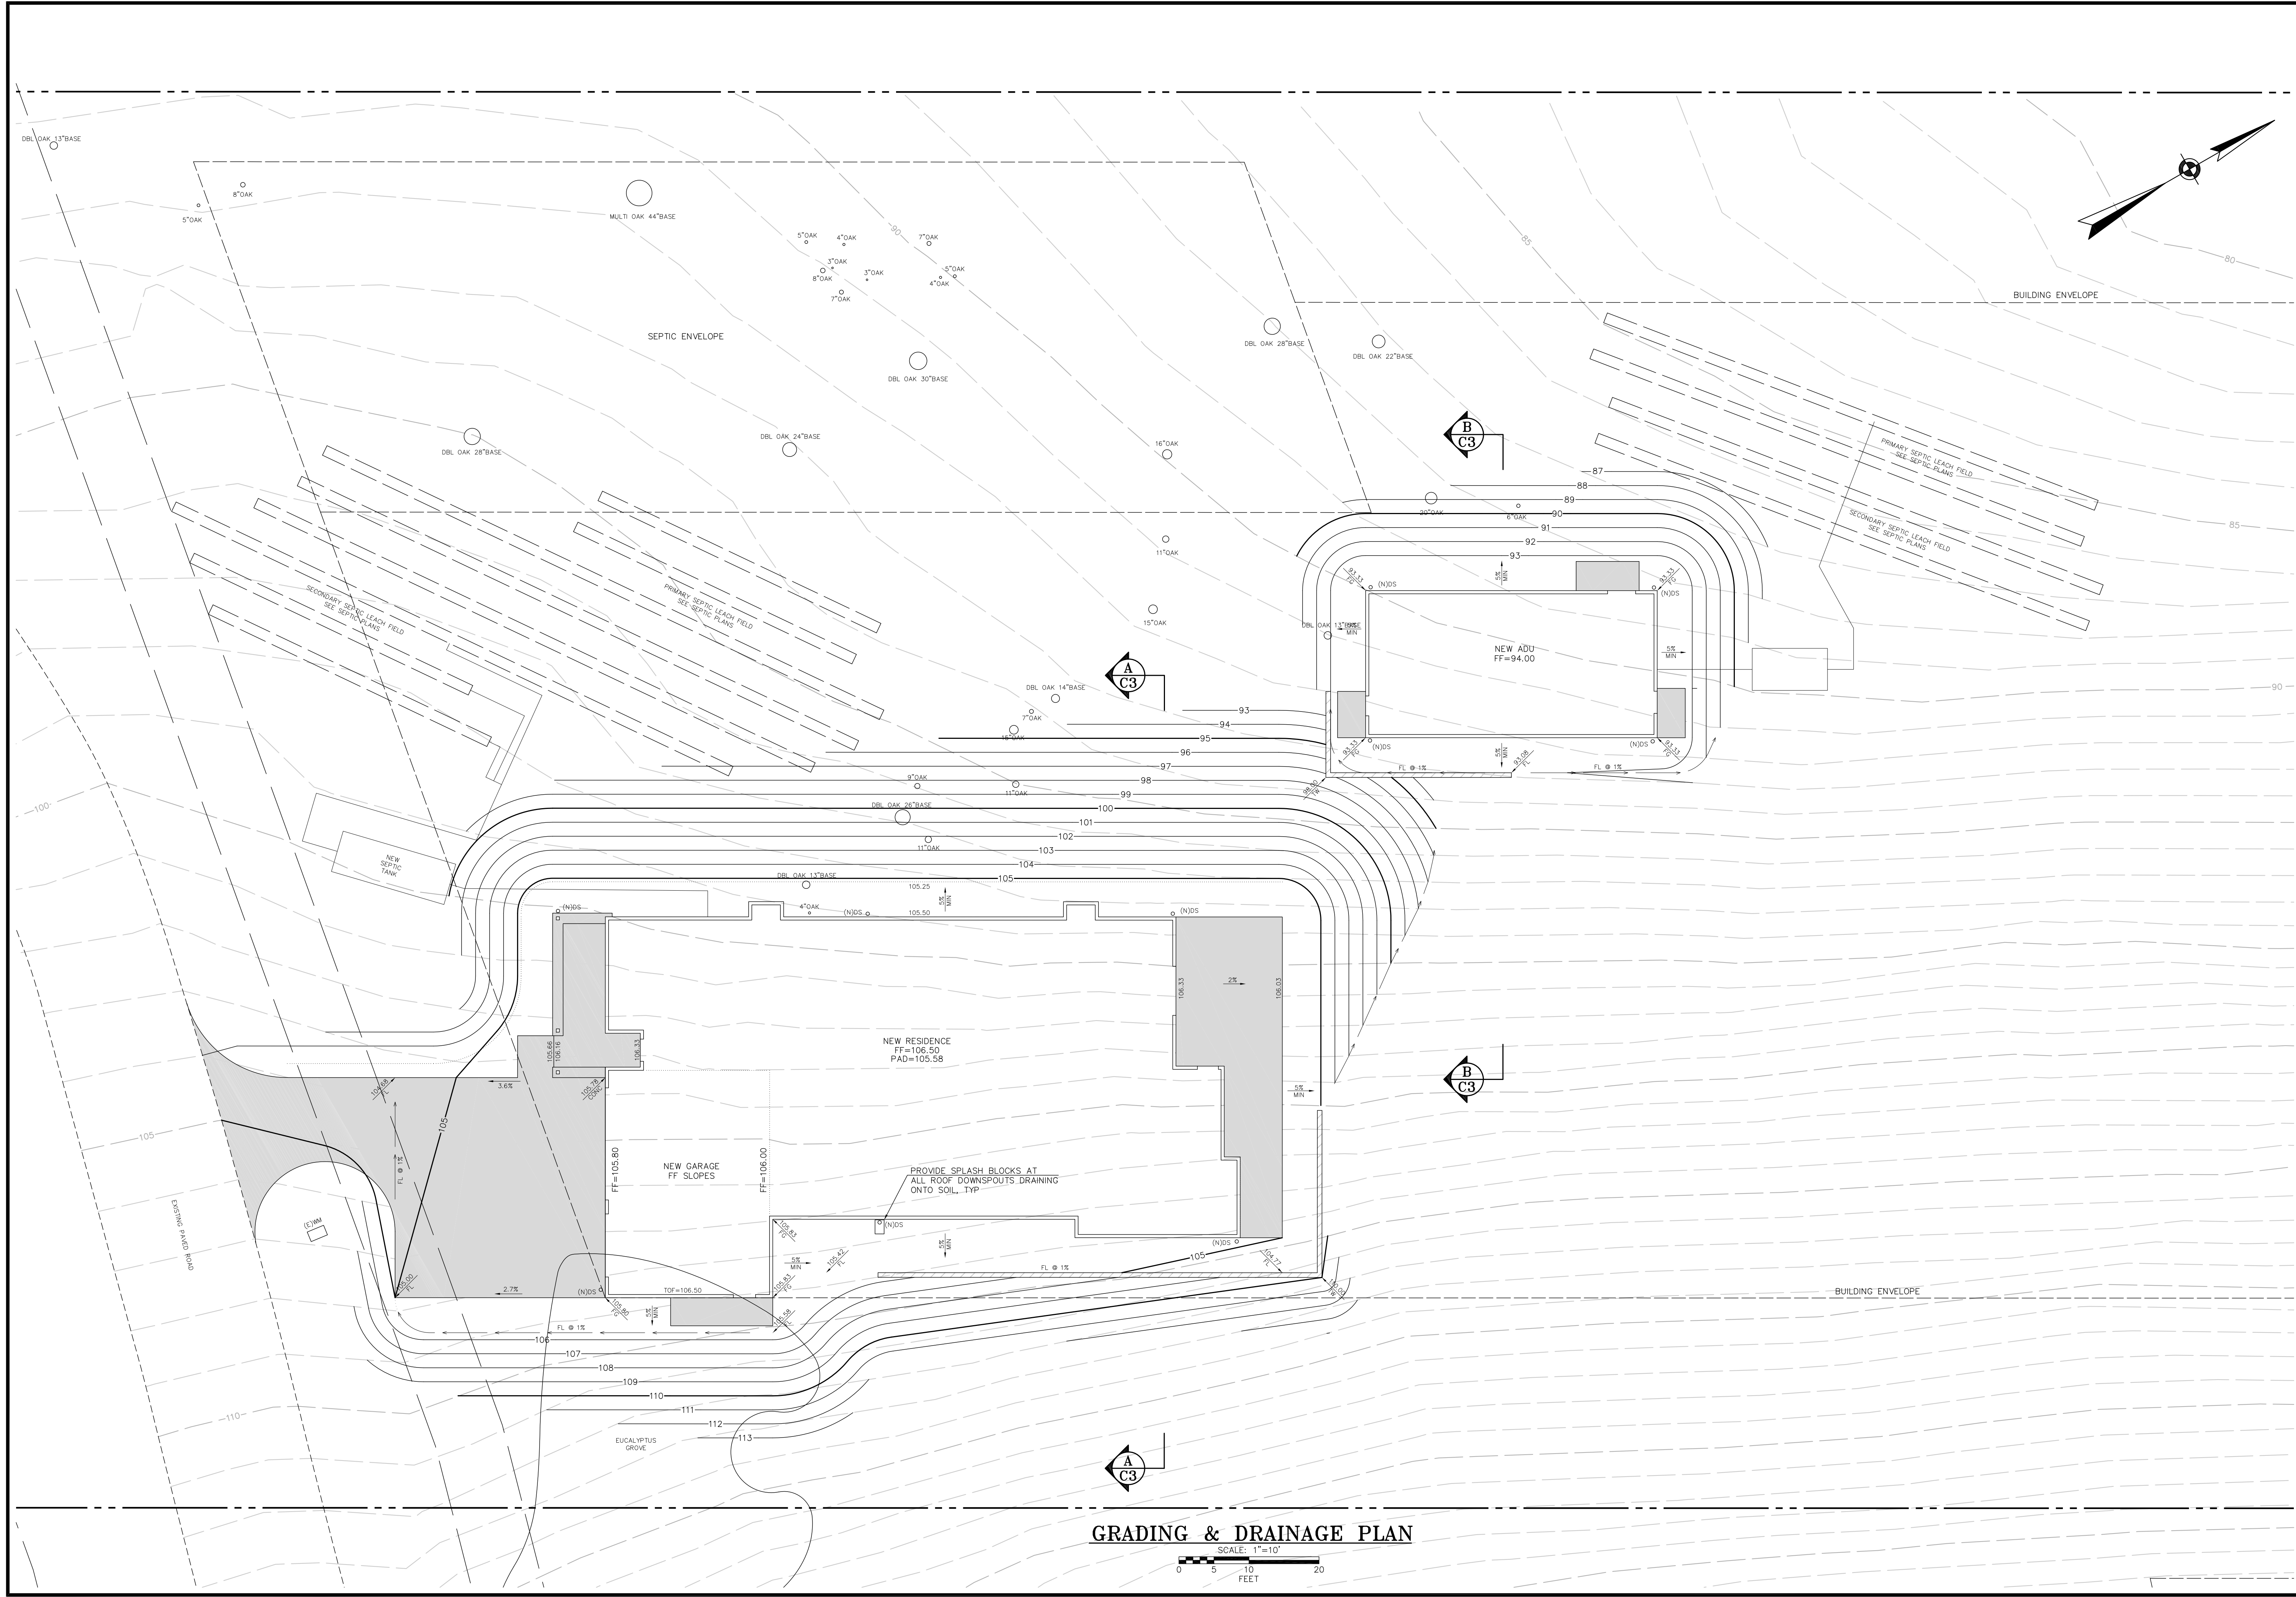


GRADING & DRAINAGE PLAN



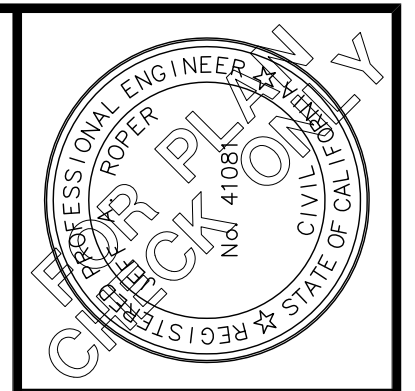


UNLESS SIGNED BY THE ENGINEER, THIS PLAN IS FOR REFERENCE ONLY. THE SIGNED PLAN IS THE ONLY PLAN TO BE USED FOR CONSTRUCTION.


ROPER ENGINEERING
CIVIL ENGINEERING & LAND SURVEYING
 48 MANN AVENUE CORRALITOS, CA 95076
 (831) 724-5300 jeff@roperengineering.com

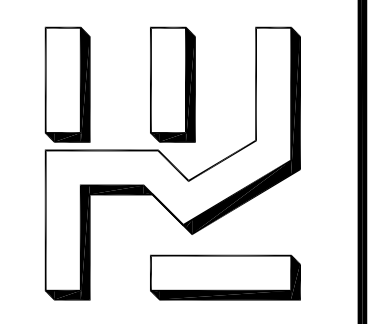

NEW RESIDENCE FOR
KAMILAH DEYN DEVELOPMENT LLC
 1907 SAN JUAN ROAD ROYAL OAKS APN 267-041-022
CIVIL SITE PLAN

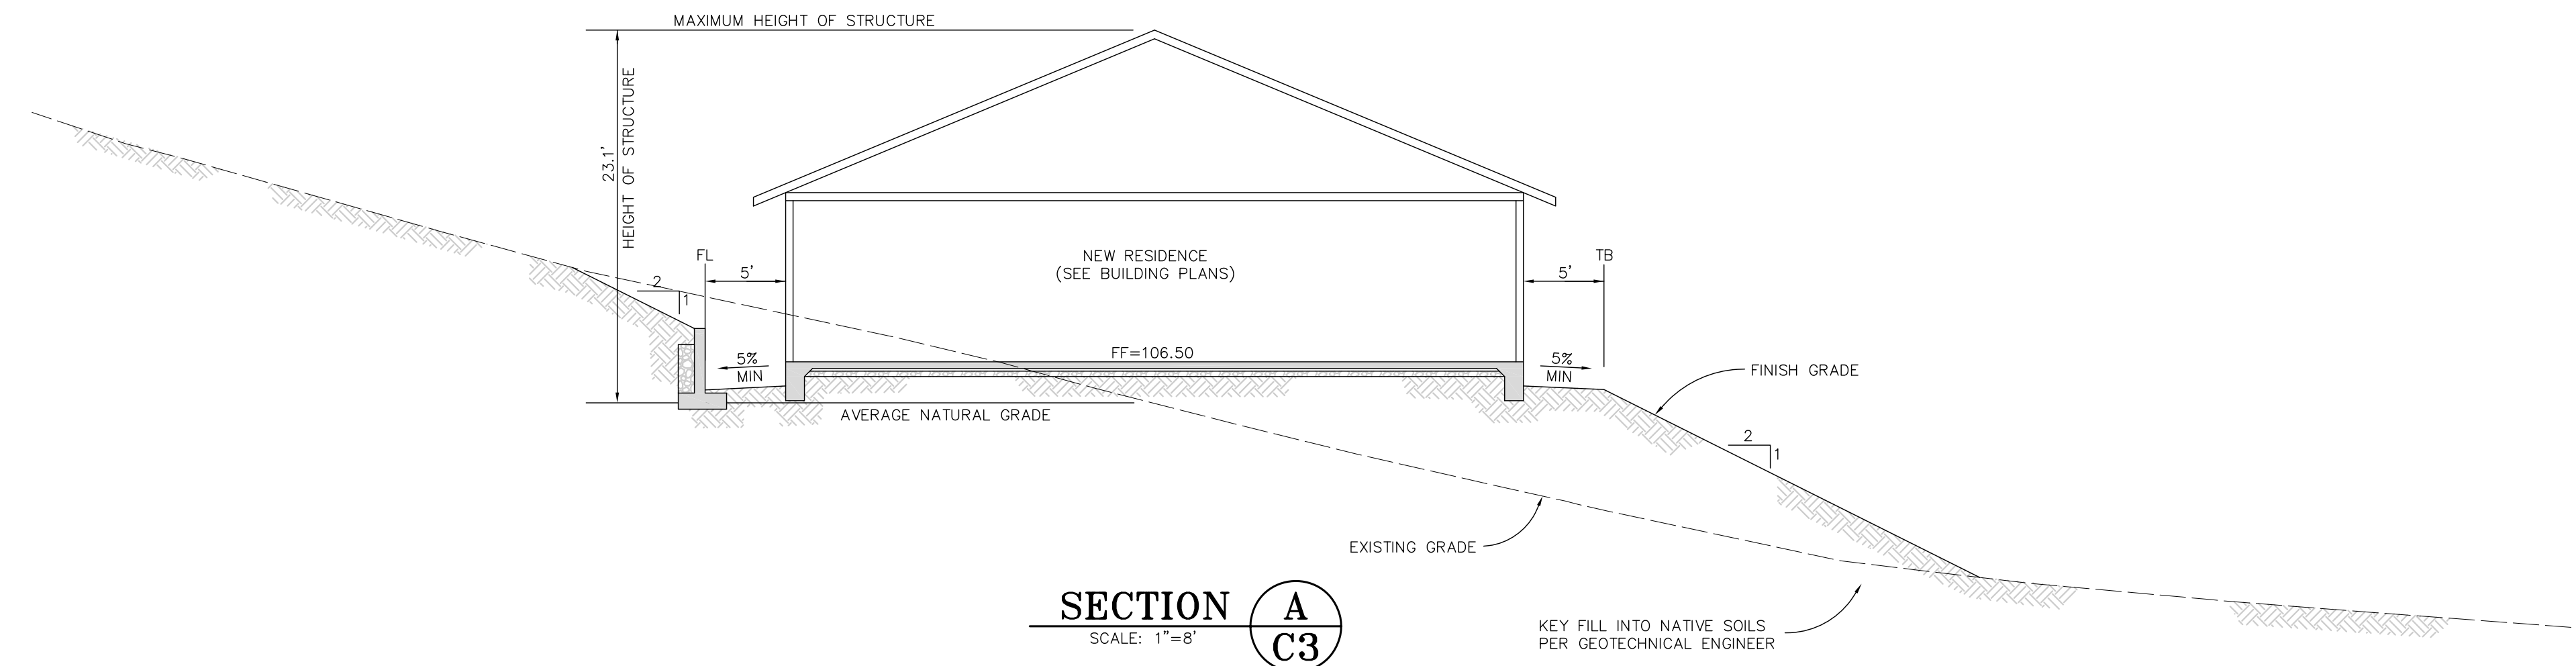

SECTION A
 SCALE: 1"=8'
 C3

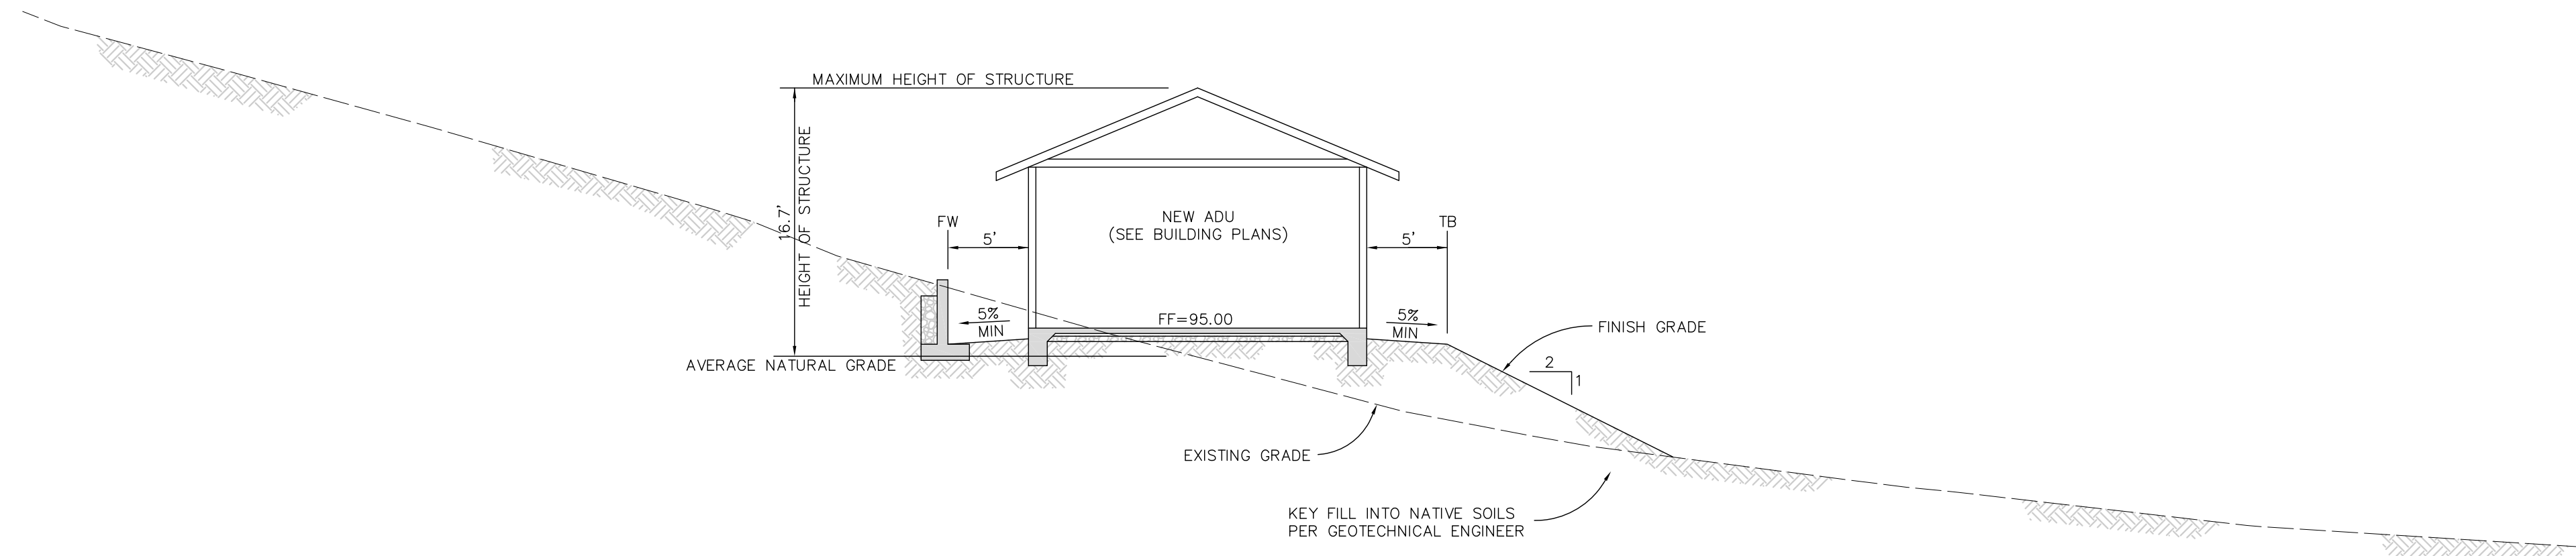


SECTION B
 SCALE: 1"=8'
 C3

GRADING NOTES

- UNDERGROUND UTILITIES SHOWN ARE APPROXIMATE, VERIFICATION IS THE RESPONSIBILITY OF THE CONTRACTOR. PRIOR TO EXCAVATION, CONTRACTOR SHALL LOCATE ALL EXISTING UNDERGROUND UTILITIES. CALL 811 TO HAVE UTILITIES LOCATED AND MARKED.
- VEGETATION, ROOTS AND DELETERIOUS MATERIALS SHALL BE REMOVED FROM AREA TO BE GRADED PRIOR TO GRADING.
- CUT SLOPES SHALL BE NO STEEPER THAN 2 HORIZONTAL TO 1 VERTICAL IN NATIVE MATERIAL AS DETERMINED BY THE ENGINEER.
- FILL SLOPES SHALL BE NO STEEPER THAN 2 HORIZONTAL TO 1 VERTICAL.
- FILL SHALL BE COMPACTED TO 90% RELATIVE COMPACTION UNLESS OTHERWISE NOTED. SEE GEOTECHNICAL INVESTIGATION FOR FURTHER SPECIFICATIONS.
- AFTER GRADING, SPREAD TOPSOIL FROM STRIPPINGS ON SLOPES AND LANDSCAPED AREAS 3" TO 6" DEEP.
- BETWEEN OCTOBER 15 AND APRIL 15, EXPOSED SOIL SHALL BE PROTECTED FROM EROSION AT ALL TIMES. DURING CONSTRUCTION SUCH PROTECTION MAY CONSIST OF MULCHING AND/OR PLANTING OF NATIVE VEGETATION OF ADEQUATE DENSITY. BEFORE COMPLETION OF THE PROJECT, ANY EXPOSED SOIL ON DISTURBED SLOPES SHALL BE PERMANENTLY PROTECTED FROM EROSION.
- CUT AND FILL SLOPES SHALL BE PLANTED WITH ANNUAL RYE GRASS (40 LBS/ACRE) AND MULCHED WITH COMPOST.
- CONCRETE IN DRIVEWAYS SHALL HAVE A COMPRESSIVE STRENGTH OF 2500 PSI @ 28 DAYS.
- THE UPPER 6 INCHES OF SUBGRADE IN DRIVEWAY AREAS SHALL BE COMPACTED TO 95% RELATIVE COMPACTION. SEE GEOTECHNICAL INVESTIGATION FOR FURTHER SPECIFICATIONS.
- AGGREGATE BASE SHALL BE CLASS 2 IN CONFORMANCE WITH SECTION 26 OF THE STATE OF CALIFORNIA STANDARD SPECIFICATIONS.
- CONSTRUCTION CONTRACTOR AGREES THAT IN ACCORDANCE WITH GENERALLY ACCEPTED CONSTRUCTION PRACTICES, CONSTRUCTION CONTRACTOR WILL BE REQUIRED TO ASSUME SOLE AND COMPLETE RESPONSIBILITY FOR JOB SITE CONDITIONS DURING THE COURSE OF CONSTRUCTION OF THE PROJECT, INCLUDING SAFETY OF ALL PERSONS AND CONDITIONS DURING THE COURSE OF CONSTRUCTION OF THE PROJECT, INCLUDING SAFETY OF ALL PERSONS AND PROPERTY, AND THAT THIS REQUIREMENT SHALL BE MADE TO APPLY CONTINUOUSLY AND NOT BE LIMITED TO NORMAL WORKING HOURS.
- THE GEOTECHNICAL INVESTIGATION PREPARED BY SOIL SURVEYS GROUP INC. FOR SHAWKI DEYN PROPERTIES LLC DATED APRIL 2, 2021. JOB #7794 SHALL BE STRICTLY ADHERED TO DURING THE GRADING AND CONSTRUCTION OF THIS PROJECT.


SCALE:	AS NOTED
DESIGNED BY:	JR
DRAWN BY:	JR
DATE:	SEPT. 7, 2021
REVISED:	FEB. 13, 2025
JOB NO.:	21006
SHEET	

C3

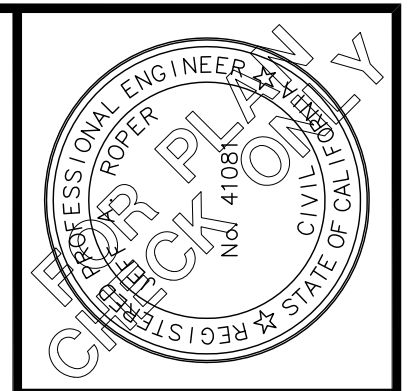

UNLESS SIGNED BY THE ENGINEER, THIS PLAN IS FOR REFERENCE ONLY. THE SIGNED PLAN IS THE ONLY PLAN TO BE USED FOR CONSTRUCTION.



ROPER ENGINEERING
CIVIL ENGINEERING & LAND SURVEYING
48 MANN AVENUE CORRALITOS, CA 95076
(831) 724-5300 jeff@roperengineering.com

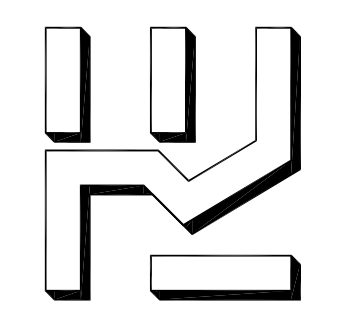


NEW RESIDENCE FOR
KAMILAH DEYN DEVELOPMENT LLC
1907 SAN JUAN ROAD ROYAL OAKS APN 267-041-022
EROSION CONTROL PLAN


SCALE:	AS NOTED
DESIGNED BY:	JR
DRAWN BY:	JR
DATE:	SEPT. 7, 2021
REVISED:	FEB. 13, 2025
JOB NO.:	21006
SHEET	

C4

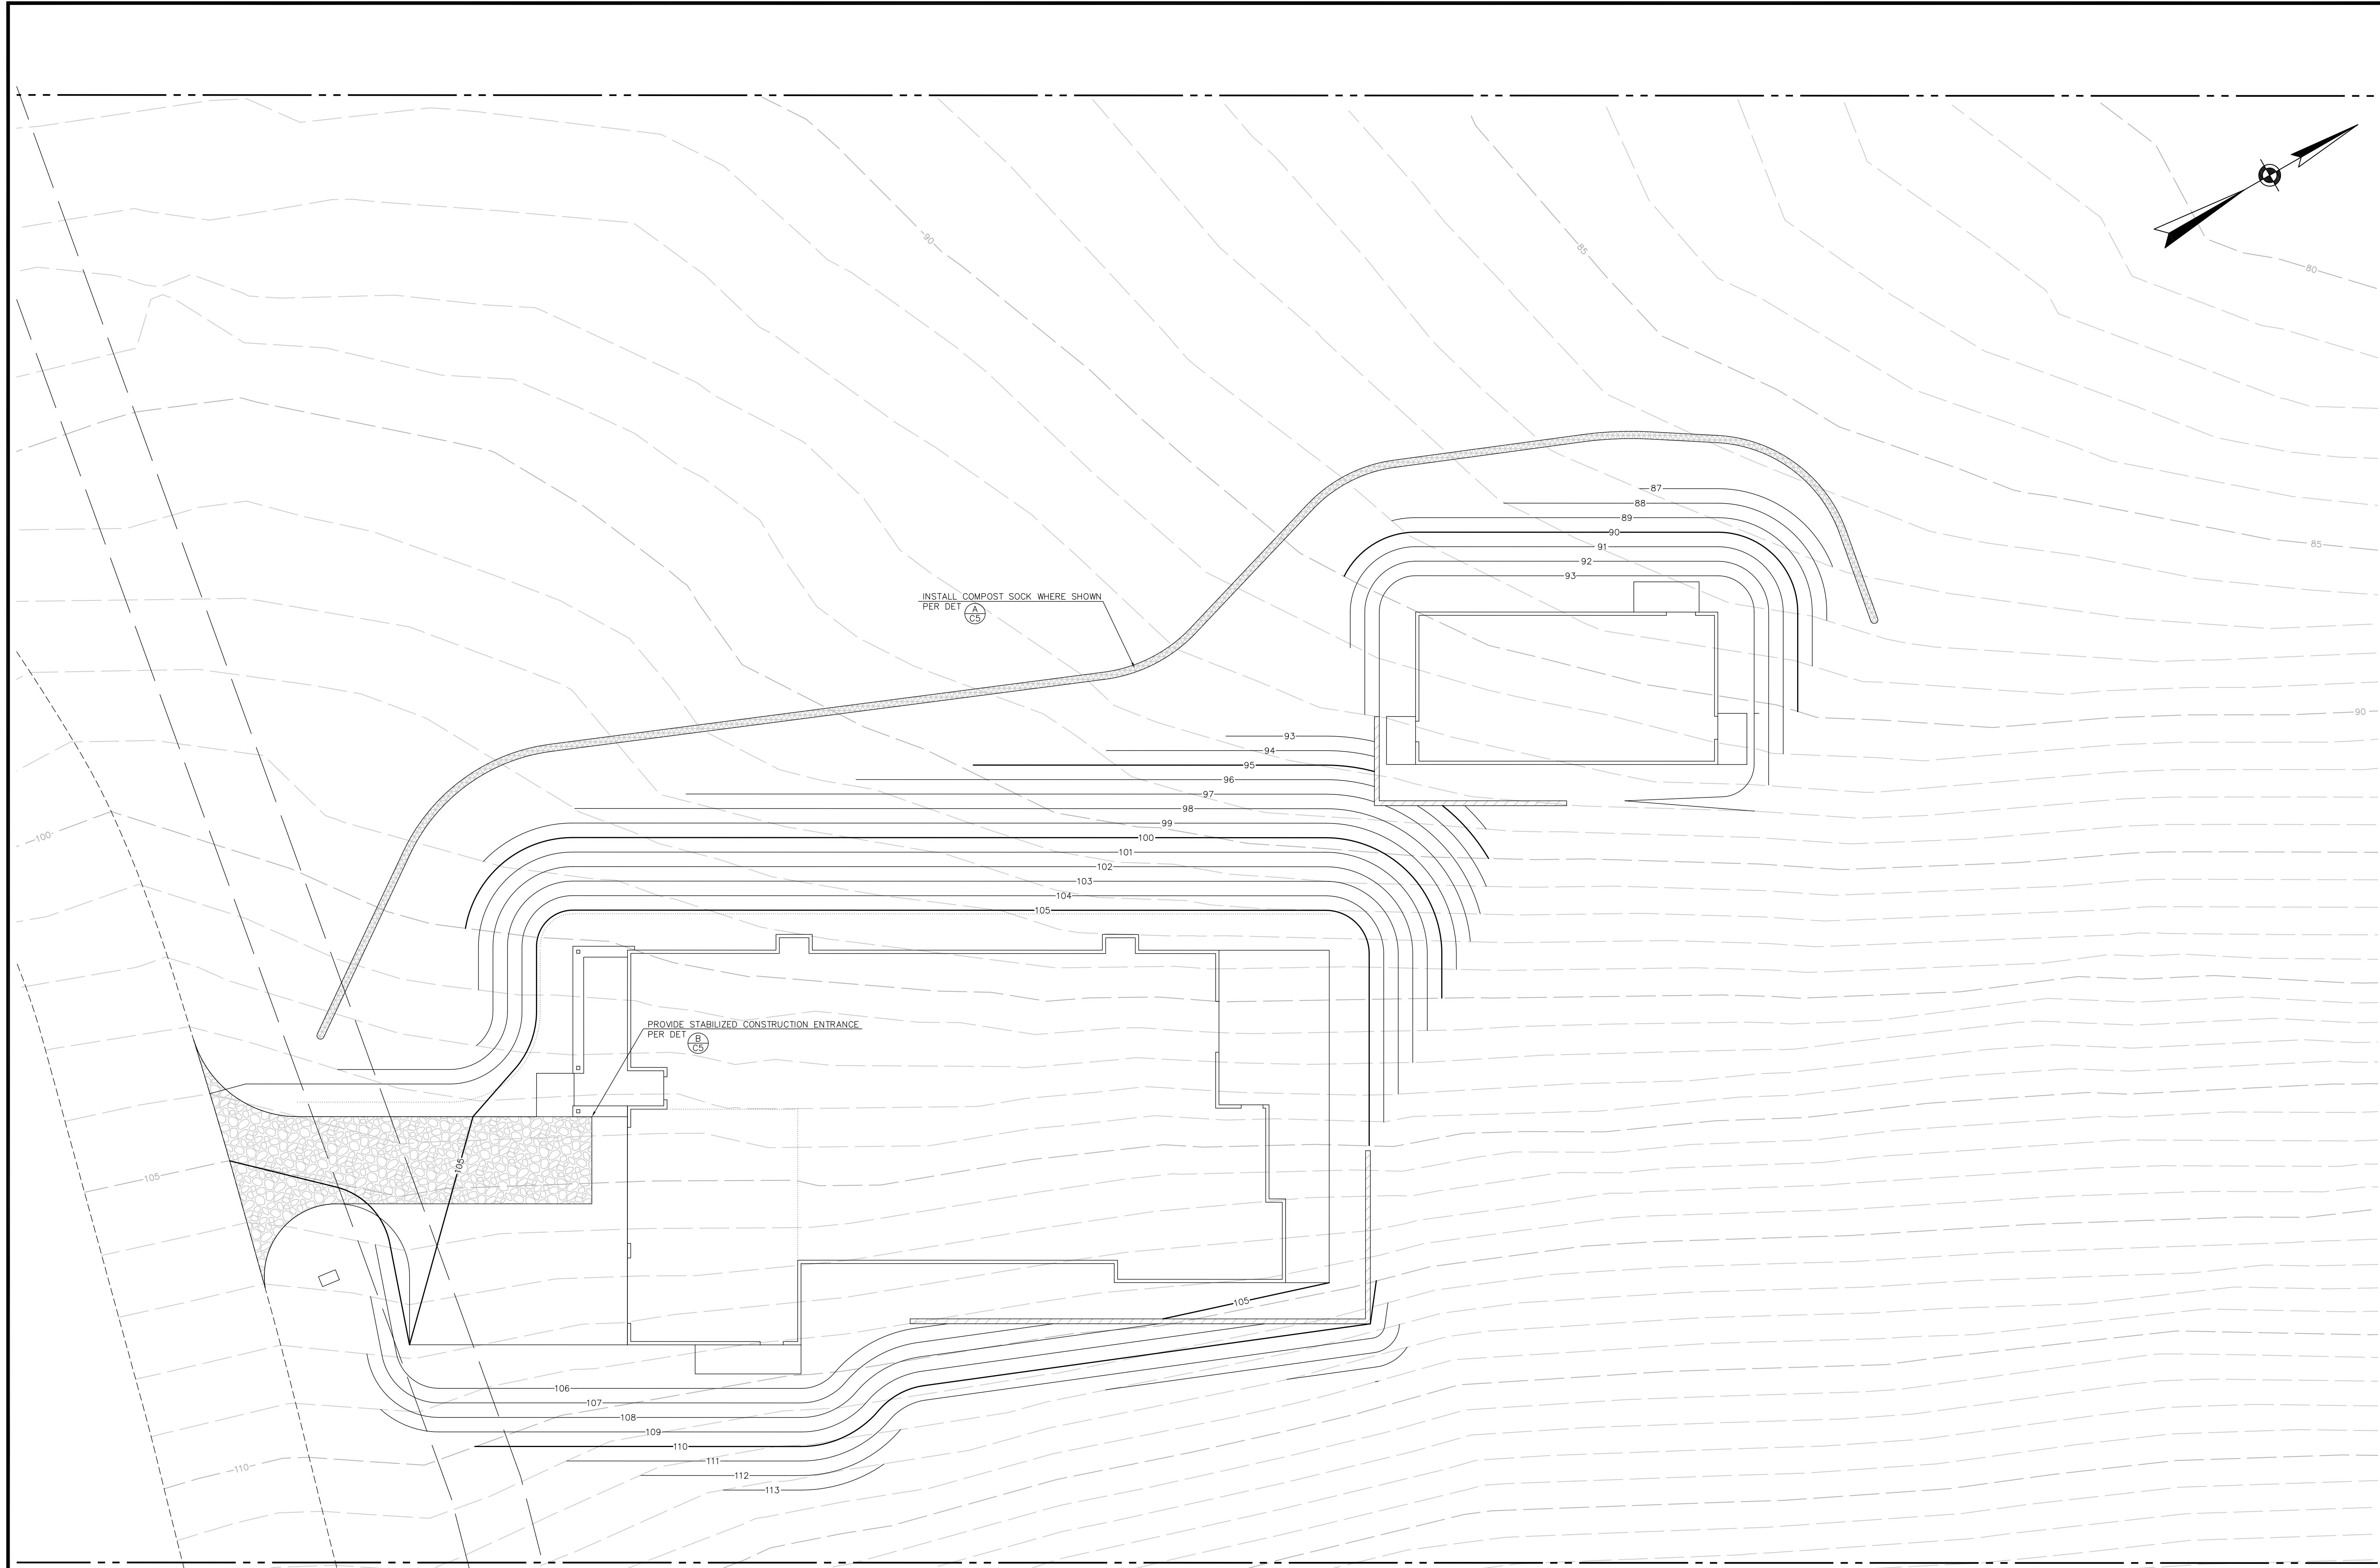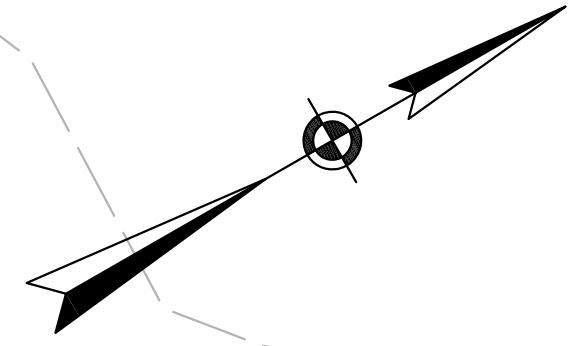


EROSION CONTROL PLAN



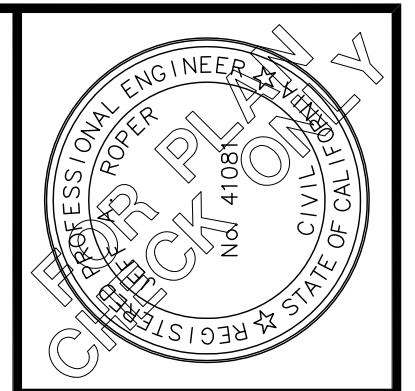


UNLESS SIGNED BY THE ENGINEER, THIS PLAN IS FOR REFERENCE ONLY. THE SIGNED PLAN IS THE ONLY PLAN TO BE USED FOR CONSTRUCTION.


ROPER ENGINEERING
CIVIL ENGINEERING & LAND SURVEYING
 48 MANN AVENUE CORRALITOS, CA 95076
 (831) 724-5300 jeff@roperengineering.com

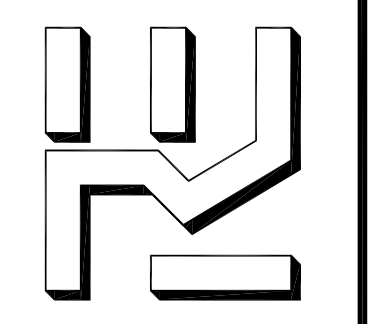

NEW RESIDENCE FOR
KAMILAH DEYN DEVELOPMENT LLC
 1907 SAN JUAN ROAD ROYAL OAKS APN 267-041-022
EROSION CONTROL DETAILS & NOTES

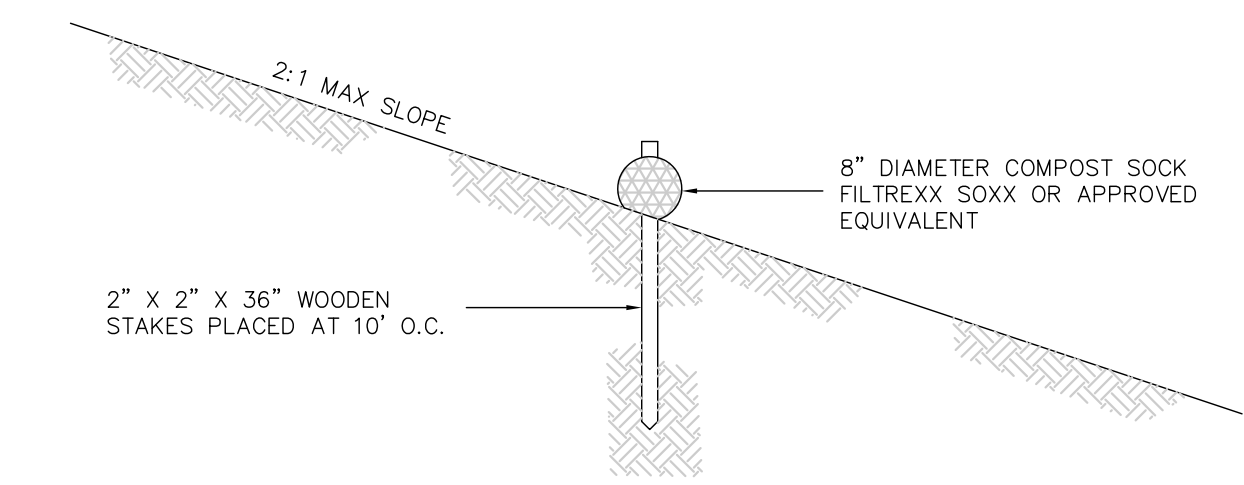

COMPOST SOCK DETAIL (A)
 SCALE: 1"=2'

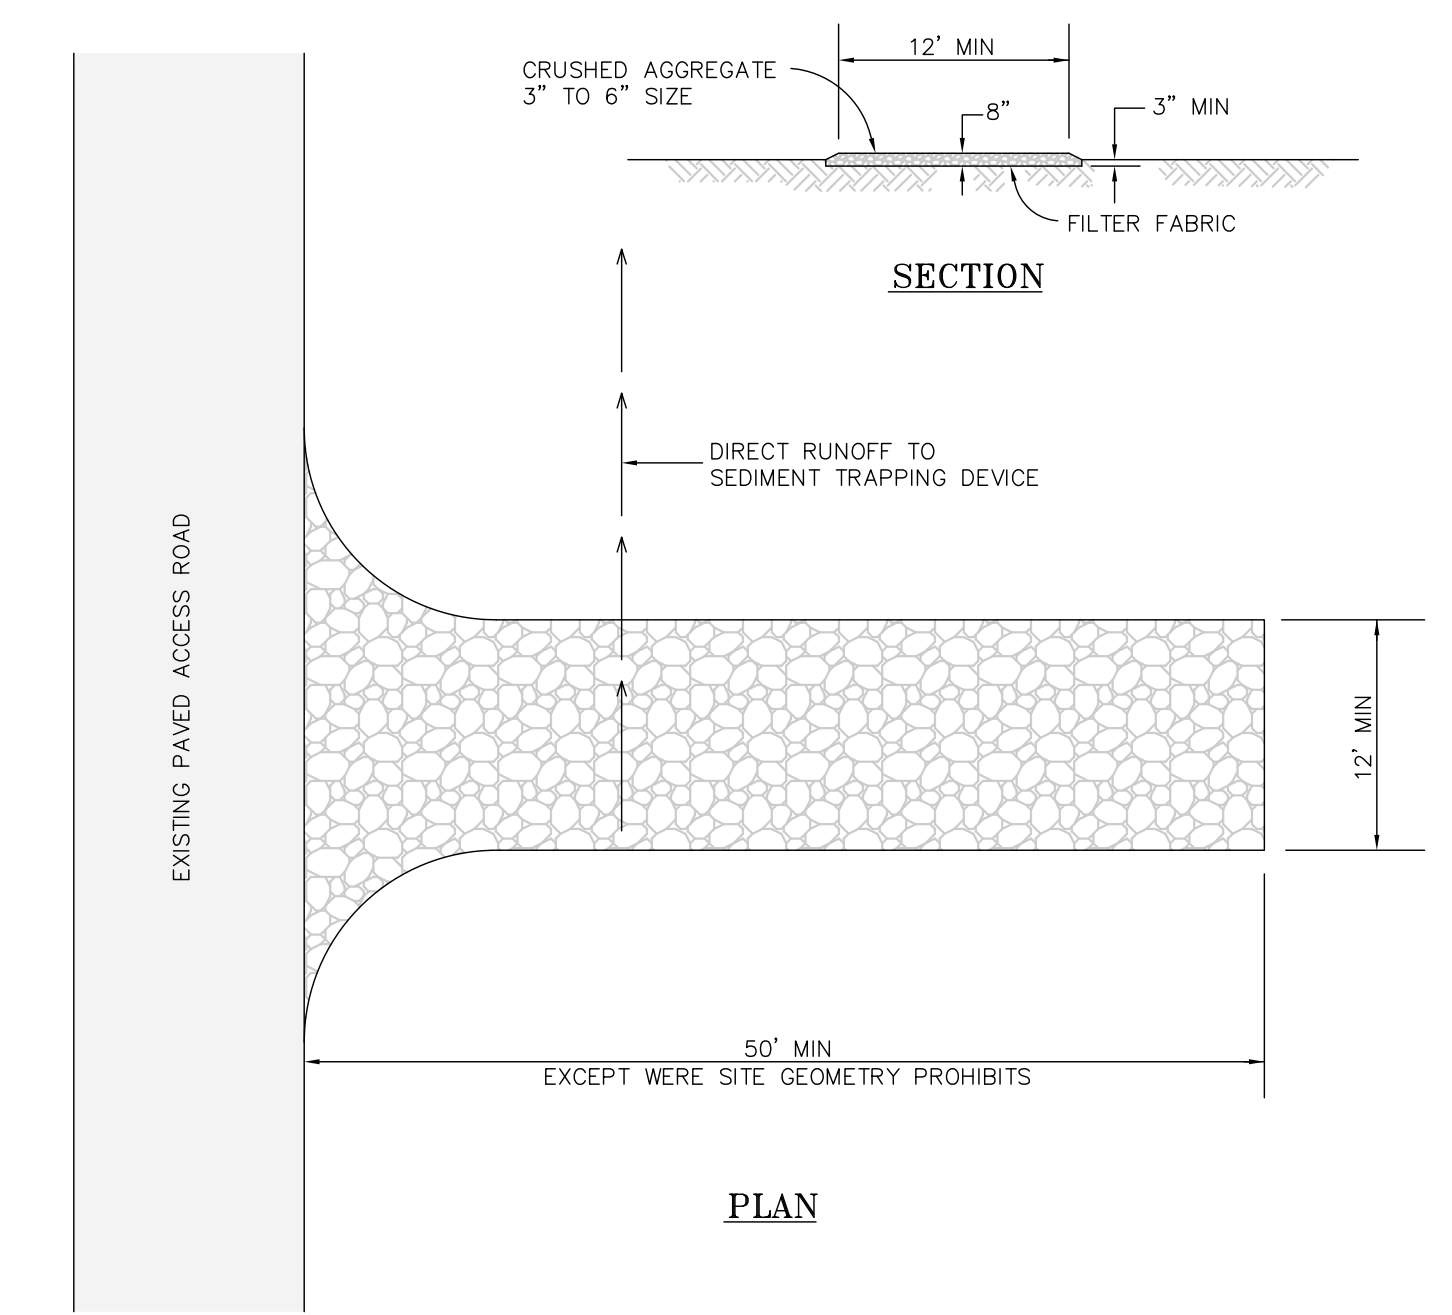

STABILIZED CONSTRUCTION ENTRANCE (B)
 SCALE: 1"=10'

DUST CONTROL NOTES

1. THE PROJECT APPLICANT AND/OR CONTRACTOR SHALL BE RESPONSIBLE FOR IMPLEMENTING THE DUST CONTROL MEASURES THROUGHOUT THE DURATION OF GRADING.
2. WATER TRUCKS OR SPRINKLER SYSTEMS SHALL BE USED IN SUFFICIENT QUANTITIES TO PREVENT AIRBORNE DUST FROM LEAVING THE SITE. INCREASED WATERING FREQUENCY SHALL BE REQUIRED WHENEVER WIND SPEEDS EXCEED 15 MPH. RECLAIMED (NON-POTABLE) WATER SHALL BE USED WHENEVER POSSIBLE.
3. THE PROJECT APPLICANT SHALL MAINTAIN A 15 MPH SPEED LIMIT ON ROADS WHERE WATER APPLICATION IS THE SOLE FORM OF DUST CONTROL, AND SHALL POST SIGNS TO REMIND WORKERS THROUGHOUT THE WORK AREAS. THE PROJECT APPLICANT SHALL MONITOR TO ENSURE COMPLIANCE WITH THE SPEED LIMIT.
4. WATER TRUCK OPERATIONS SHALL ADJUST THEIR SPRAYING METHODS ACCORDING TO THE CONDITIONS. FOR EXAMPLE, DURING WINDY CONDITIONS TRUCKS SHOULD POINT THE WATER SPRAY DOWNWARD. IN SILTY SOILS, TRUCKS SHOULD USE LIGHT FRONT SPRAY FOLLOWED BY THE HEAVIER BACK SPRAY. IN CLAY SOILS, A HEAVY SPRAY IS APPLIED WELL BEFORE TRAFFIC IS EXPECTED IN THE AREA.
5. WHERE ACCESS BY WATER TRUCKS IS LIMITED BY STRUCTURES OR CONDITIONS, HAND-OPERATED WATER TANKS (I.E. WATER BUFFALOS) SHALL BE USED TO PROVIDE DUST CONTROL. HAND-OPERATED WATER TANKS CAN BE USED TO APPLY WATER DIRECTLY TO THE WORK AREA BY CREW MEMBERS.
6. HEAVY CONSTRUCTION EQUIPMENT TRAVELING ON DIRT ROADS ON THE PROJECT SITE SHALL BE PRECEDED BY A WATER TRUCK TO DAMPEN ROADWAYS AND REDUCE DUST FROM TRANSPORTATION ALONG ON-SITE DIRT ROADS.
7. ALL DIRT STOCK PILE AREAS SHALL BE SPRAYED DAILY AS NEEDED.
8. INSTALL TRACK-OUT CONTROL DEVICES WHERE VEHICLES ENTER AND EXIT UNPAVED ROADS ONTO STREETS, OR WASH OFF TRUCKS AND EQUIPMENT LEAVING THE SITE.
9. SWEEP PAVED/UNPAVED ROADWAYS BOUNDARIES (E.G. PROJECT ENTRANCE ROADWAYS) AT THE END OF EACH DAY IF VISIBLE SOIL MATERIAL IS CARRIED ONTO ADJACENT PAVED ROADS. WATER SWEEPERS WITH RECLAIMED WATER SHALL BE USED WHERE FEASIBLE.


EROSION CONTROL NOTES

1. PROTECT AND PRESERVE TOPSOIL TO MINIMIZE EROSION AND RETAIN INFILTRATION CAPACITY.
2. MINIMIZE LAND DISTURBANCE SUCH AS CUTS AND FILLS. STABILIZE SLOPES AND ALL DISTURBED AREAS AS SOON AS GRADING IS FINISHED OR CUT-AND-FILLS ARE MADE.
3. COVER BARE SOILS AND SLOPES AS SOON AS POSSIBLE. USE ONE OR MORE OF THE FOLLOWING TO REDUCE THE EROSION POTENTIAL FROM BARE, EXPOSED, OR DISTURBED SOIL: ROLLED EROSION CONTROL PRODUCTS (E.G. FILTER FABRIC, EROSION CONTROL BLANKETS, GEOTEXTILES), HYDRAULIC MULCH OR HYDROSEEDING, STRAW OR WOOD MULCH, SEEDING, VEGETATION PLANTING, OR OTHER APPROPRIATE COVER MATERIAL.
4. DO NOT USE SEEDING OR LOOSE MULCH ON SLOPES GREATER THAN 3:1 (H:V) WITHOUT ADDITIONAL EROSION PROTECTION SUCH AS GEOTEXTILES OR HYDROSEEDING. IF VEGETATIVE COVER IS USED, ESTABLISH A UNIFORM VEGETATIVE COVER WITH A MINIMUM OF 70 PERCENT COVERAGE.
5. PROTECT VEGETATED BUFFER ZONES AND RIPARIAN CORRIDORS BY USING SILT FENCES, THAT ARE PROPERLY STAKED IN (ON FLAT LAND OR MODERATE SLOPES), OR USE OTHER APPROPRIATE SEDIMENT CONTROLS.
6. PROPERLY INSTALL AND MAINTAIN ALL ON-SITE EROSION CONTROL MEASURES AND STRUCTURAL DEVICES, BOTH TEMPORARY AND PERMANENT. PROMPTLY REPAIR OR REINSTALL ANY EROSION CONTROL MEASURES AND STRUCTURAL DEVICES THAT WERE DAMAGED DURING CONSTRUCTION AND MAINTAIN THEM SO THAT THEY DO NOT BECOME NUISANCES WITH STAGNANT WATER, ODORS, INSECT BREEDING, HEAVY ALGAE GROWTH, DEBRIS, AND/OR SAFETY HAZARDS.
7. A QUALIFIED PERSON SHOULD CONDUCT INSPECTIONS OF ALL ON-SITE BMPS DURING EACH RAINSTORM. IF POSSIBLE, AND AFTER A STORM IS OVER TO ENSURE THAT THE BMPS ARE FUNCTIONING PROPERLY. FOR SITES GREATER THAN ONE-ACRE, ON-SITE INSPECTIONS ARE REQUIRED IN ACCORDANCE WITH THE STATE WATER QUALITY CONTROL BOARD CONSTRUCTION ACTIVITIES STORM WATER GENERAL PERMIT.
8. DUST CONTROL SHALL CONFORM WITH THE PROVISIONS IN SECTION 10 OF THE STATE STANDARD SPECIFICATIONS.


COUNTY EROSION CONTROL NOTES

1. PRIOR TO COMMENCEMENT OF ANY LAND DISTURBANCE, THE OWNER/APPLICANT SHALL SCHEDULE AN INSPECTION WITH RMA-ENVIRONMENTAL SERVICES TO ENSURE ALL NECESSARY SEDIMENT CONTROLS ARE IN PLACE AND THE PROJECT IS COMPLIANT WITH MONTEREY COUNTY REGULATIONS.
2. DURING CONSTRUCTION, THE OWNER/APPLICANT SHALL SCHEDULE AN INSPECTION WITH RMA-ENVIRONMENTAL SERVICES TO INSPECT DRAINAGE DEVICE INSTALLATION, REVIEW THE MAINTENANCE AND EFFECTIVENESS OF BMPS INSTALLED, AND TO VERIFY THAT POLLUTANTS OF CONCERN ARE NOT DISCHARGED FROM THE SITE. AT THE TIME OF THE INSPECTION, THE APPLICANT SHALL PROVIDE CERTIFICATION THAT ALL NECESSARY GEOTECHNICAL INSPECTIONS HAVE BEEN COMPLETED TO THAT POINT.
3. PRIOR TO FINAL INSPECTION, THE OWNER/APPLICANT SHALL SCHEDULE AN INSPECTION WITH RMA-ENVIRONMENTAL SERVICES TO ENSURE THAT ALL DISTURBED AREAS HAVE BEEN STABILIZED AND THAT ALL TEMPORARY EROSION AND SEDIMENT CONTROL MEASURES THAT ARE NO LONGER NEEDED HAVE BEEN REMOVED.

SCALE:	AS NOTED
DESIGNED BY:	JR
DRAWN BY:	JR
DATE:	SEPT. 7, 2021
REVISED:	FEB. 13, 2025
JOB NO.:	21006
SHEET	C5
OF	5 SHEETS

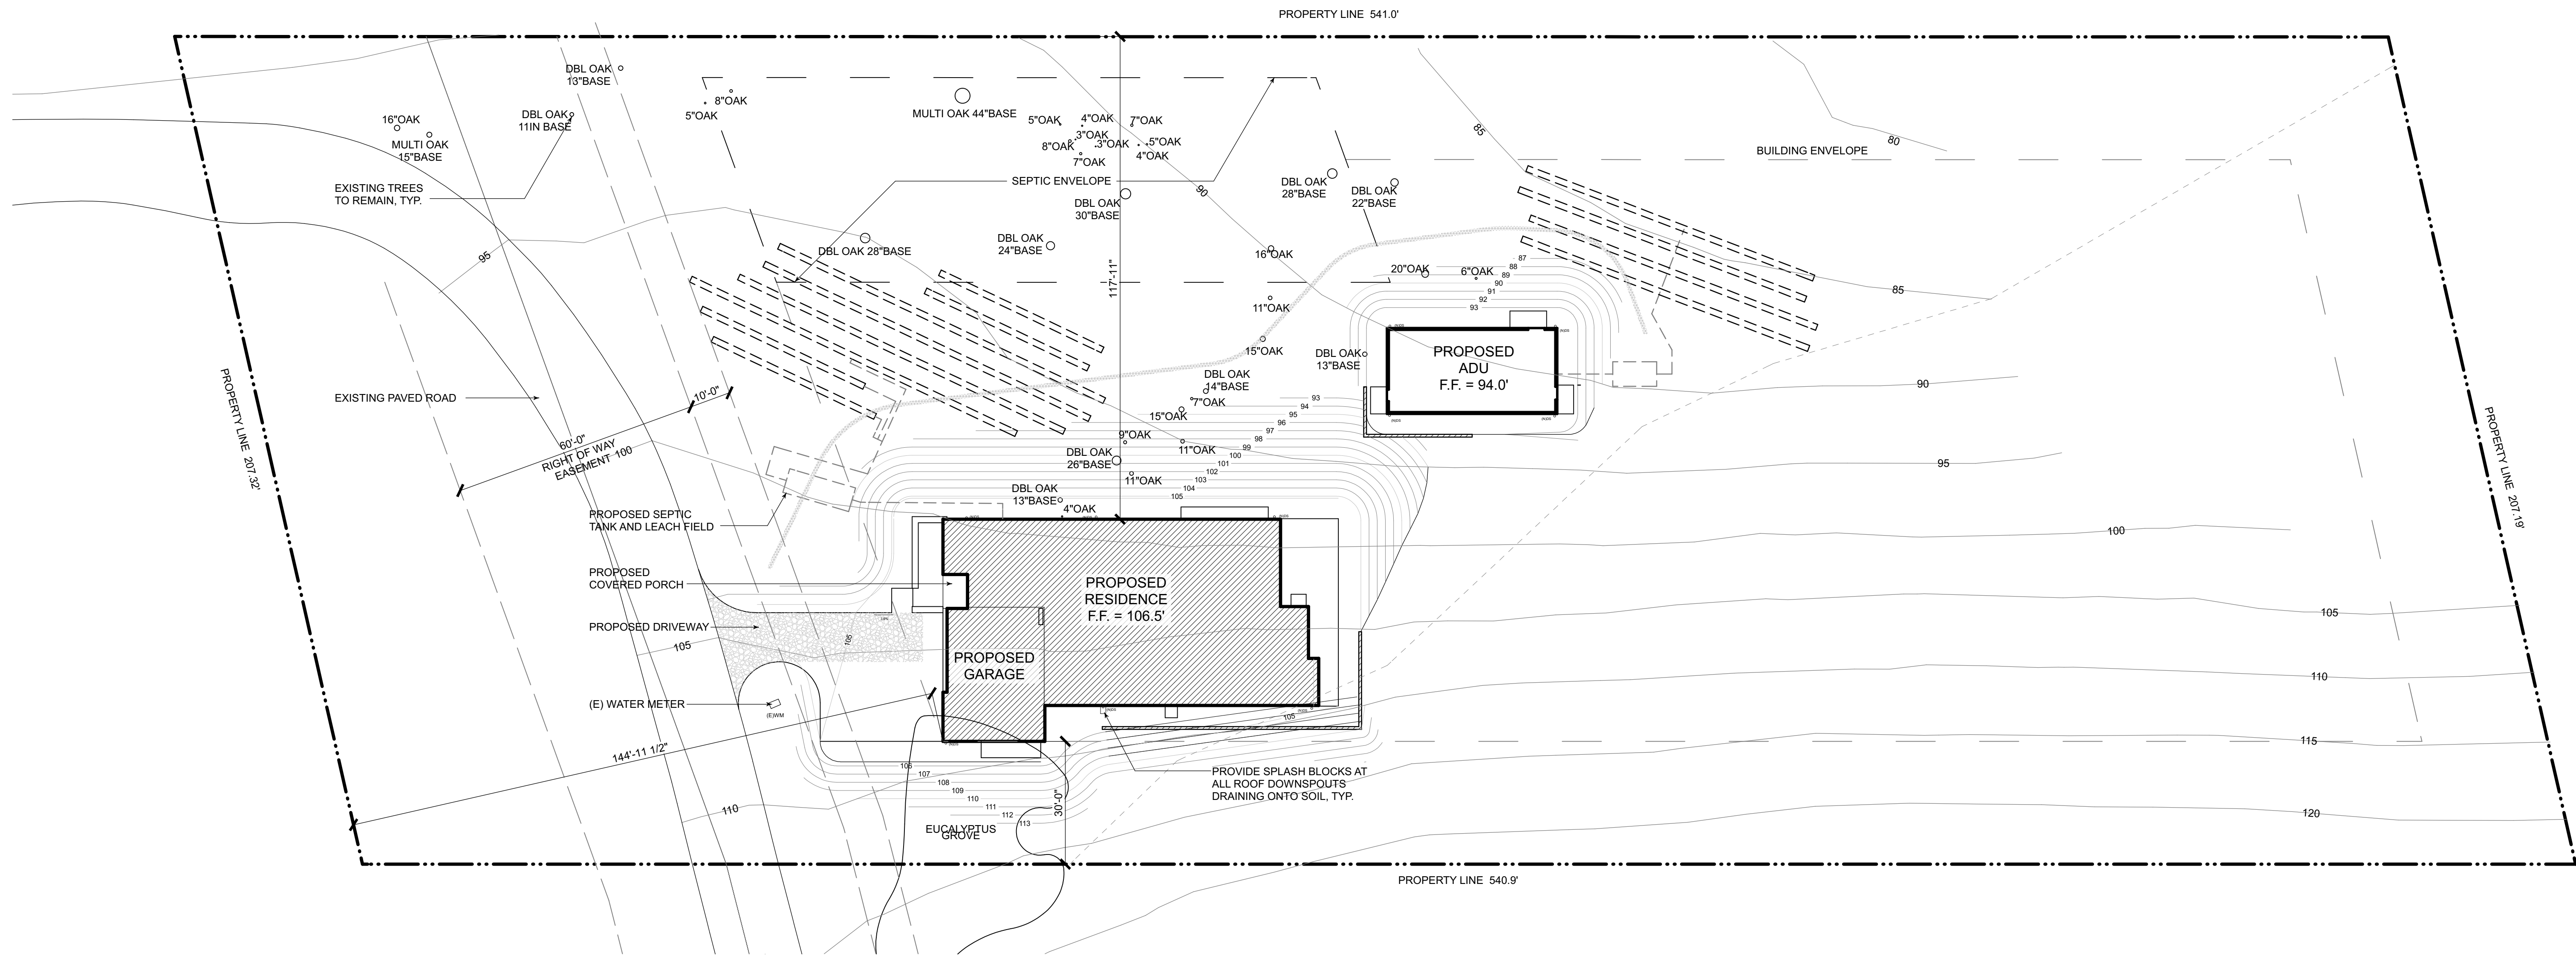

Site Plan

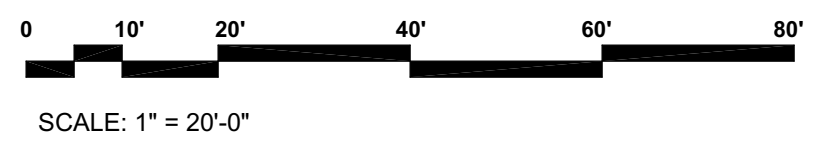

GENERAL NOTES:

- 1 VERIFY LOCATION OF ALL UTILITIES AT JOB SITE.
- 2 SLOPE ALL FINISH GRADES A MIN. OF 5% FOR 10'-0" AWAY FROM STRUCTURE FOR DRAINAGE. IMPERVIOUS SURFACES SHALL BE SLOPED NO LESS THAN 2% AWAY FROM BUILDING CRC R401.3
- 3 ALL DWELLINGS SHALL HAVE A CONTROLLED METHOD OF WATER DISPOSAL FROM ROOFS THAT WILL COLLECT AND DISCHARGE ROOF DRAINAGE TO THE GROUND SURFACE AT LEAST 5 FEET FROM FOUNDATION WALLS OR TIE INTO AN APPROVED DRAINAGE SYSTEM.
- 4 THE FINISH GRADE AROUND THE STRUCTURE SHALL SLOPE AWAY FROM THE FOUNDATION A MINIMUM OF 5% FOR A MINIMUM DISTANCE OF 10'-0" (CBC 1804.3).
- 5 ON GRADED SITES, THE TOP OF ANY EXTERIOR FOUNDATION SHALL EXTEND ABOVE THE ELEVATION OF THE STREET GUTTER AT POINT OF DISCHARGE OR THE INLET OF AN APPROVED DRAINAGE DEVICE A MINIMUM OF 12" PLUS 2" (CRC 1808.7.4).
- 6 EAVE PROJECTIONS SHALL HAVE 1 HOUR FIRE-RESISTANCE RATING ON ALL EAVE PROJECTIONS THAT ARE LESS THAN 3'-0" FROM THE PROPERTY LINE. THIS IS NOT REQUIRED FOR EAVE PROJECTIONS GREATER THAN 3'-0" AS PRESCRIBED UNDER CRC SECTION R302 & TABLES R302.1(2).

WASTE MANAGEMENT PLAN:

CONSTRUCTION WASH-OUT WATER FROM CONCRETE, MORTAR, TILE, TAPING, AND PAINTING SHALL BE DONE IN A PORTABLE CONTAINMENT POOL OR IN A LINED EVAPORATIVE PIT. WASH-OUT SHALL NOT ENTER THE STORM WATER SYSTEM.

TRASH PILES SHALL NOT BE LOCATED IN THE FRONT YARD OR VISIBLE FROM THE STREET. TRASH PILES SHALL NOT CONTAIN: PAINTS, SOLVENTS, GLUES, TAPING COMPOUND, FOOD PRODUCTS, OR EASILY RECYCLE-ABLE DISCARDS SUCH AS BOTTLES, CANS, PLASTICS, OR PAPER. REMAINING TRASH SHALL BE LIMITED TO CONCRETE, WOOD, DRYWALL, ROOFING, AND ASSORTED METALS AND SHALL BE COVERED WITH A WATERPROOF TARP. TRASH SHALL BE SEPARATED AT AN APPROVED BAY AREA DISPOSAL SITE SUCH AS GUADALUPE RECYCLING. ALL TRASH IS TO BE QUICKLY HAULED OFF SITE. RETAIN THE RECEIPT AND KEEP WITH THE PERMIT DOCUMENTS. PROOF OF RECYCLE AND DISPOSAL OF THE JOB SITE TRASH WILL BE CHECKED PERIODICALLY AND PRIOR TO FINAL INSPECTION.

OR

WEST VALLEY COLLECTION AND RECYCLING (408) 283-9250 WILL DELIVER A ROLL-OFF DEBRIS BOX AND SORT THE TRASH OFF SITE.

EROSION CONTROL NOTES:


1. ALL EROSION CONTROL MEASURES SHALL BE ONSITE AND READILY ACCESSIBLE PRIOR TO CONSTRUCTION.
2. SWEEP OR SCRAPE UP SOILS TRACKED ONTO THE ROAD AT THE END OF EACH DAY. DO NOT HOSE INTO STREET, GUTTER, OR STORM DRAIN.
3. REVEGETATE DISTURBED AREAS. EXPOSED BARE DIRT SHALL BE COVERED WITH MULCH, JUT NETTING OR OTHER EROSION CONTROL BLANKET.
4. ALL TEMPORARY STOCKPILES SHALL BE COVERED WITH 6 MIL. PLASTIC SHEETS, SUITABLY ANCHORED.
5. THE SITE SHALL BE MONITORED BY THE CONTRACTOR / OWNER AFTER RAIN EVENT TO VERIFY EROSION CONTROL MEASURES ARE FUNCTIONING.

WARREN DESIGN
 579 E. CAMPBELL AVE. CAMPBELL, CA 95008 P. 650.469.3780


These drawings and the design incorporated herein are the property of Warren Design and are not to be used for any other project without the written consent of Warren Design.

SAN JUAN RESIDENCE - LOT C
NEW RESIDENCE
 1907 SAN JUAN ROAD
 AROMAS CALIFORNIA

Date:	08/18/2025
Drawn By:	DW
Revisions:	
▲	
▲	
▲	
▲	
▲	
SITE PLAN	
Project No:	2549
Sheet No:	A-1
3 of 11	

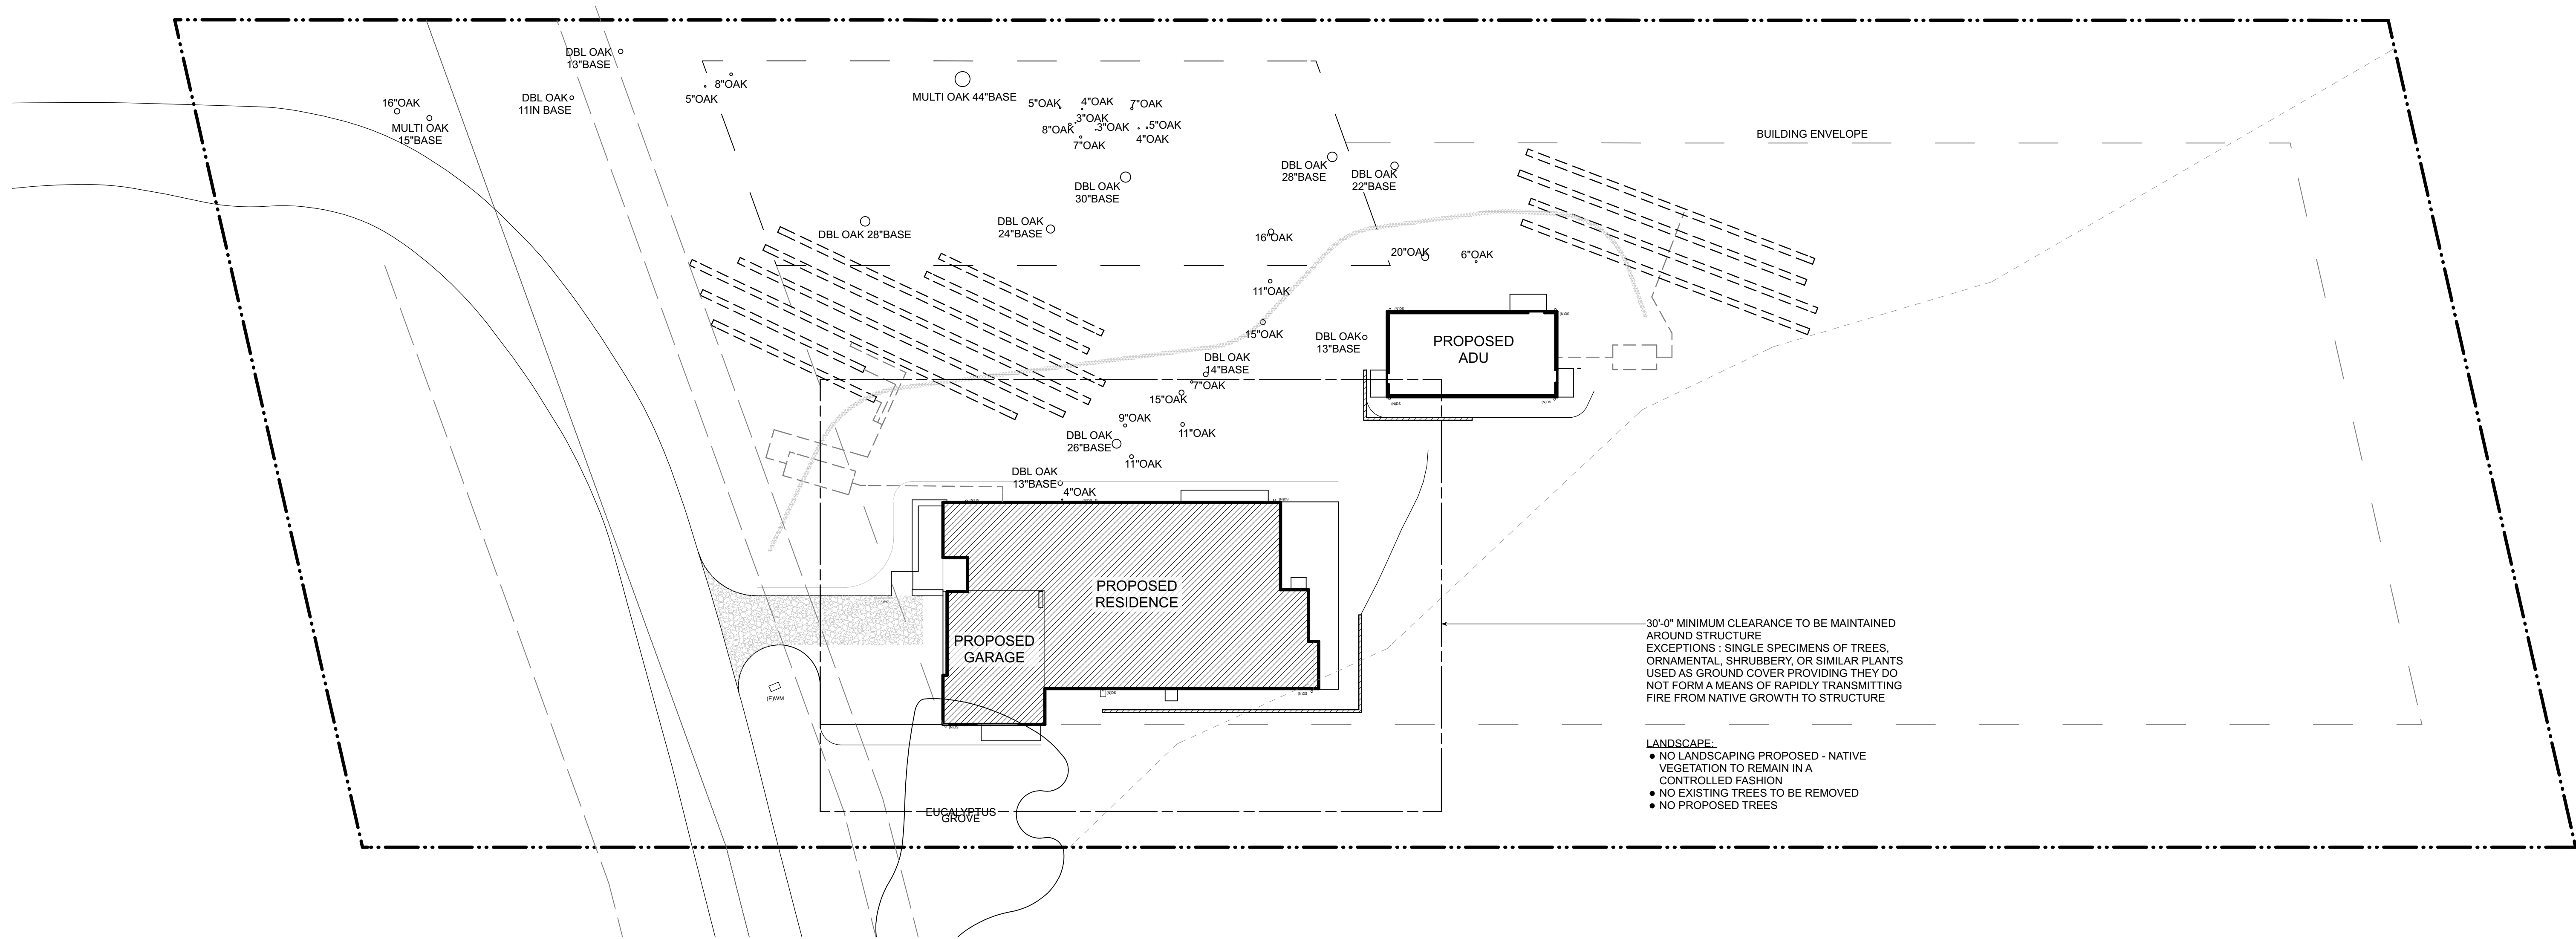

Fuel Management & Landscaping Plan

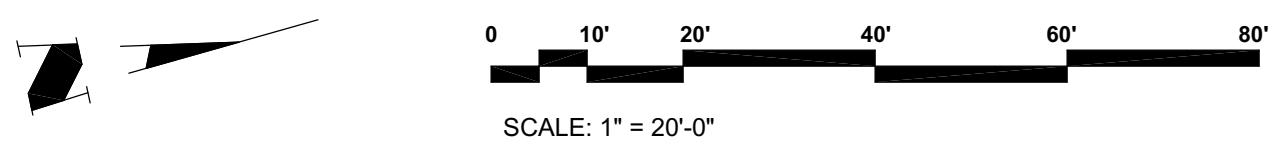

Date:	08/18/2025
Drawn By:	DW
Revisions:	
▲	
▲	
▲	
▲	

FUEL MANAGEMENT & LANDSCAPING PLAN

GENERAL NOTES:


1. WINDOW & DOOR SIZES SHOWN ARE FOR DESIGN PURPOSES ONLY. ACTUAL WINDOW & DOOR SIZES SHALL BE FRAMED & SET PER MFG. SPECIFICATIONS. MAKE & MODEL NUMBERS SHALL BE CALLED OUT PER SUPPLIER'S AND/OR OWNER'S SPECIFICATIONS. WINDOWS TO BE DUAL-PANED (U.N.O.)
2. ALL EXTERIOR HEADERS SHALL BE AT 8'-0" U.N.O.
3. ALL EXTERIOR DOORS SHALL BE AT LEAST 1 3/4" THICK
4. ALL GLASS DOORS, GLASS WITHIN 24" OF DOORS & WITHIN 18" OF FLOORS, GLASS SUBJECT TO HUMAN IMPACT, ETC. SHALL BE SAFETY TEMPERED
5. BEDROOM WINDOWS SHALL HAVE MAX 44" HIGH TO THE BOTTOM OF THE CLEAR OPENING. NET CLEAR OPENINGS OF 20" IN WIDTH & 24" IN HEIGHT W/ MIN. CLEAR OPENING OF 5.7 SQUARE FEET
6. SHOWERS TO BE FINISHED WITH MOISTURE RESISTANT MATERIALS OVER A MOISTURE RESISTANT UNDERLAYMENT TO MIN. HEIGHT OF 72" ABOVE DRAIN W/ TEMPERED GLASS ENCLOSURES
7. PROVIDE THERMOSTATIC MIXING VALVE OR INDIVIDUAL CONTROL VALVES OF THE PRESSURE BALANCE AT ALL SHOWERS PER C.P.C.
8. WATER HEATERS & FURNACES TO BE C.E.C. CERTIFIED. WATER HEATERS TO HAVE PRESSURE & TEMPERATURE RELIEF DEVICES & DISCHARGE TO OUTSIDE.
9. PROVIDE COMBUSTION AIR FOR FUEL BURNING APPLIANCES
10. WATER HEATERS SHALL BE STRAPPED WITHIN THE UPPER & LOWER 1/3 OF THE HEATER STRAPS SHALL BE LOCATED A MIN. OF 4" FROM ANY CONTROLS. WATER HEATER TO BE ON PLATFORM 18" MIN. A.F.F.
11. OPENINGS AROUND GAS VENTS, DUCTS & PIPING AT EACH FLOOR SHALL BE FIRE STOPPED
12. AIR DUCTS IN GARAGE THAT PASS THRU LIVING/ GARAGE COMMON WALL SHALL BE 26 GA. STEEL OR THICKER
13. INSTALL PRE-FAB MTL. FIREPLACES PER MFG'S SPEC'S. PROVIDE I.C.C. APPROVED NUMBERS TO BUILDING DEPT. PRIOR TO INSTALLATION
14. PROVIDE FIRE-STOPPS IN OPENINGS AT FLOOR & CEILINGS OF ALL FIREPLACES
15. PROVIDE CO. SMOKE DETECTORS WITHIN EACH SLEEPING ROOM & CENTRALLY LOCATED IN CORRIDORS OR AREAS GIVING ACCESS TO EACH SLEEPING AREA ALL DETECTORS TO BE INTERCONNECTED TYPICAL
16. LANDINGS NO MORE THAN 7.75" LOWER THAN THRESHOLD FOR IN-SWINGING DOORS, & NO MORE THAN 1 1/2" FOR OUT-SWINGING & ENTRY DOORS. EXTERIOR LANDINGS TO BE 3'-0" DEEP MIN.
17. ALL GYPSUM BOARD TO 5/8" TYP. U.N.O.
18. CONTROL VALVES AND SHOWERHEADS SHALL BE LOCATED ON THE SIDEWALL OF THE SHOWER COMPARTMENTS OR BE OTHERWISE ARRANGED SO THAT THE SHOWERHEAD DOES NOT DISCHARGE DIRECTLY AT THE ENTRANCE TO THE COMPARTMENT AND THE BATHER CAN ADJUST THE VALVES PRIOR TO STEPPING INTO THE SHOWER SPRAY CPC 408.9
19. JOINTS AND OTHER OPENINGS IN THE BUILDING ENVELOPE THAT ARE POTENTIAL SOURCES OF AIR LEAKAGE SHALL BE CAULKED, GASKETED, WEATHER-STRIPPED OR OTHERWISE SEALED TO LIMIT INFILTRATION AND EXFILTRATION. (CEN-C SECTION 17)
20. THE FIRST 5' OF HOT AND COLD WATER PIPES FROM THE STORAGE TANK FOR NON RECIRCULATING SYSTEMS SHALL BE THERMALLY INSULATED WITH A MIN. OF 1" (.75") THICK INSULATION FOR HOT (COLD) WATER PIPES WITH A DIAMETER LESS THAN OR EQUAL TO 2" OR 1.5" (1") FOR HOT (COLD) WATER PIPES WITH A DIAMETER GREATER THAN 2" (150)(1/2) CEN-C.
21. VENTILATION ISLAND FIXTURES (VEGETABLE SINK) SHALL BE DESIGNED PER SECTION 909 OF THE 2022 CALIFORNIA PLUMBING CODE.
22. PROVIDE 2x8 SOLID LUMBER REINFORCEMENT LOCATED BETWEEN 32" & 39 1/4" ABOVE FINISHED FLOOR AND FLUSH WITH WALL FRAMING FOR FUTURE GRAB BARS IN BATHROOM IN ACCORDANCE WITH CRC SECTION R327.1.1. WATER CLOSET REINFORCEMENT SHALL BE INSTALLED ON BOTH SIDE WALLS OF THE FIXTURE, OR ONE SIDE WALL AND THE BACK WALL. SHOWER REINFORCEMENT SHALL NOT BE CONTINUOUS WHERE WALL FRAMING IS PROVIDED. REINFORCEMENT SHALL NOT BE REQUIRED IN WALL FRAMING FOR PREFABRICATED SHOWER ENCLOSURES AND BATHTUB WALL PANELS WITH INTEGRAL FACTORY-INSTALLED GRAB BARS OR WHEN FACTORY-INSTALLED REINFORCEMENT FOR GRAB BARS IS PROVIDED. SHOWER ENCLOSURES THAT DO NOT PERMIT INSTALLATION OF REINFORCEMENT AND/OR GRAB BARS SHALL BE PERMITTED, PROVIDED REINFORCEMENT FOR INSTALLATION OF FLOOR-MOUNTED GRAB BARS OR AN ALTERNATE METHOD IS APPROVED BY THE ENFORCING AGENCY.

1. PLUMBING GENERAL NOTES:


1. PROVIDE AN ACCESSIBLE SHUTOFF VALVE INSTALLED IN THE FUEL-SUPPLY PIPING OUTSIDE OF EACH APPLIANCE AND AHEAD OF THE UNION CONNECTION THERETO. AN APPLIANCE FUEL CONNECTOR SHALL NOT BE CONCEALED WITHIN OR EXTEND THROUGH A WALL, FLOOR, OR PARTITION AND SHALL NOT EXTEND THROUGH THE APPLIANCE HOUSING OR CASING 2022 CMC 1312.3
2. PROVIDE WATER HAMMER ARRESTORS AT ALL APPLIANCES THAT HAVE QUICK-ACTING VALVES (i.e. DISHWASHER HOT WATER LINE AND THE HOT/COLD WATER LINES FOR THE CLOTHES WASHER.) 2022 CPC 609.10
3. IN ADDITION TO PRIMARY CONDENSATE DRAINS, WHEN COOLING COILS ARE LOCATED IN AN ATTIC, A SECONDARY OR OVERFLOW SHALL BE PROVIDED. THE REQUIRED OVERFLOW LINE SHALL BE SEPARATE FROM THE PRIMARY AND SHALL TERMINATE WHERE IT IS READILY OBSERVABLE (i.e. ABOVE WINDOWS OR DOORS). CMC 310.2
4. ALL HOSE BIBBS SHALL HAVE NON-REMOVABLE TYPE BACK-FLOW PREVENTION DEVICE.
5. PROVIDE DEL. SEISMIC STRAPPING AT ALL WATER HEATERS
6. PLUMBING CONTRACTOR SHALL PROVIDE T & P VALVE ON WATER HEATER AND ROUTE DISCHARGE LINE TO EXTERIOR, C.B.C
7. IN SHOWERS & TUB/SHOWER COMBINATIONS, CONTROL VALVES MUST BE PRESSURE BALANCED OR THERMOSTATIC MIXING VALVES PER CPC
8. NO UNDERFLOOR CLEANOUT SHALL BE LOCATED MORE THAN 20 FEET FROM AN ACCESS DOOR, TRAP DOOR, OR CRAWL HOLE PER CPC
9. PLUMBING CONTRACTOR WILL PROVIDE A SINGLE LINE DIAGRAM OF THE GAS LINE INDICATING THE DISTANCE FROM THE METER TO EACH GAS-FIRED APPLIANCE. HE SHALL INCLUDE THE SIZE OF THE GAS PIPE TO EACH APPLIANCE. GAS PIPE SIZING TO BE PER TABLE 12-8 2022 CPC 1217. DIAGRAM SHALL BE PROVIDED AT TIME OF INSPECTION AND ANY INSTALLATION PRIOR TO PLAN CHECK AND APPROVAL IS AT CONTRACTOR'S RISK
10. THE MAXIMUM HOT WATER TEMPERATURE DISCHARGING FROM THE BATHTUB, SHOWER AND WHIRLPOOL BATHTUB FILLER SHALL BE LIMITED TO 120 DEGREES FAHRENHEIT. THE WATER HEATER THERMOSTAT SHALL NOT BE CONSIDERED A CONTROL FOR MEETING THIS PROVISION. (CPC 408.3)
11. EXTERIOR WATER HEATER PIPING SHALL BE INSULATED AND WRAPPED TIGHTLY WITH A UV RESISTANT TAPE (150 CEC).
12. DISHWASHER SHALL BE FITTED WITH AN AIR GAP OR A HIGH LOOP IF THE MANUFACTURE'S INSTALLATION GUIDELINES ALLOW.
13. ON AND AFTER JANUARY 1, 2014, FOR ALL BUILDING ALTERATIONS OR IMPROVEMENTS TO SINGLE FAMILY RESIDENTIAL REAL PROPERTY, AS A CONDITION FOR ISSUANCE OF A CERTIFICATE OF FINAL COMPLETION AND OCCUPANCY OR FINAL PERMIT APPROVAL BY THE LOCAL BUILDING DEPARTMENT, THE PERMIT APPLICANT SHALL REPLACE ALL NON-COMPLIANT PLUMBING FIXTURES WITH WATER CONSERVING PLUMBING FIXTURES. SOME HISTORIC BUILDINGS MAY HAVE EXEMPT FIXTURES.
14. WATER CLOSETS (TOILETS) SHALL USE NO MORE THAN 1.28 GALLONS/FLUSH. SHOWER HEADS SHALL HAVE A WATER FLOW RATE NOT MORE THAN 1.8 GALLONS PER MINUTE AT 80 PSI. LAVATORY FAUCETS SHALL NOT EXCEED 1.2 GALLONS PER MINUTE AT 60 PSI. KITCHEN FAUCETS SHALL NOT EXCEED 1.8 GALLONS PER MINUTE AT 60 PSI.

FIXTURE	IF THE WATER USAGE EXCEEDS	IT MUST BE REPLACED WITH
WATER CLOSET	1.8 GAL / FLUSH	1.28 GAL / FLUSH
SHOWER HEAD	2.5 GAL / MINUTE	1.8 GAL / MINUTE
LAVATORY FAUCET	2.2 GAL / MINUTE	1.2 GAL / MINUTE
KITCHEN FAUCET	2.2 GAL / MINUTE	1.8 GAL / MINUTE

15. WATER HEATERS & FURNACES TO BE C.E.C. CERTIFIED. WATER HEATERS TO HAVE PRESSURE & TEMPERATURE RELIEF DEVICES & DISCHARGE TO OUTSIDE.
16. OPENINGS AROUND GAS VENTS, DUCTS & PIPING AT EACH FLOOR SHALL BE FIRE STOPPED
17. AIR DUCTS IN GARAGE THAT PASS THRU LIVING/ GARAGE COMMON WALL SHALL BE 26 GA. STEEL OR THICKER
18. THE FIRST 5'-0" OF HOT AND COLD WATER PIPES FROM THE STORAGE TANK FOR NON RECIRCULATING SYSTEMS SHALL BE THERMALLY INSULATED WITH A MIN. OF 1" (.75") THICK INSULATION FOR HOT (COLD) WATER PIPES WITH A DIAMETER LESS THAN OR EQUAL TO 2" OR 1.5" (1") FOR HOT (COLD) WATER PIPES WITH A DIAMETER GREATER THAN 2" (150)(1/2) CEN-C.

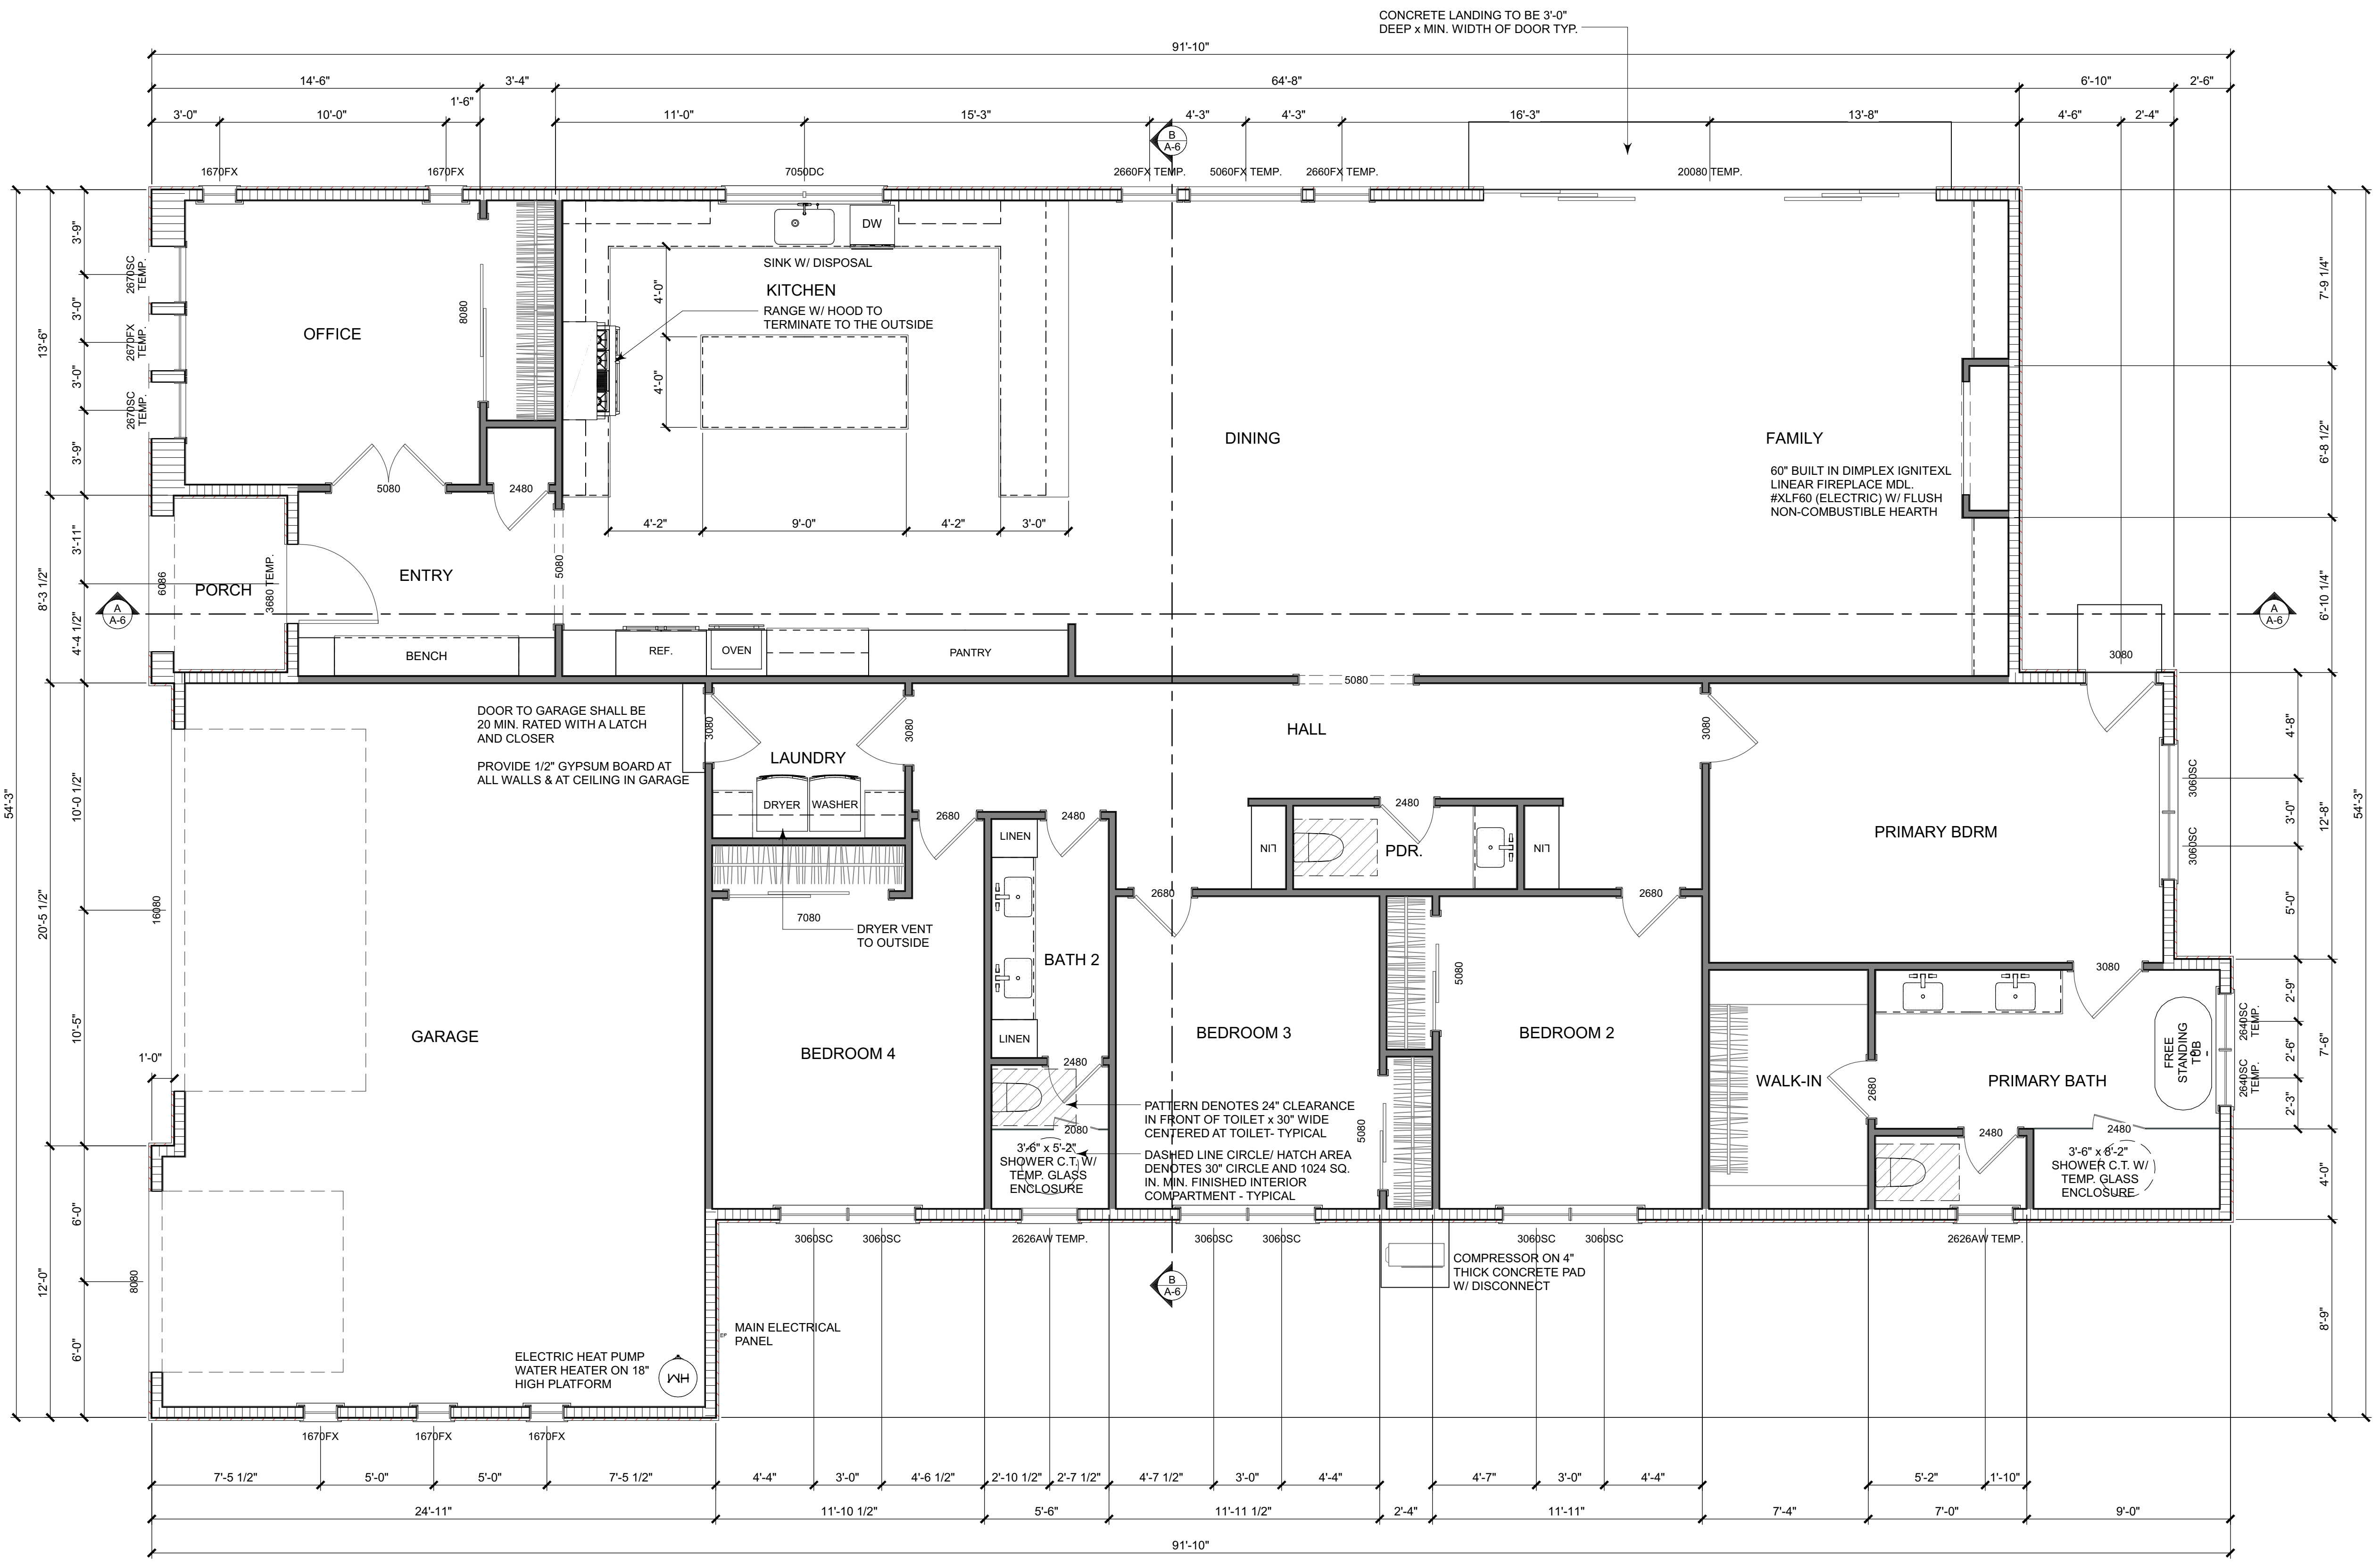

Proposed Floor Plan

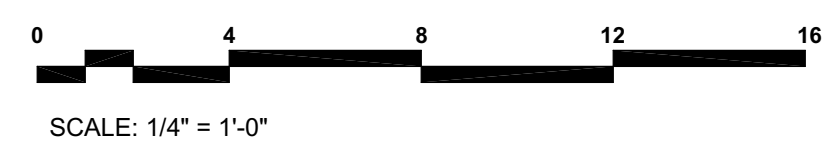

WARREN DESIGN
 579 E. CAMPBELL AVE. CAMPBELL, CA 95008 P. 650.469.3780
Warren Design

SAN JUAN RESIDENCE - LOT C
NEW RESIDENCE
 1907 SAN JUAN ROAD
AROMAS CALIFORNIA

Date: 08/18/2025
 Drawn By: DW
 Revisions:
 ▲
 ▲
 ▲
 ▲

PROPOSED FLOOR PLAN


Project No: **2549**
 Sheet No: **A-2**
 5 of 11



Front Elevation



26 GA. G.I. DRIP SCREED WITH MIN. VERTICAL ATTACHMENT FLANGE AT 31/2" PROVIDED AT OR BELOW THE FOUNDATION PLATE LINE AT ALL EXTERIOR WALLS-TYP. AT 4" ABV. GRADE (2" ABV. HARDSCAPE)

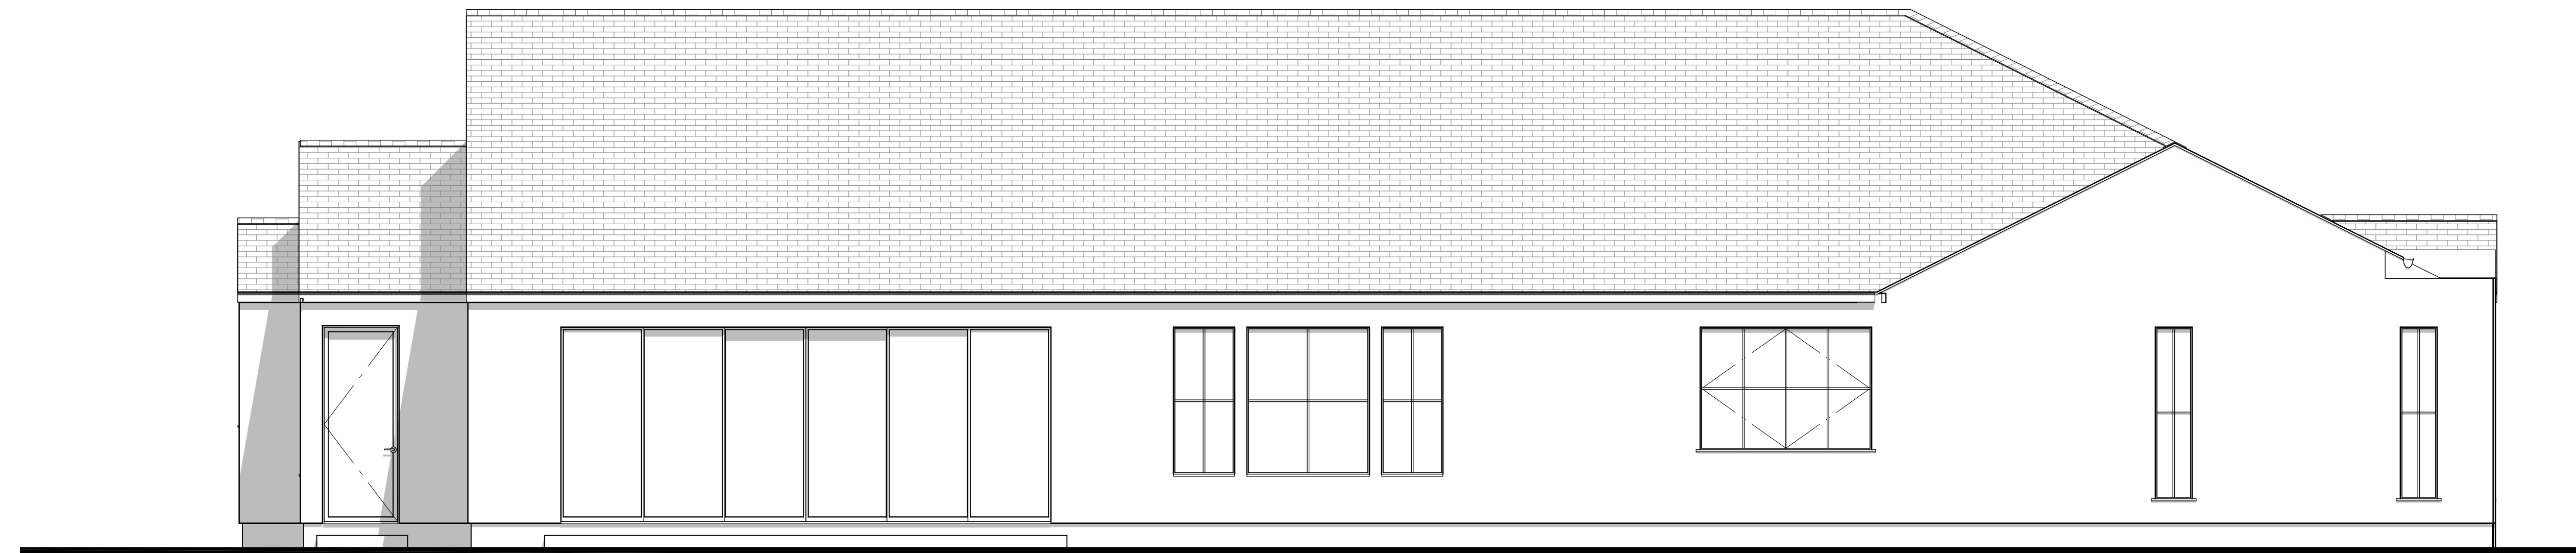

Left Elevation

- ALL EXTERIOR FLASHING AND INSTALLATION OF APPROVED CORROSION RESISTANT FLASHING ALLIED SHINGLE-FASHION IN A MANNER TO PREVENT ENTRY OF WATER INTO THE WALL CAVITY OR PENETRATION OF WATER INTO THE BUILDING STRUCTURAL FRAMING COMPONENTS AT THE FOLLOWING LOCATIONS, BUT NOT LIMITED TO:
- EXTERIOR WINDOWS AND DOORS.
 - AT THE INTERSECTION OF CHIMNEYS OR OTHER MASONRY CONSTRUCTION WITH FRAME OR STUCCO WALLS, WITH PROJECTION LIPS ON BOTH SIDES UNDER STUCCO COPINGS.
 - UNDER AND AT THE ENDS OF MASONRY, WOOD OR METAL COPINGS AND SILLS.
 - CONTINUOUSLY ABOVE ALL PROJECTING WOOD TRIM.
 - WHERE EXTERIOR PORCHES, DECKS OR STAIRS ATTACH TO A WALL OR FLOOR ASSEMBLY OR WOOD-FRAME CONSTRUCTION AT WALL AND ROOF INTERSECTIONS.
 - AT BUILT-IN GUTTERS.

WARREN DESIGN
679 E. CAMPBELL AVE. CAMPBELL, CA 95008 P. 650.469.3780

DW


These drawings and the design incorporated herein are the intellectual property of Warren Design and are not to be used for any other project without the written consent of Warren Design.

SAN JUAN RESIDENCE - LOT C
NEW RESIDENCE
1907 SAN JUAN ROAD
AROMAS CALIFORNIA

Date:	08/18/2025
Drawn By:	DW
Revisions:	
▲	
▲	
▲	
▲	



EXTERIOR ELEVATIONS

Project No: **2549**
Sheet No: **A-3**

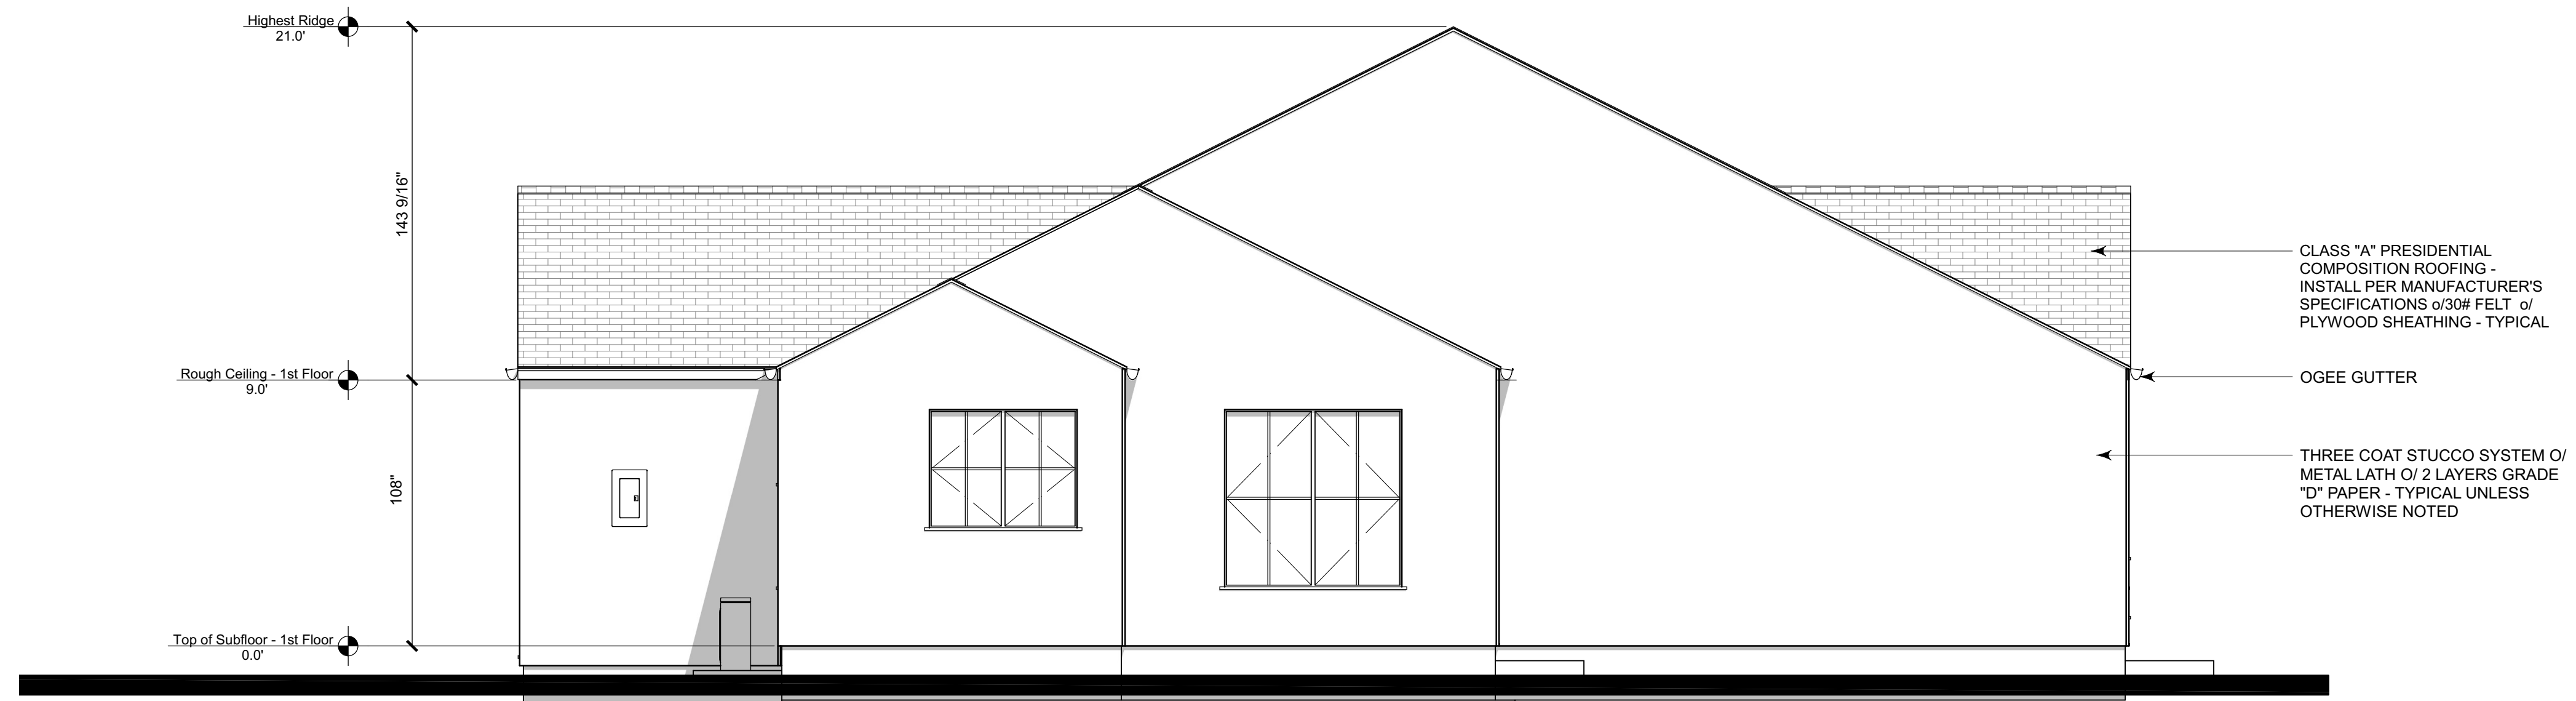

Rear Elevation

26 GA. G.I. DRIP SCREED WITH MIN. VERTICAL ATTACHMENT FLANGE AT 31/2" PROVIDED AT OR BELOW THE FOUNDATION PLATE LINE AT ALL EXTERIOR WALLS-TYP. AT 4" ABV. GRADE (2" ABV. HARDSCAPE)

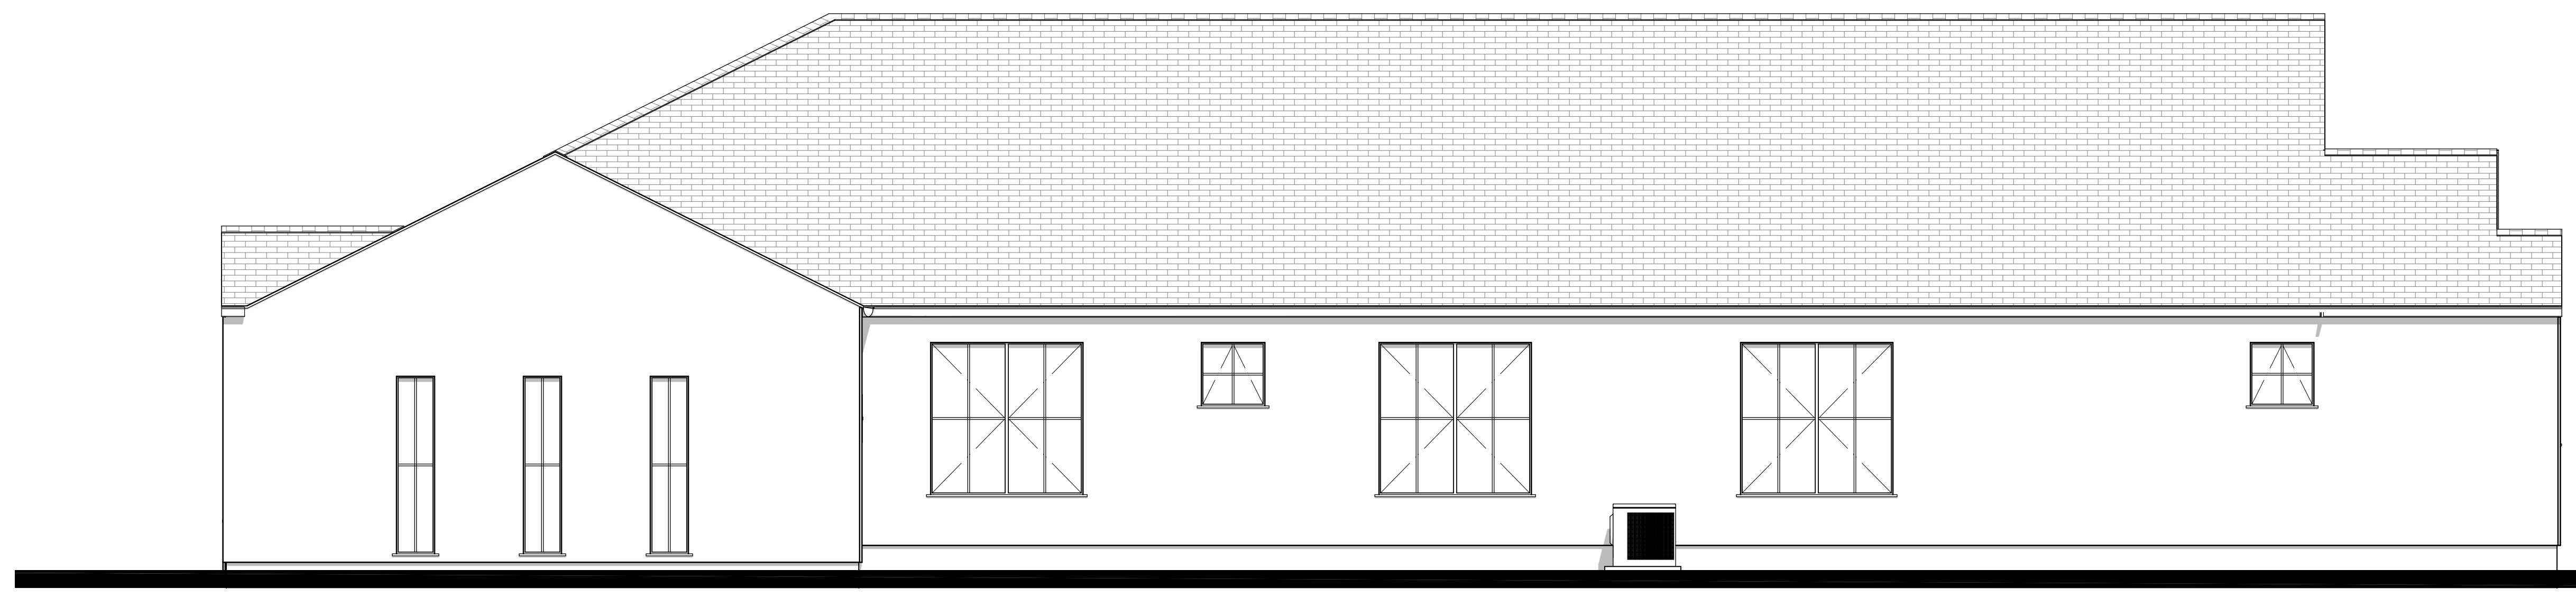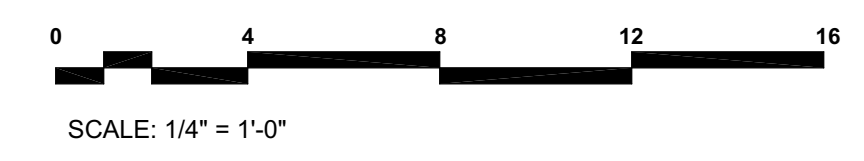

Right Elevation

WARREN DESIGN
 579 E. CAMPBELL AVE. CAMPBELL, CA 95008 P. 650.469.3780

DW
 These drawings and the design incorporated herein are the intellectual property of Warren Design and are not to be used for any other project without the express written consent of Warren Design.

SAN JUAN RESIDENCE - LOT C
NEW RESIDENCE
 1907 SAN JUAN ROAD
 AROMAS CALIFORNIA

Date:	08/18/2025
Drawn By:	DW
Revisions:	
▲	
▲	
▲	
▲	

EXTERIOR ELEVATIONS

Project No:
2549
 Sheet No:
A-4

ROOF PLAN GENERAL NOTES:

1. ARROWS INDICATE DIRECTION OF ROOF SLOPE.
2. OVERHANGS ARE TO BE 12" AT EAVES & 12" AT RAKES (U.N.O.)
3. PROVIDE EAVE VENTS FOR ATTIC VENTILATION PER C.R.C. TYPICAL.
4. INSTALL G.I. MATERIAL ROOF JACKS FOR PLUMBING VENTS, ETC. AS REQUIRED.
5. INSTALL "OGEE" GUTTER W/ DOWNSPOUTS AS REQUIRED TO MATCH EXISTING.
6. PROVIDE CONCRETE SPLASH BLOCKS AT DOWNSPOUT LOCATIONS FOR DRAINAGE AWAY FROM STRUCTURE - TYPICAL.

ATTIC VENTILATION:

2,434.69 S.F. OF ATTIC SPACE / 300 = 7.4 S.F.
 8.12 S.F. x 144 SQ. INCHES = 1,169.28 SQ. INCHES REQ'D
 1,169.28 SQ. INCHES / 2 = 584.64 SQ. INCHES


584.64 SQ. INCHES REQ'D / 72 SQ. INCHES = 20 - 32"x24" O'HAGIN FLAT ROOF VENTS.

PROVIDE (3) 2" DIA. HOLES AT FREEZE BLK'G (9 SQ. INCHES OF VENTING PER BLOCK)
 584.64 SQ. INCHES REQ'D / 9 SQ. INCHES = 65 FREEZE BLOCKS REQUIRED.
 PROVIDE VENTING BLK'S SPACED EVENLY AT PERIMETER BUT NOT CLOSER THAN EVERY OTHER BAY.


NOTE:
 AT LEAST 40% BUT NOT MORE THAN 50% OF REQUIRED ATTIC VENTILATION SHALL BE PROVIDED BY VENTS LOCATED NOT MORE THAN 3' BELOW THE RIDGE AND THE REMAINING VENTS LOCATED AT THE EAVE OR CORNICE PER C.R.C.

FOUNDATION VENTILATION:
 8"x16" SIMPSON G.I. FOUNDATION VENTS TO BE EVENLY SPACED AROUND PERIMETER OF FOUNDATION FOR CROSS VENTILATION REQUIREMENTS. WHERE EXISTING VENTS ARE COVERED UP PROVIDE ADDITIONAL VENTS AS NECESSARY. VENTS SHALL NOT BE LOCATED AT SHEARWALLS

2,261.26 S.F. / 150 S.F. = 15.08 S.F.
 8"x16" = .72 S.F.
 15.08 S.F. / .72 S.F. = 21 VENTS MIN. REQ'D

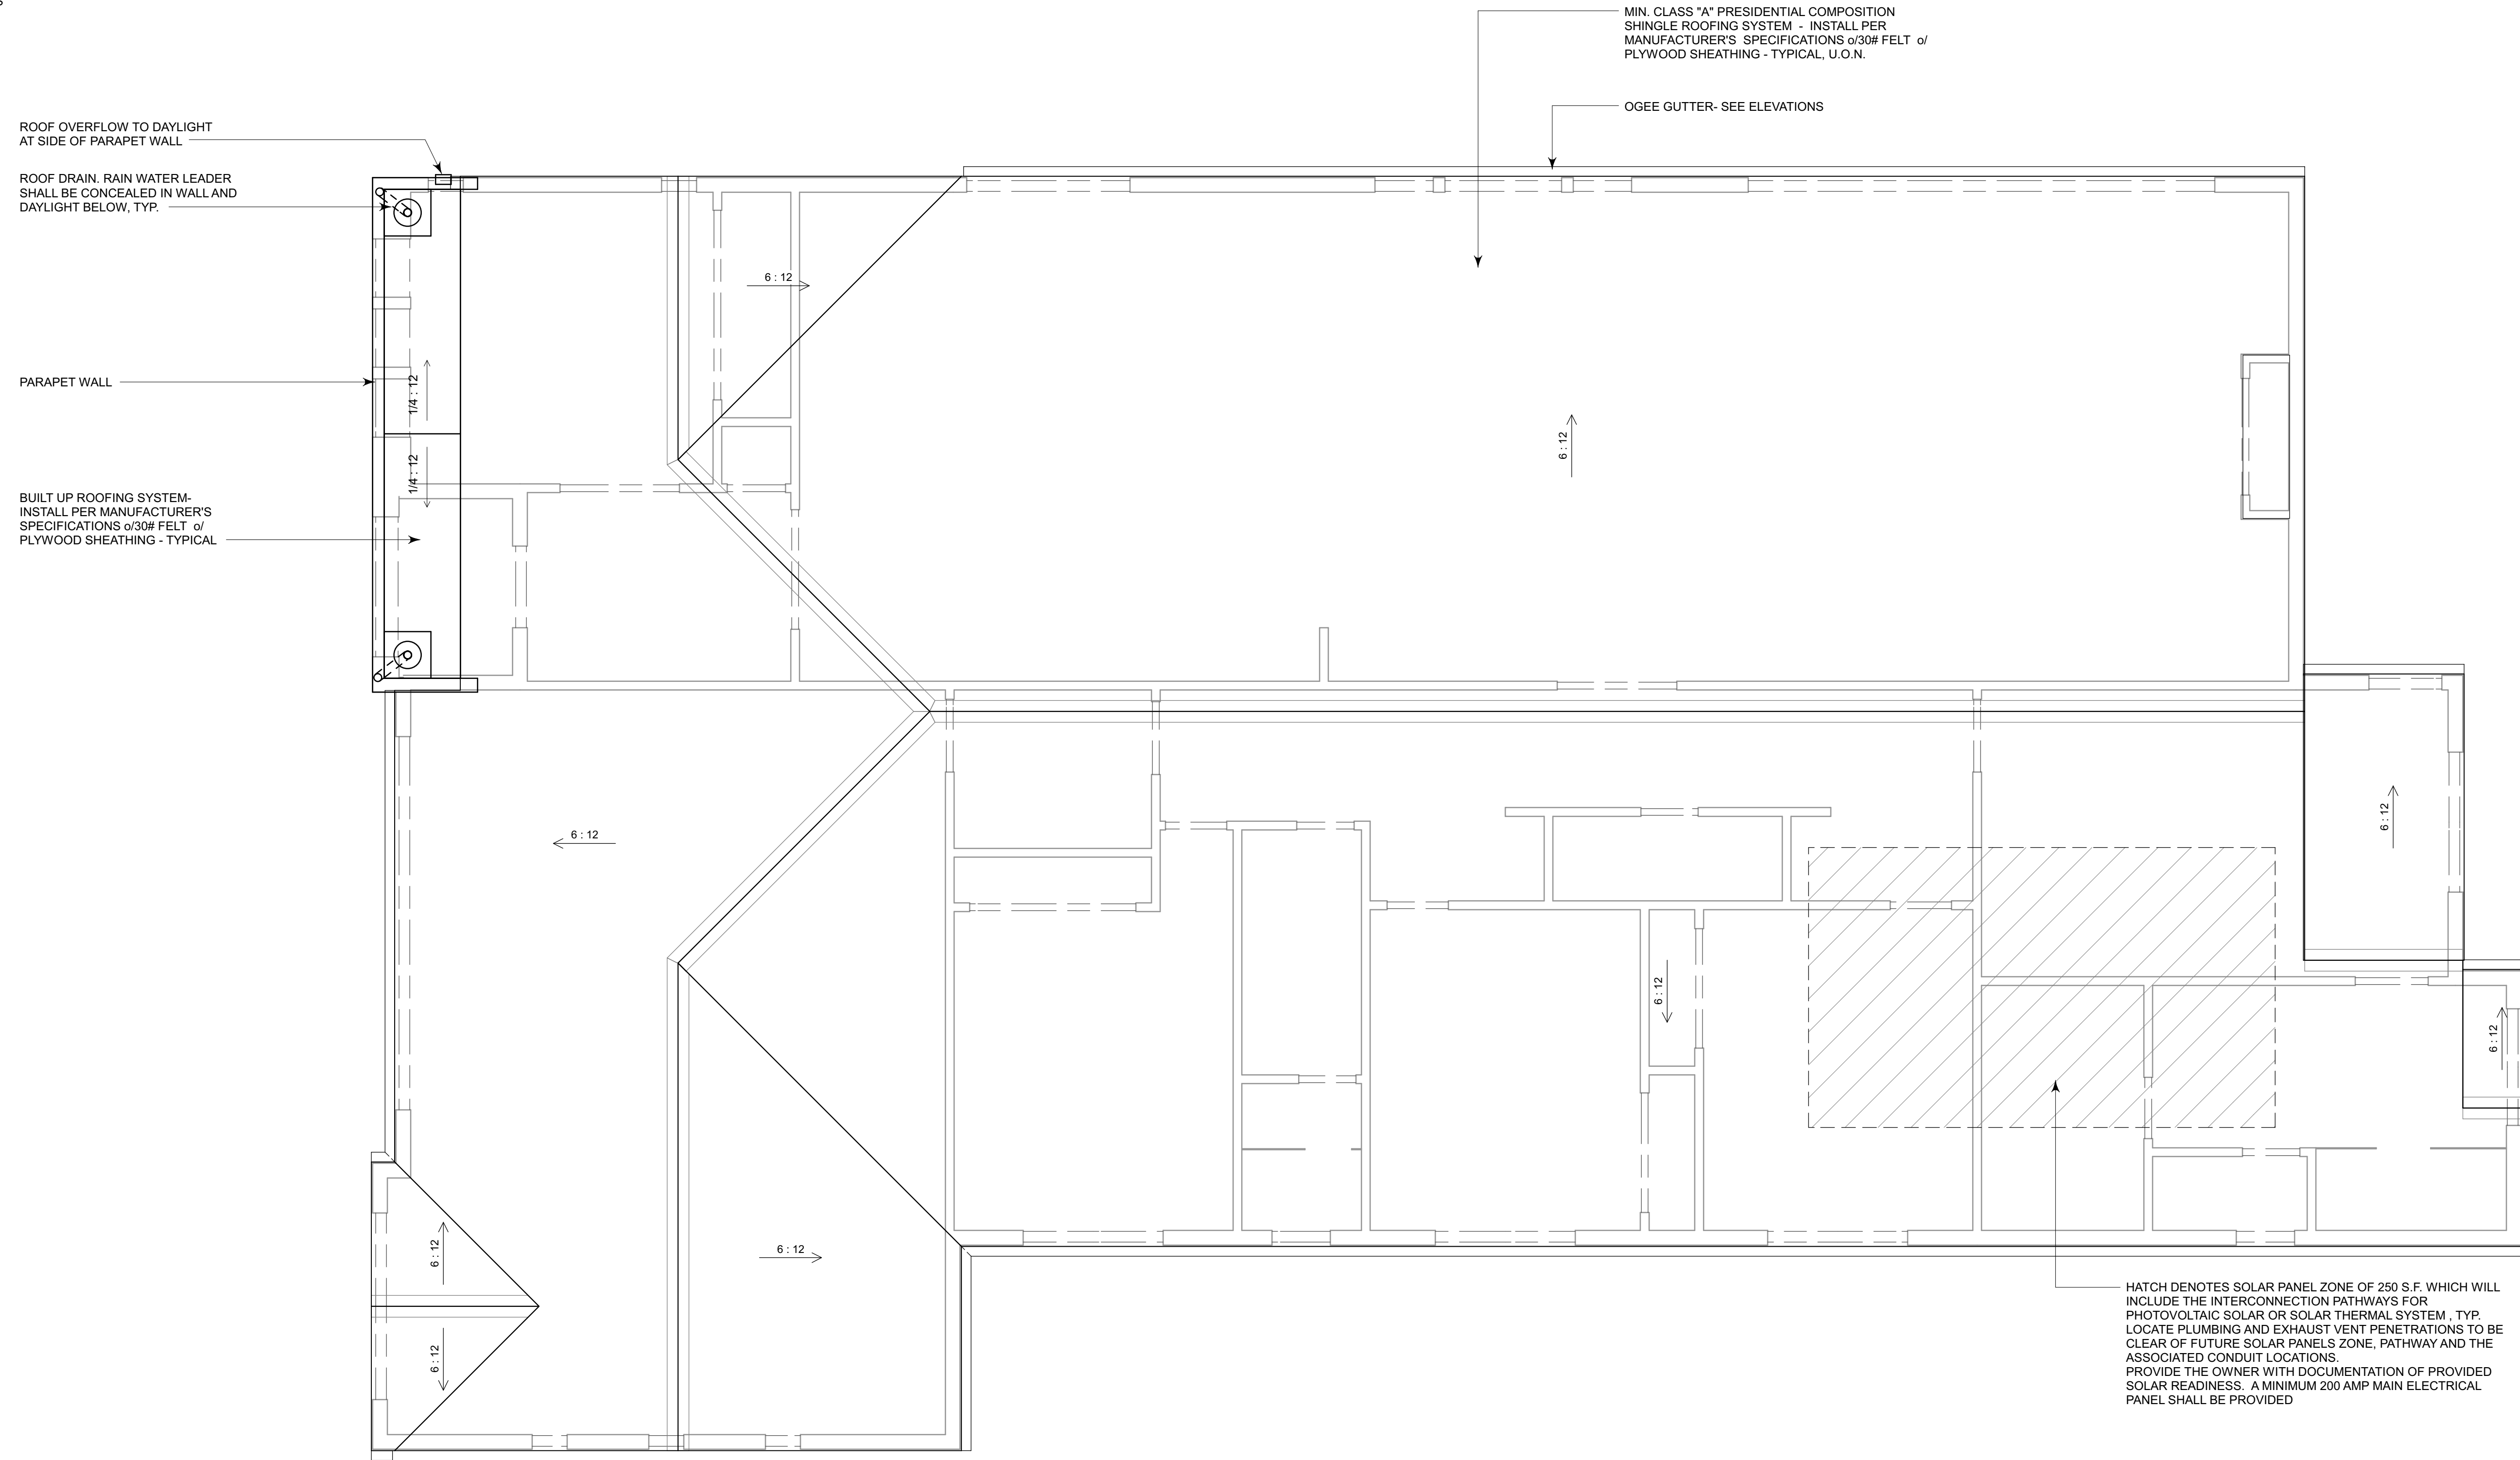

Roof Plan

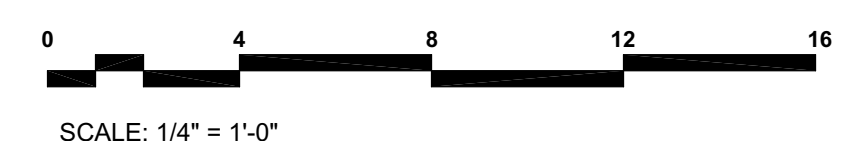

WARREN DESIGN
 679 E. CAMPBELL AVE. CAMPBELL, CA 95008 P. 650.469.3780


[Signature]
 These drawings and the design incorporated herein are the property of Warren Design and are not to be used for any other project without the written consent of Warren Design.

SAN JUAN RESIDENCE - LOT C
NEW RESIDENCE
 1907 SAN JUAN ROAD
 AROMAS CALIFORNIA



Date:	08/18/2025
Drawn By:	DW
Revisions:	
▲	
▲	
▲	
▲	

ROOF PLAN

Project No: **2549**
 Sheet No: **A-5**

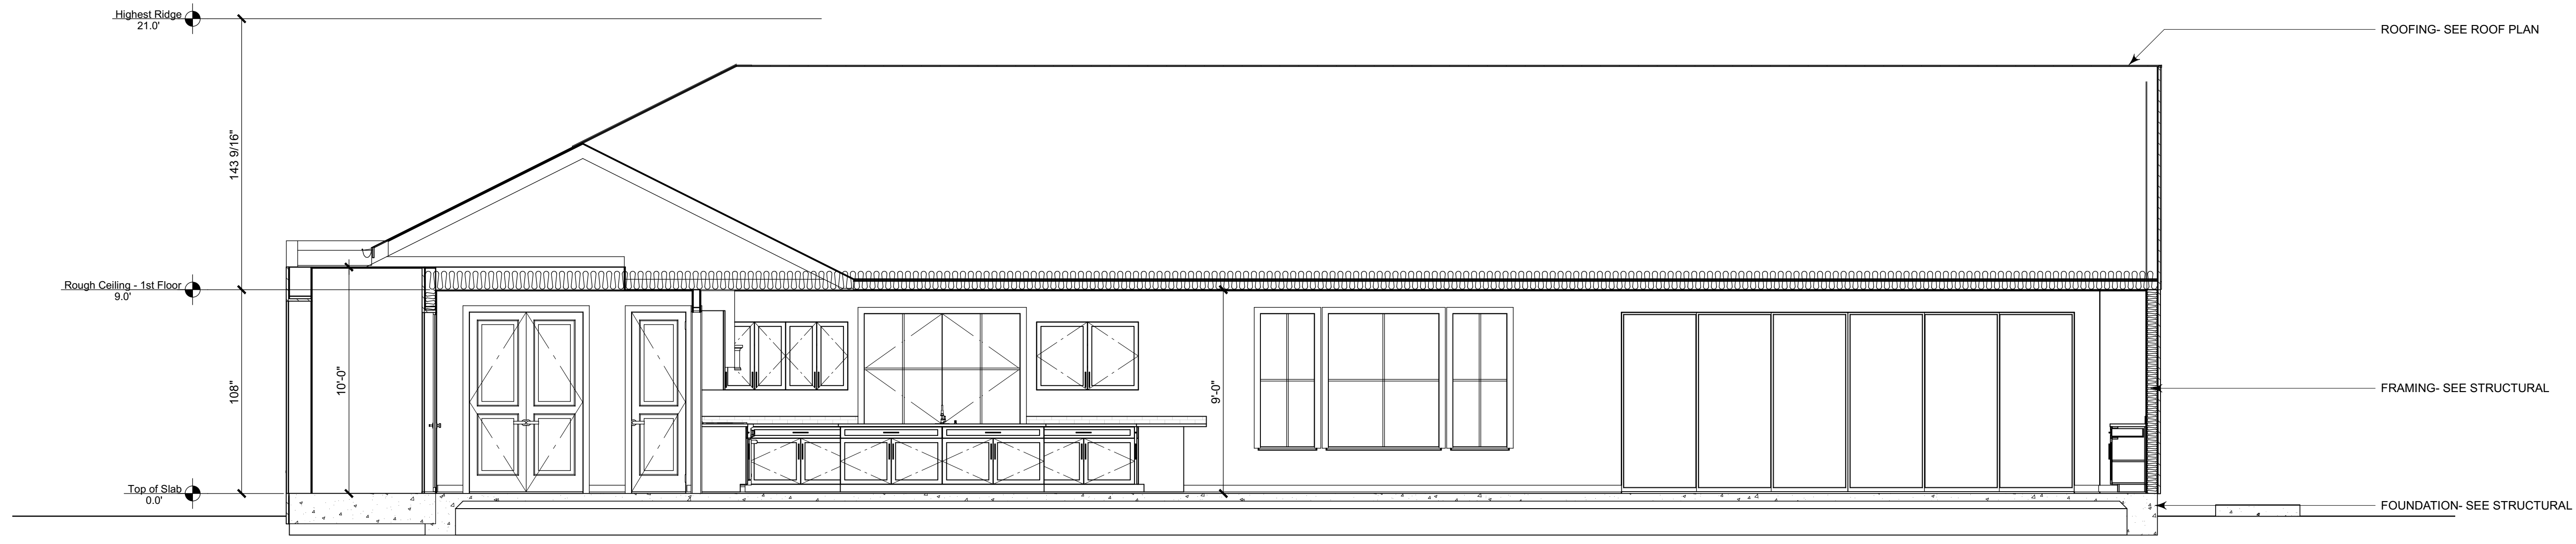

Section A-A


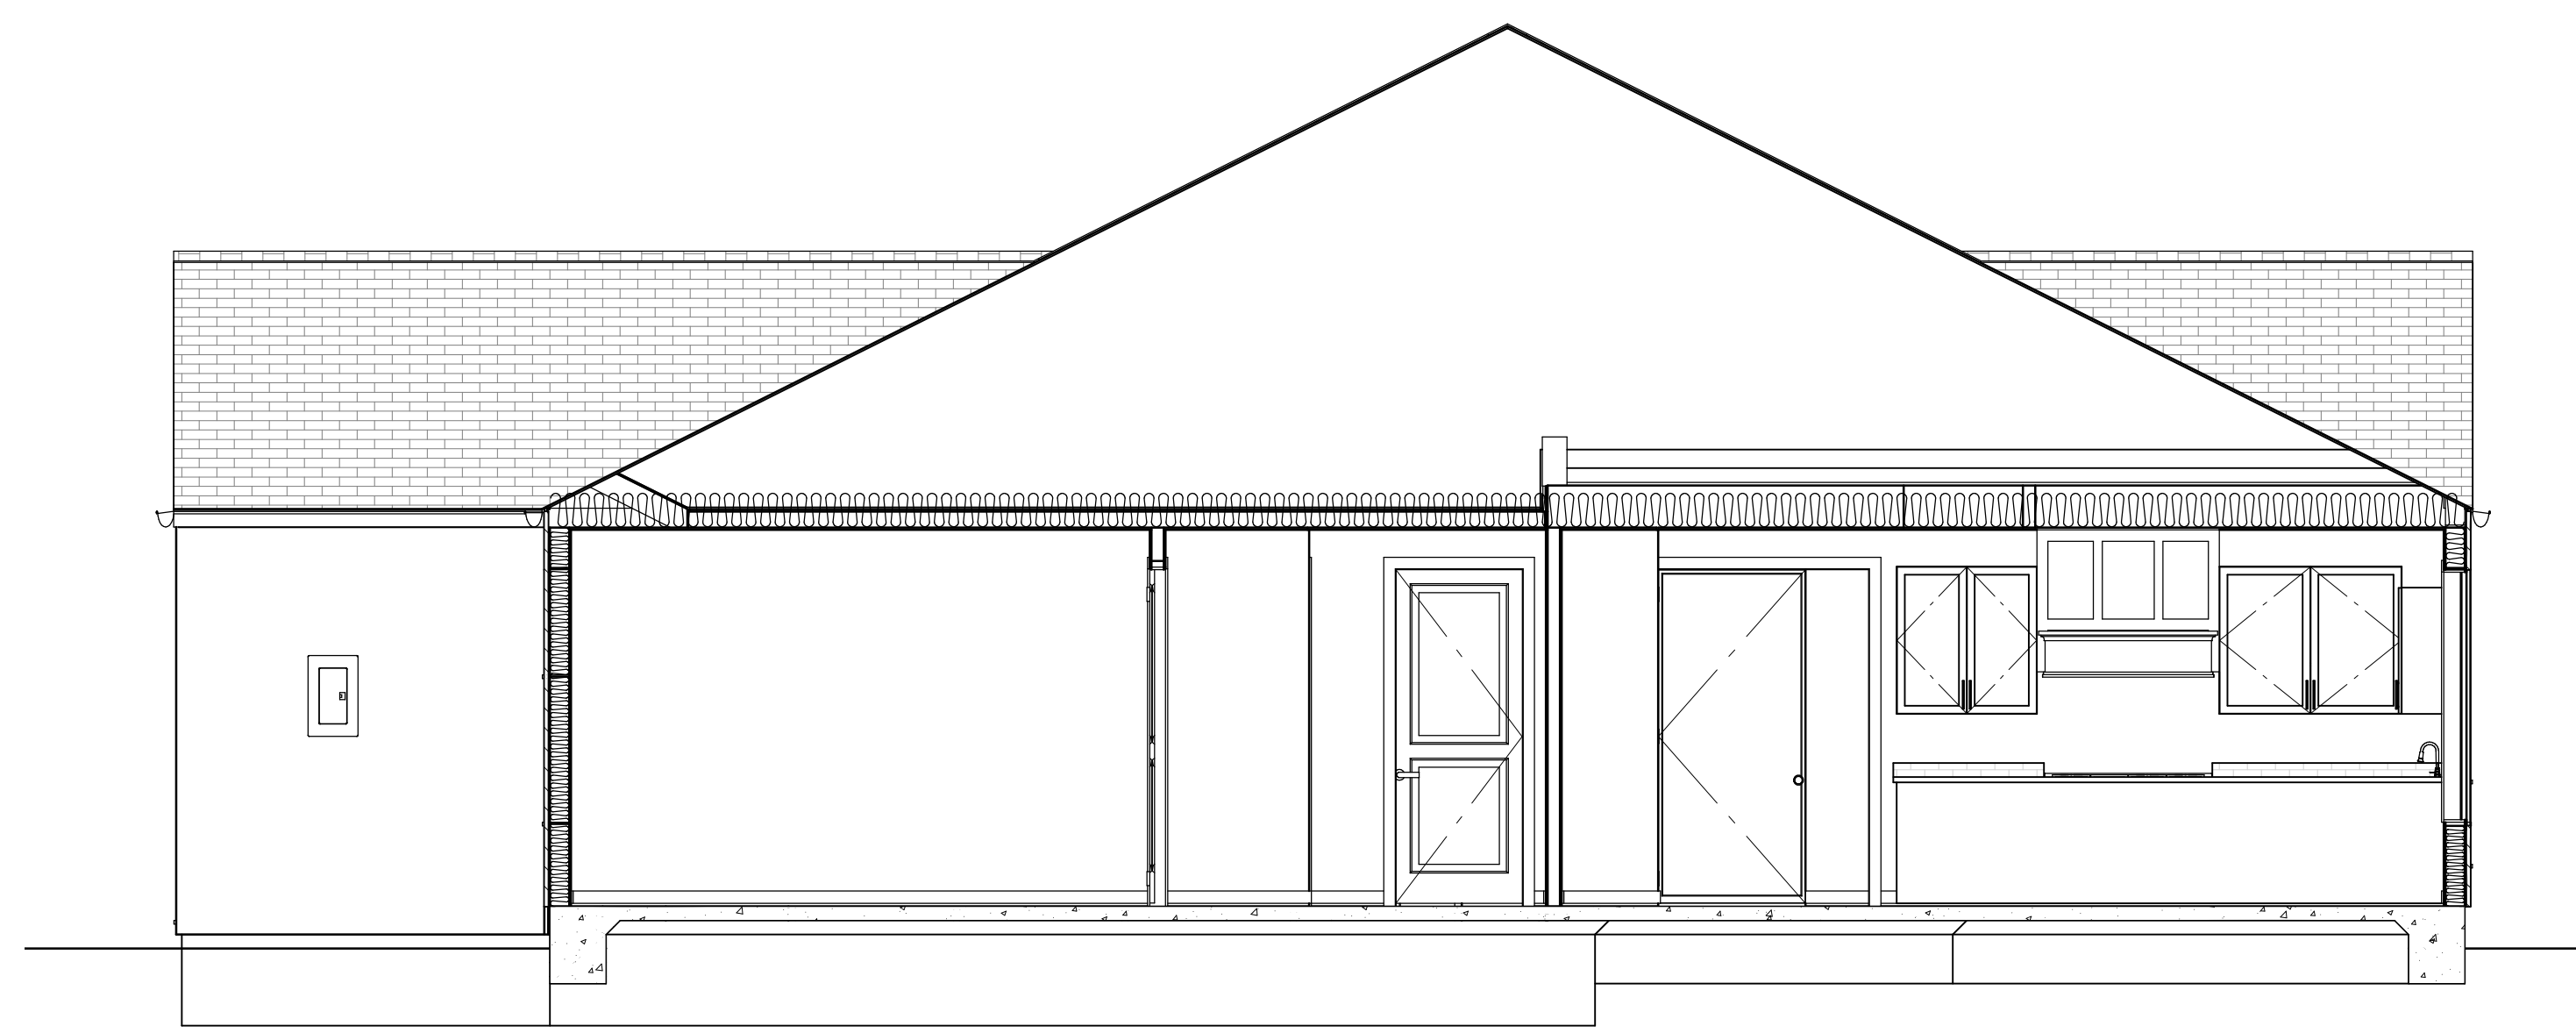
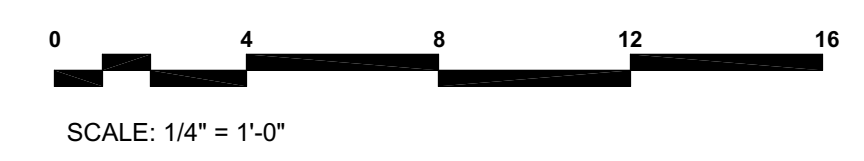


Section B-B


- GENERAL NOTES:
1. ALL SHEARWALLS TO BE FRAMED TO BOTTOM OF ROOF SHEATHING - TYP.
 2. FIRE STOPS SHALL BE PROVIDED IN THE FOLLOWING LOCATIONS PER CBC:
 - 2.a. IN CONCEALED SPACES OF STUD WALLS AND PARTITIONS, INCLUDING FURRED SPACES, AT THE CEILING AND FLOOR LEVELS AND AT 10-FOOT INTERVALS BOTH VERTICAL AND HORIZONTAL AT ALL INTERCONNECTIONS BETWEEN CONCEALED VERTICAL AND HORIZONTAL SPACES SUCH AS OCCUR AT SOFFITS, DROP CEILING AND COVE CEILINGS.
 - 2.b. IN CONCEALED SPACES BETWEEN STAIR STRINGERS AT THE TOP AND BOTTOM OF THE RUN AND BETWEEN STUDS ALONG AND IN LINE WITH THE RUN OF STAIRS IF THE WALLS UNDER THE STAIRS ARE UNFINISHED.
 - 2.c. IN OPENINGS AROUND VENTS, PIPES, DUCTS, CHIMNEYS, FIREPLACES AND SIMILAR OPENINGS WHICH AFFORD A PASSAGE FOR FIRE AT CEILING AND FLOOR LEVELS, WITH NONCOMBUSTIBLE MATERIALS.
 - 2.d. AT OPENINGS BETWEEN ATTIC SPACES AND CHIMNEY CHASES FOR FACTORY-BUILT CHIMNEYS.

INSULATION REQUIREMENTS:
 WALL INSULATION: R-21
 FLOOR INSULATION: R-19
 ATTIC INSULATION: R-38

PROVIDE RADIANT BARRIER AT UNDERSIDE OF ROOF AND GABLE END WALLS PER TITLE-24

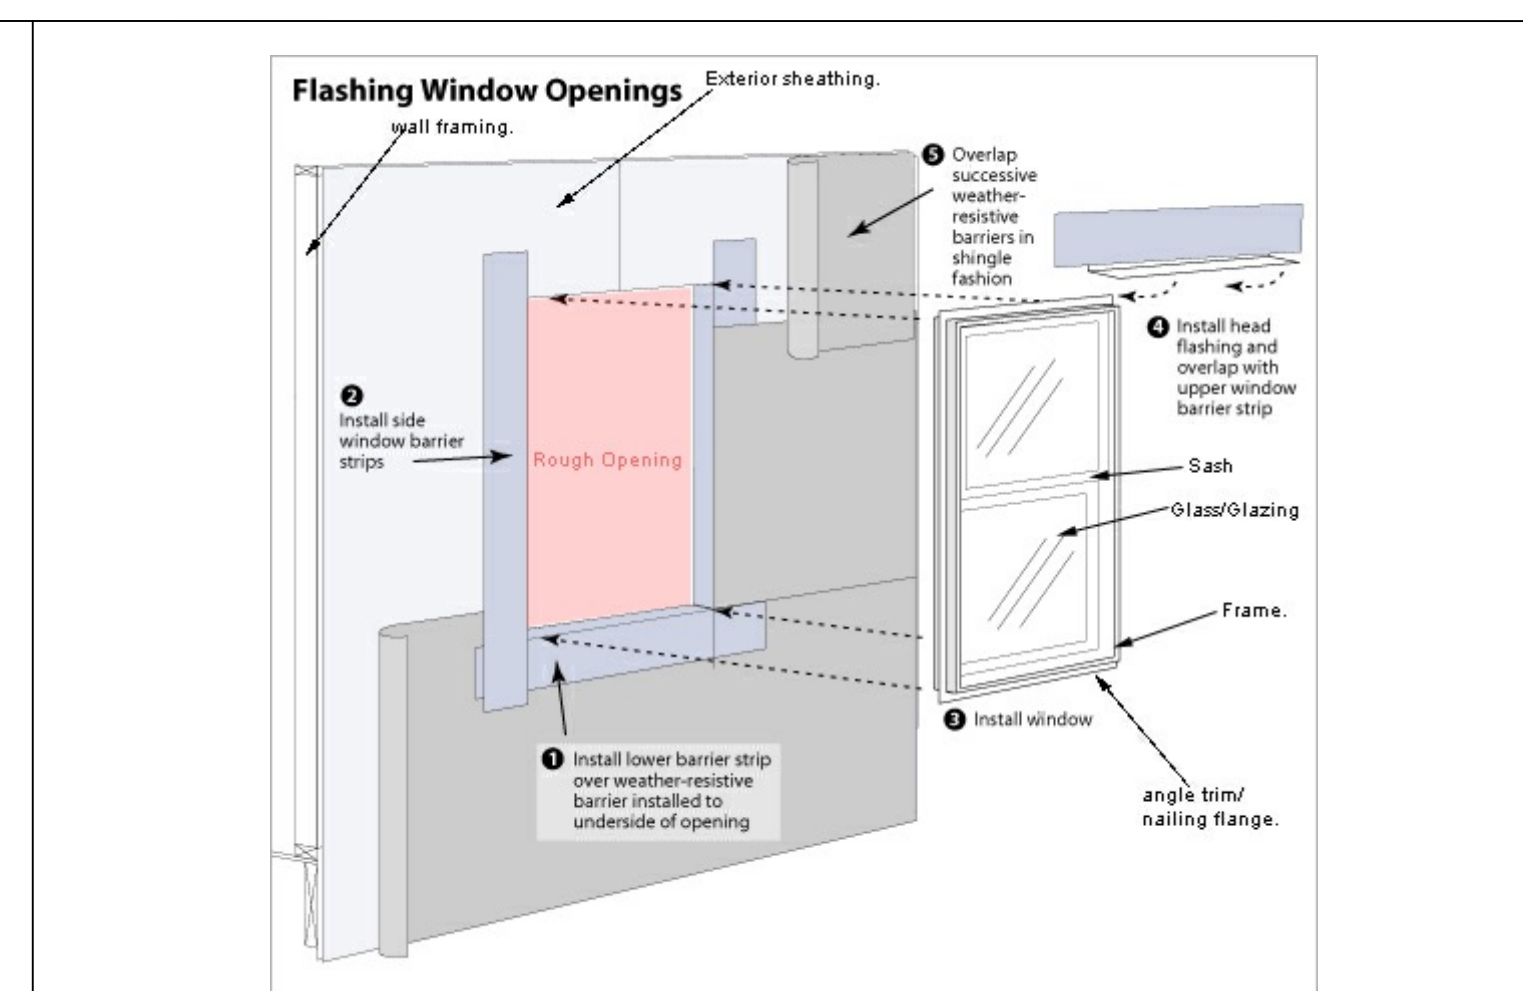

WINDOW FLASHING SCALE: N.T.S.

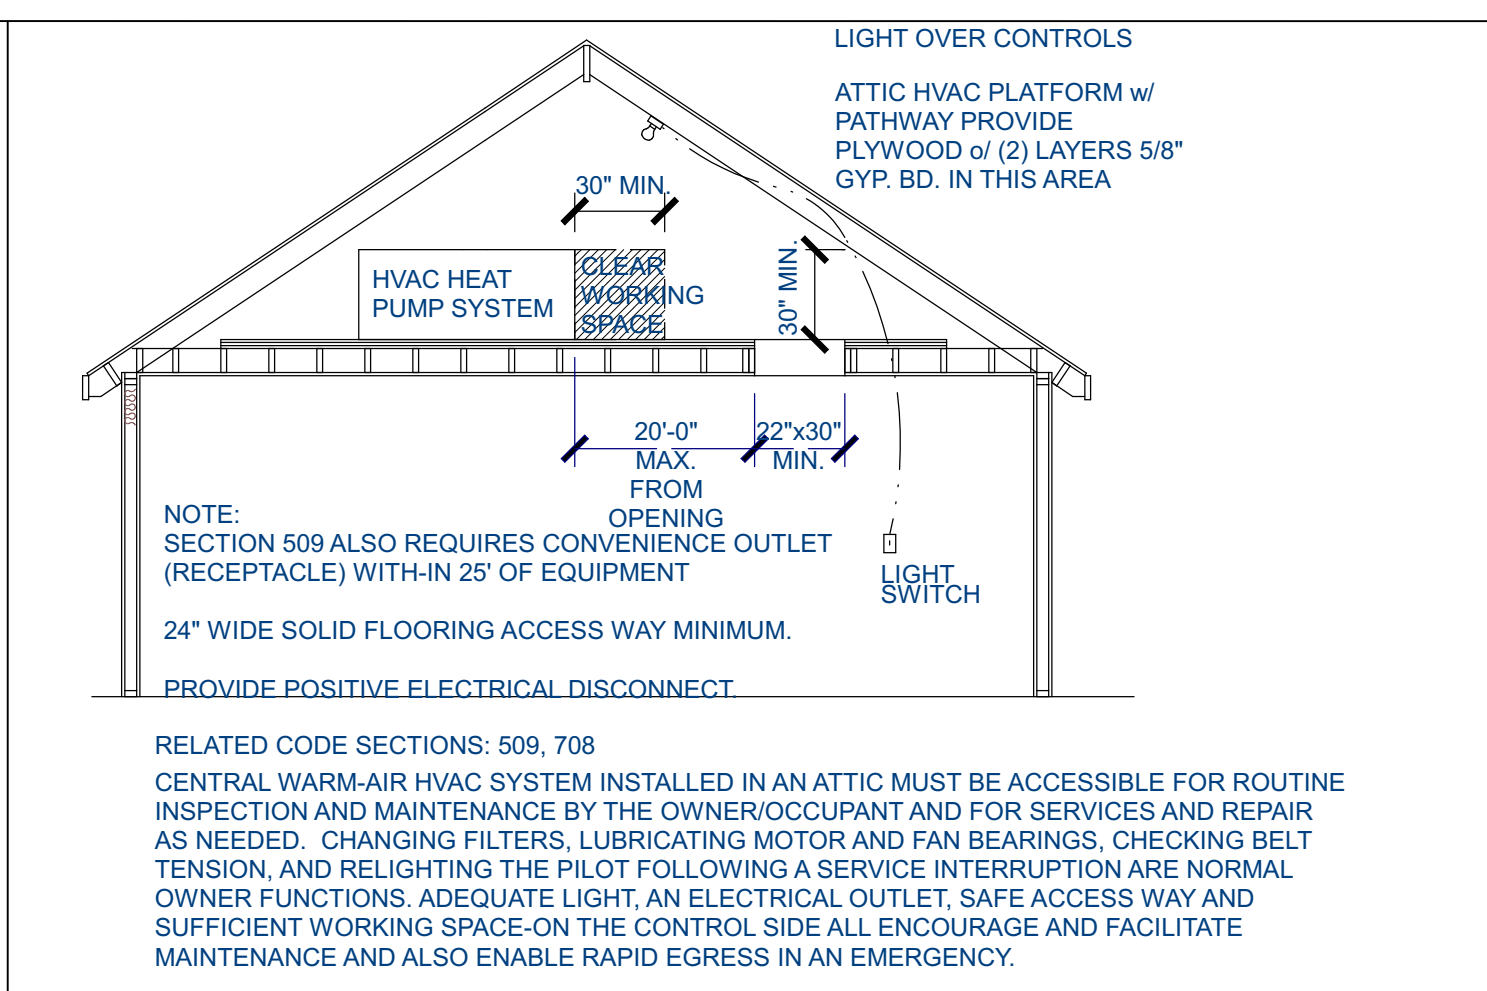

ATTIC HVAC PLATFORM SCALE: N.T.S.


WARREN DESIGN
 579 E. CAMPBELL AVE. CAMPBELL, CA 95008 P. 650.469.3780

SAN JUAN RESIDENCE - LOT C
NEW RESIDENCE
 1907 SAN JUAN ROAD
 AROMAS CALIFORNIA



Date: 08/18/2025
 Drawn By: DW
 Revisions:

SECTIONS


Project No:	2549
Sheet No:	A-6

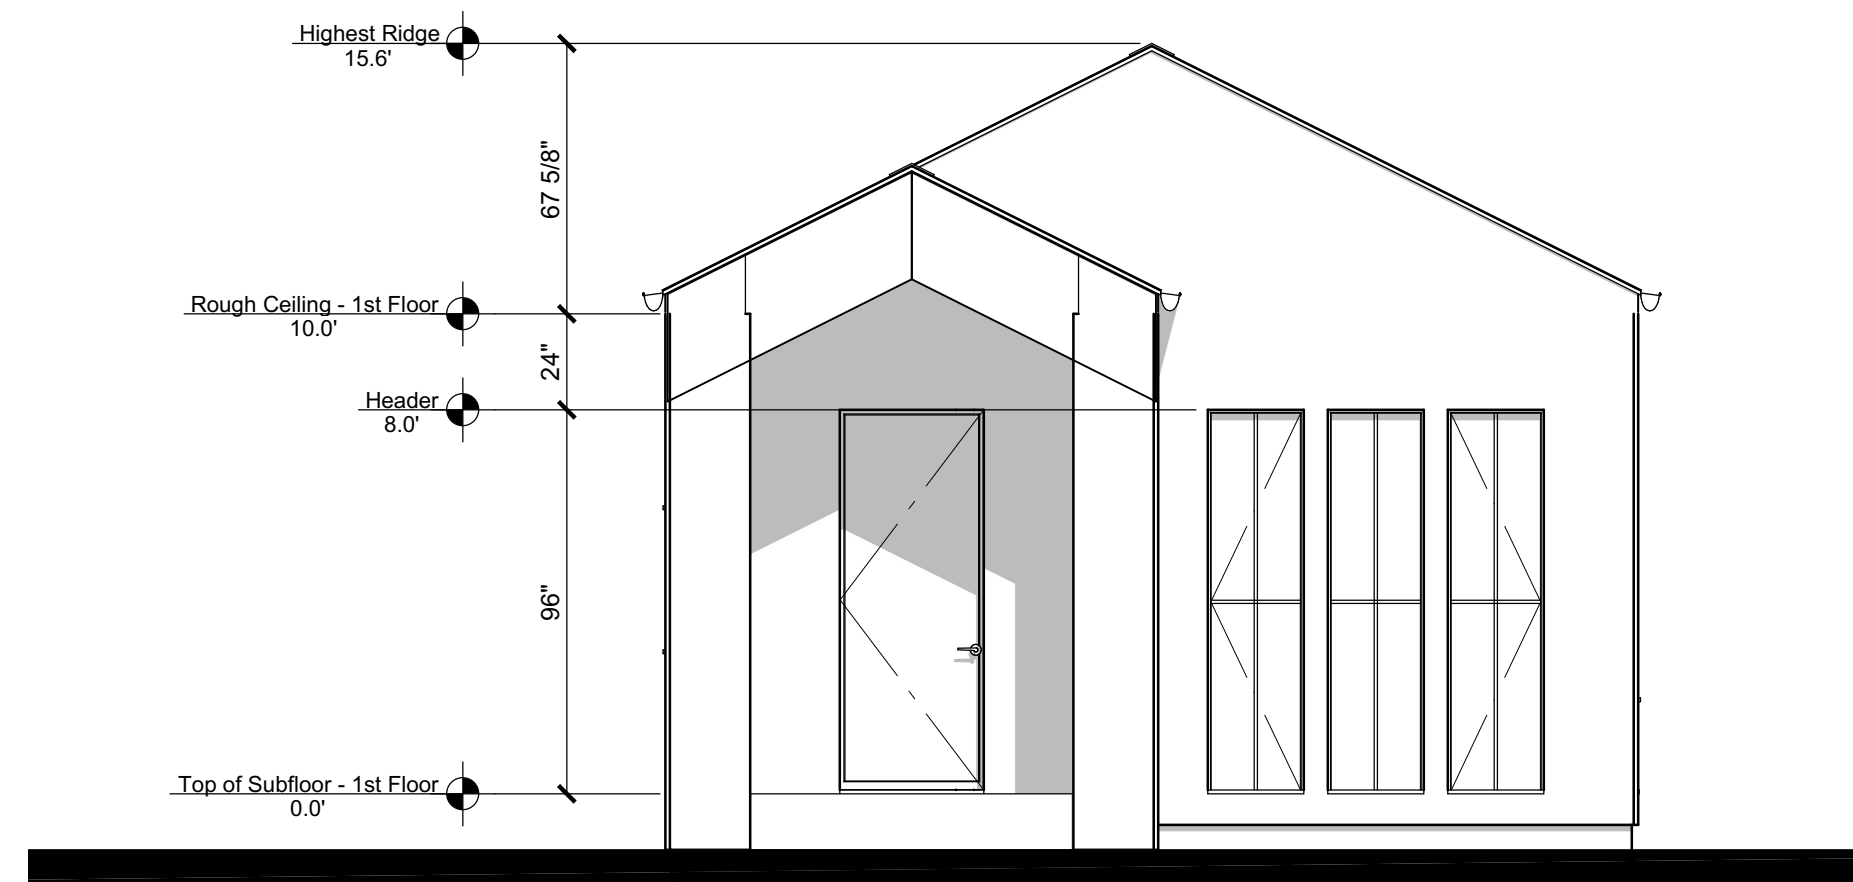


Front Elevation

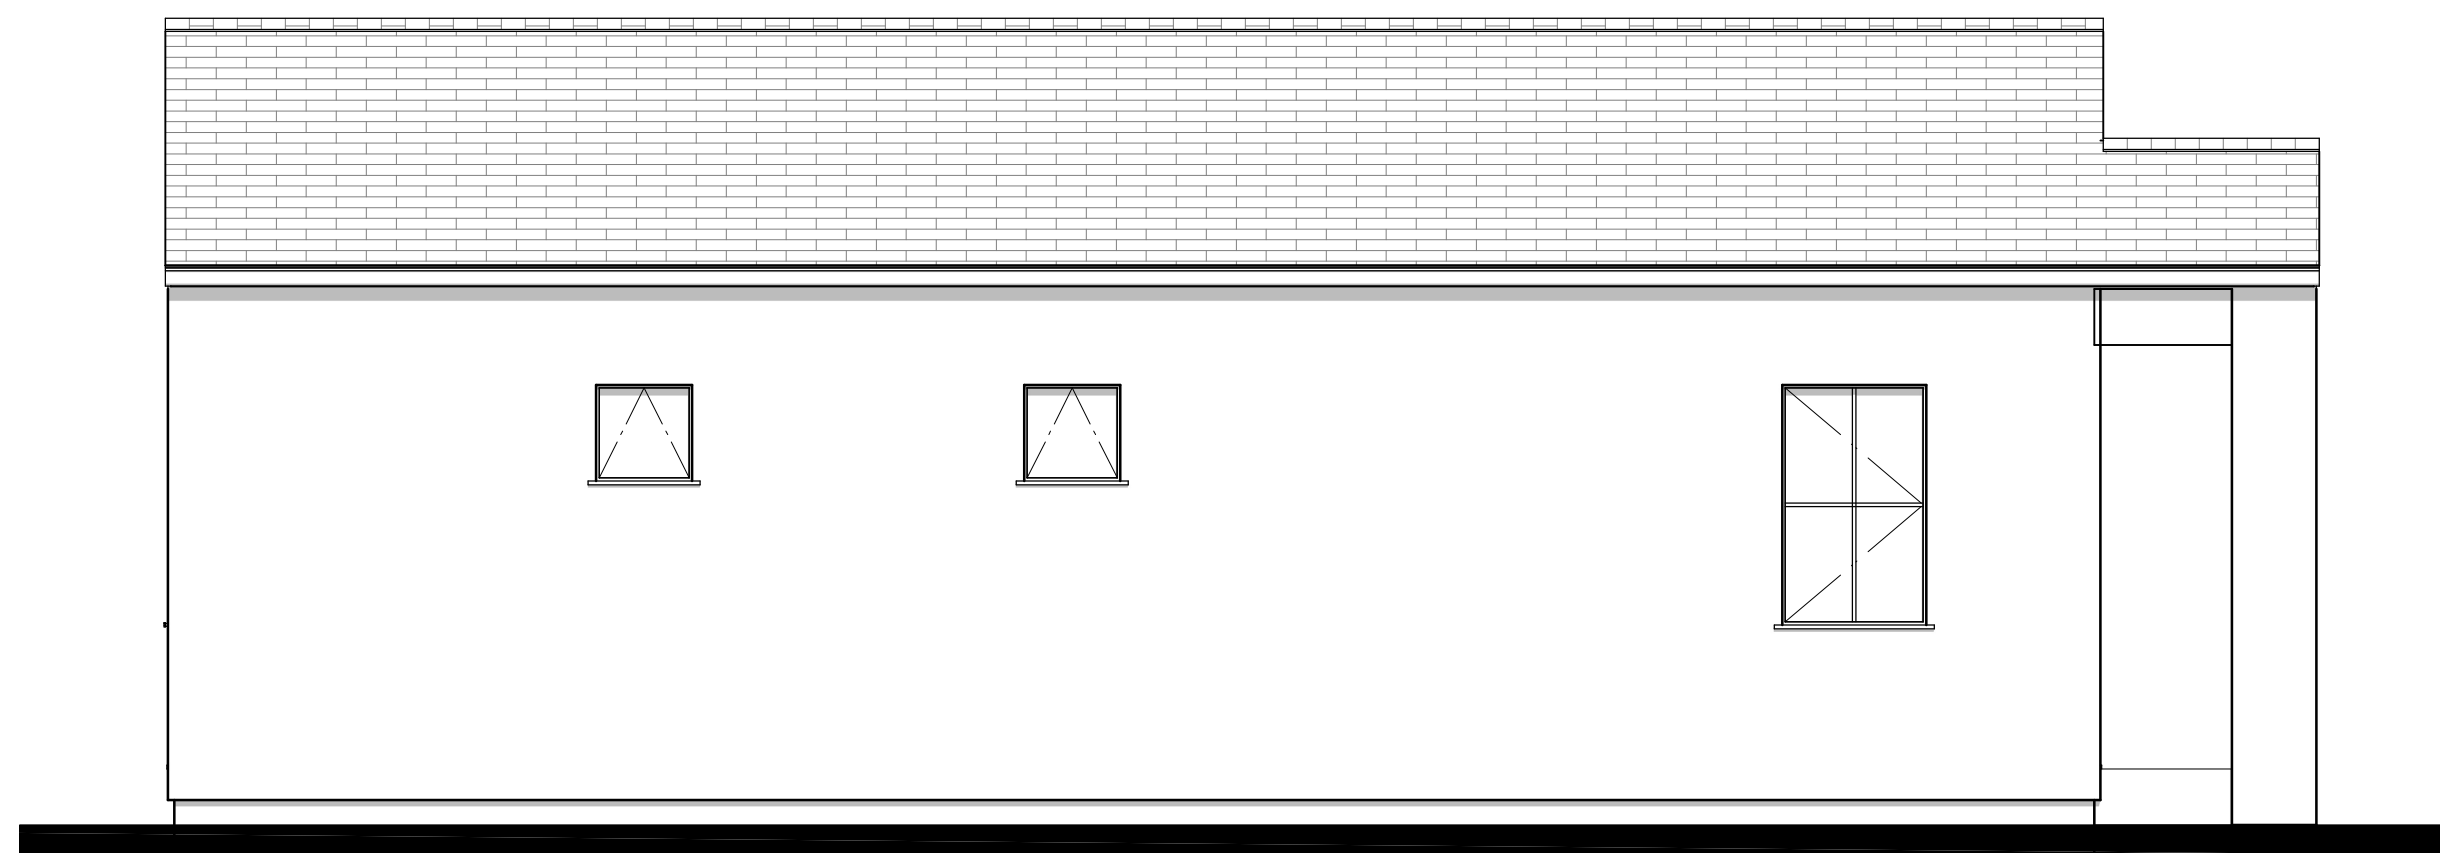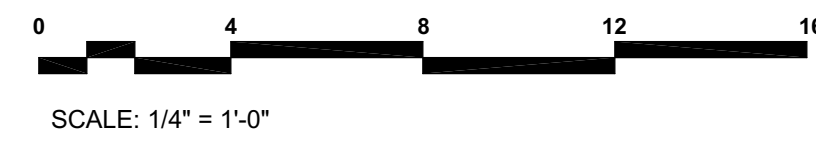



Left Elevation

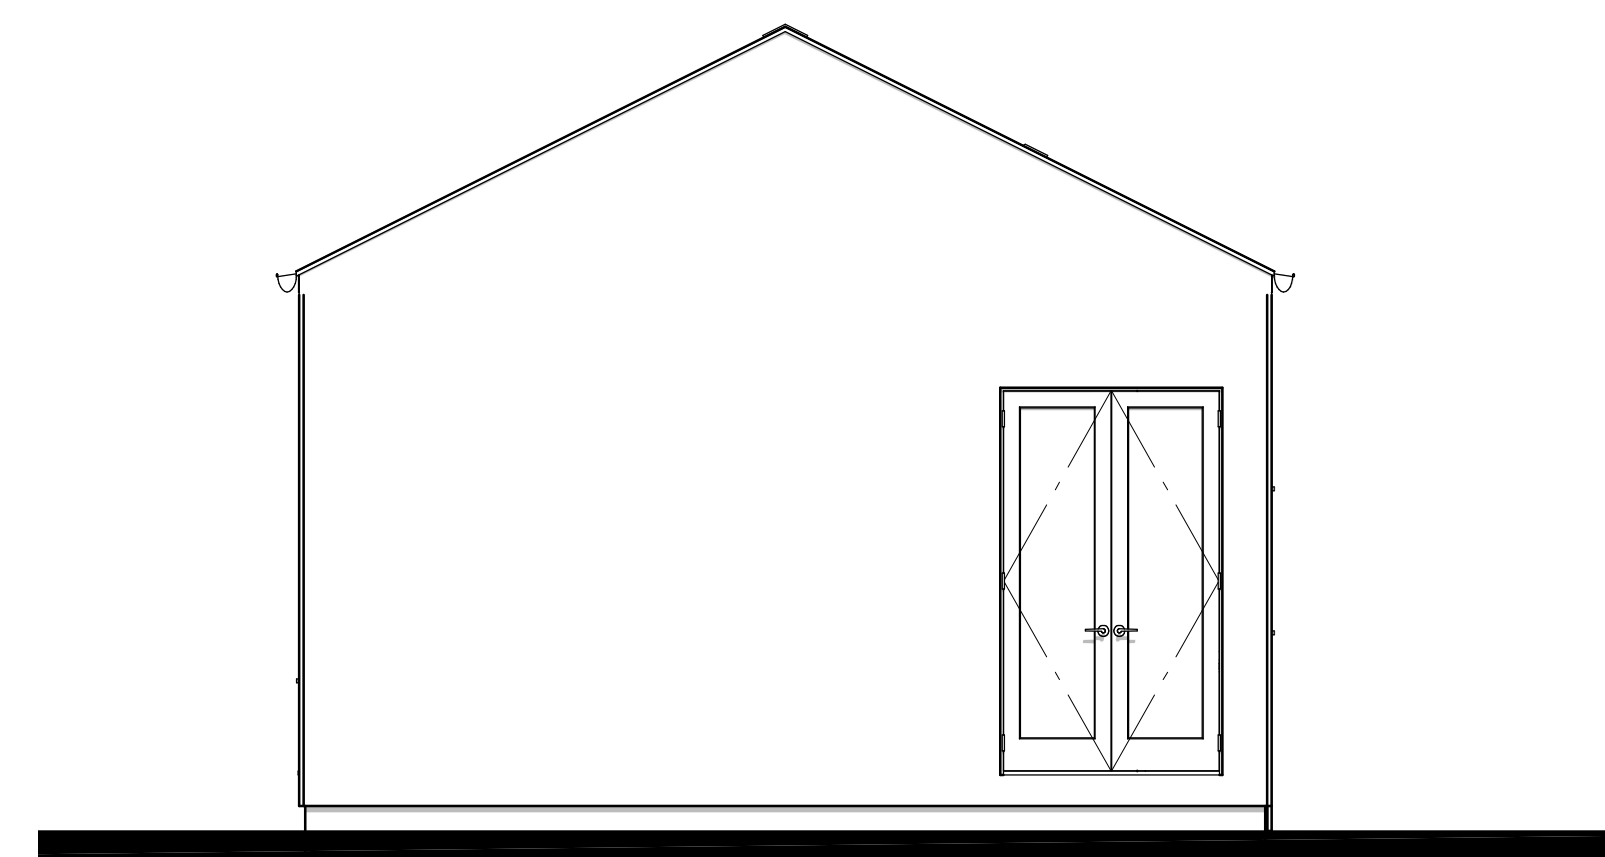

Rear Elevation

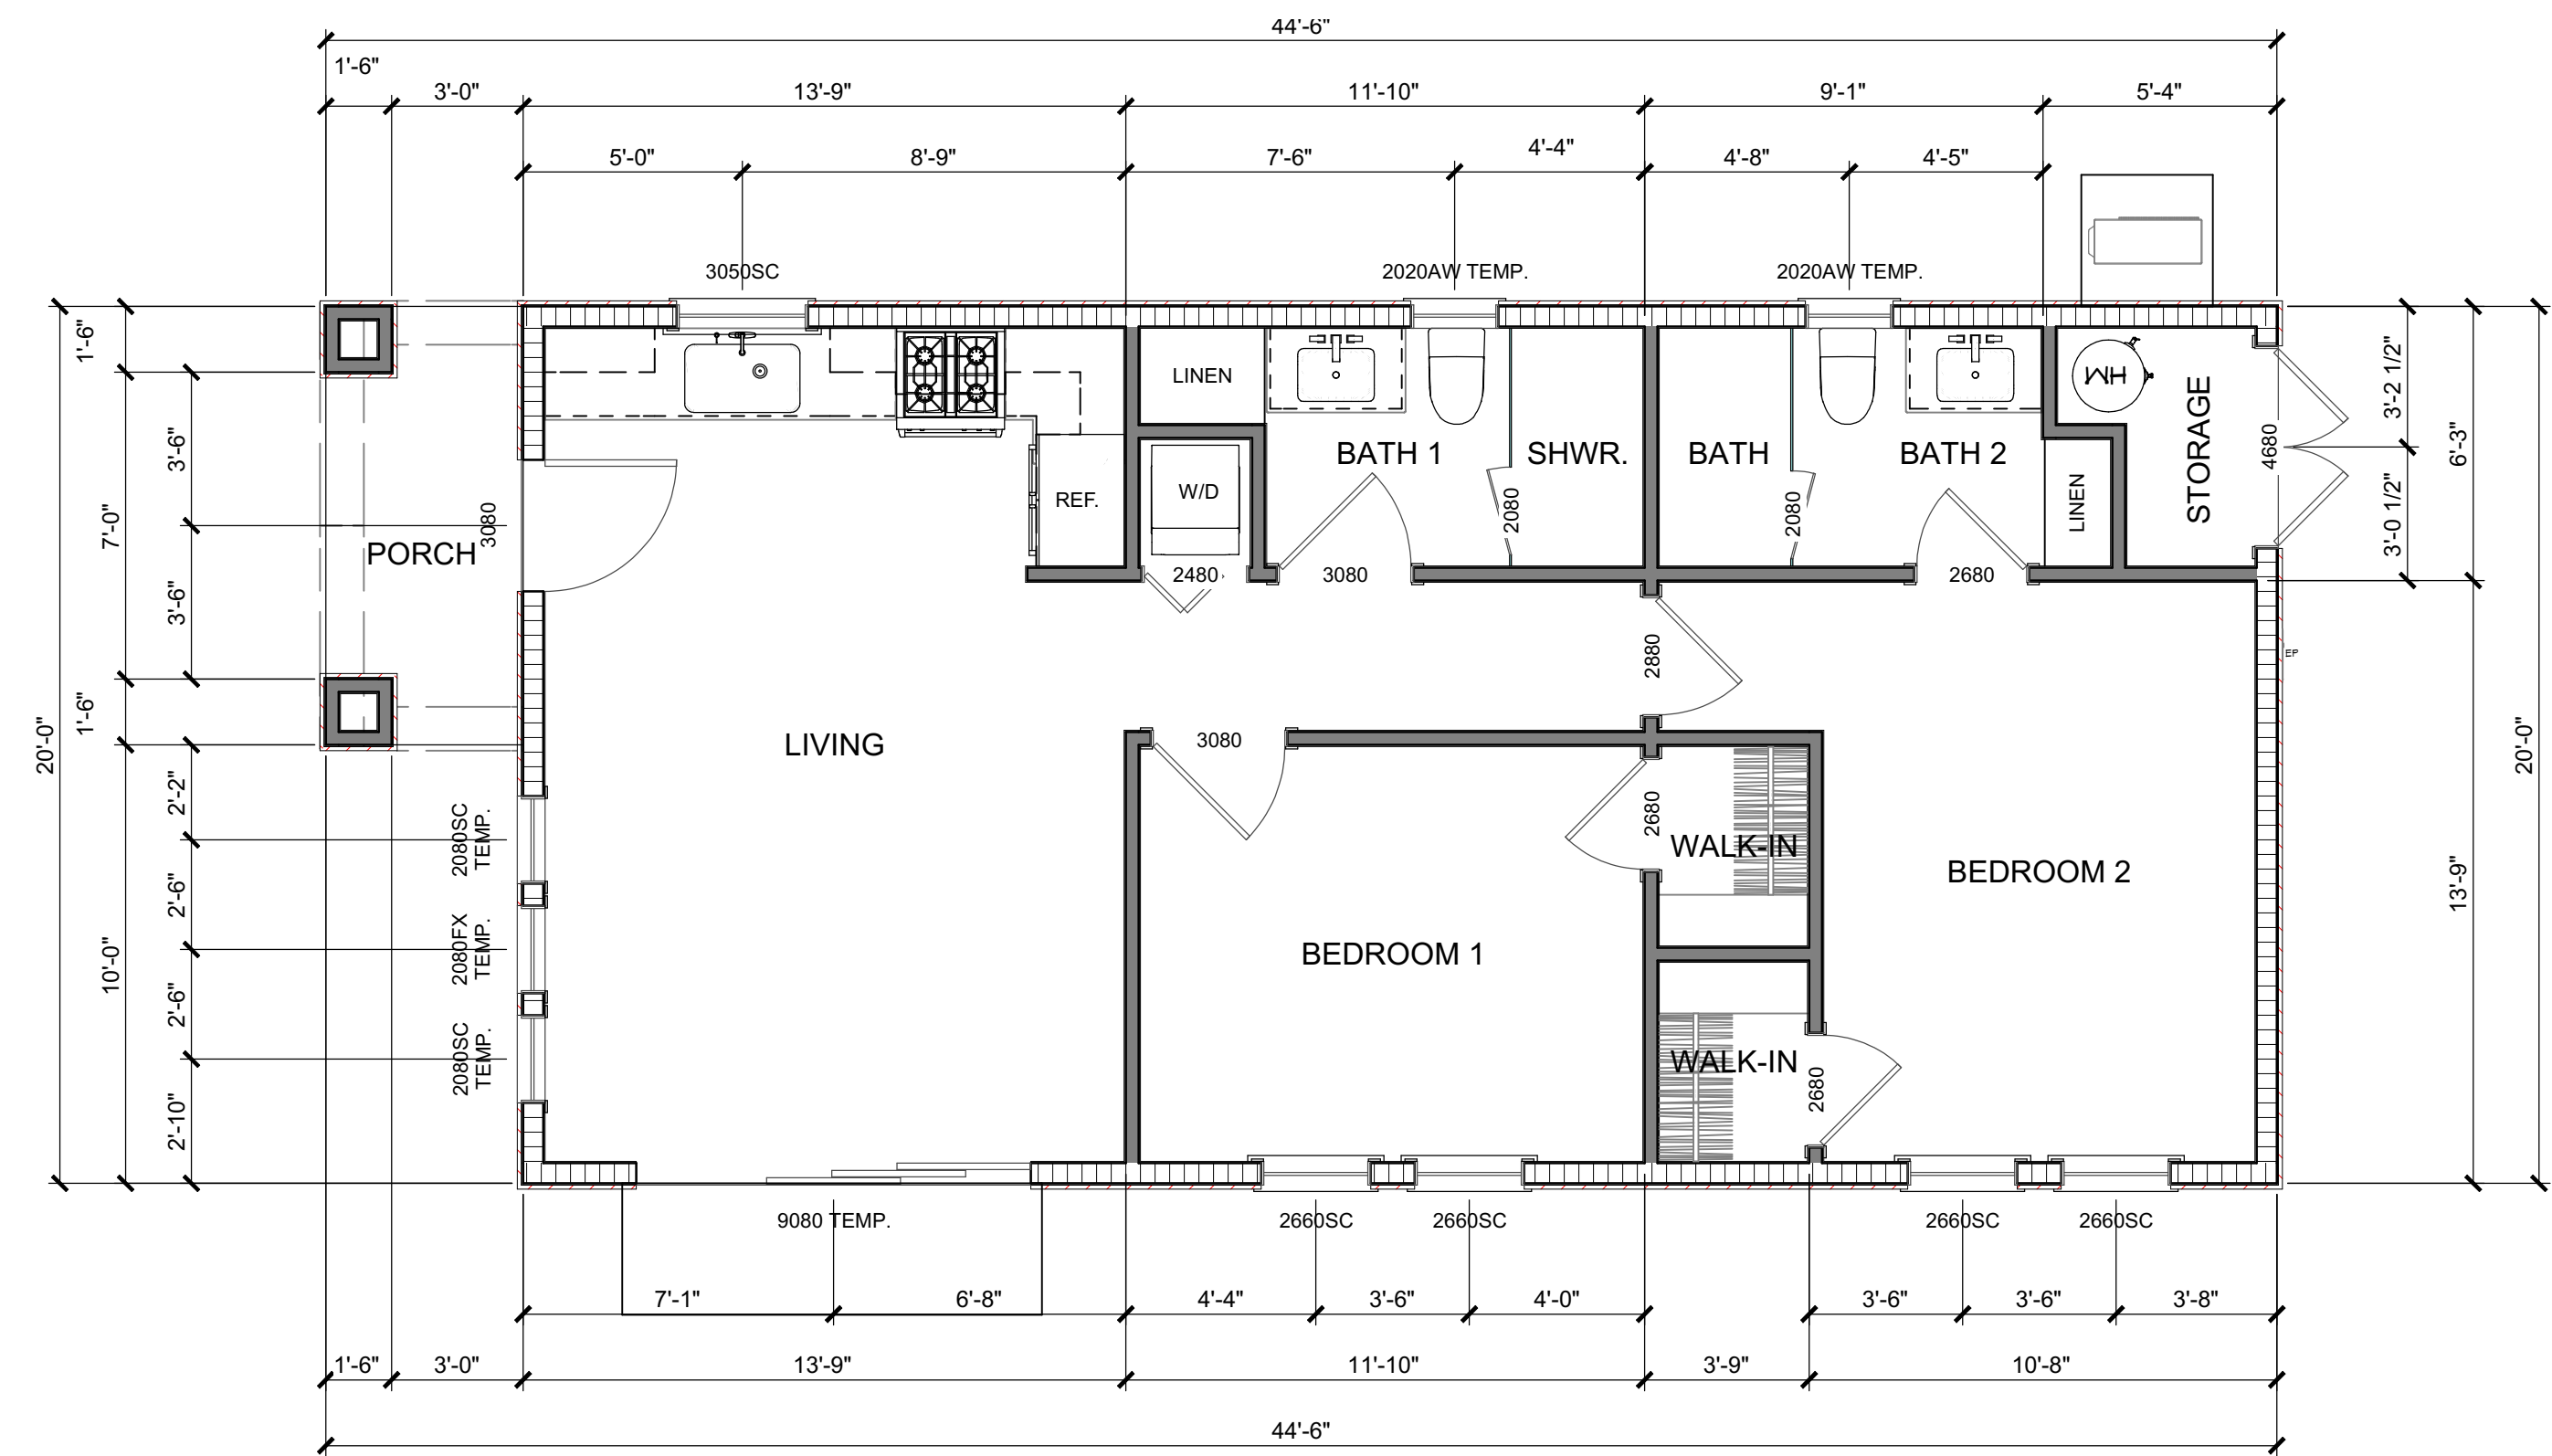

Proposed Detached ADU Floor Plan

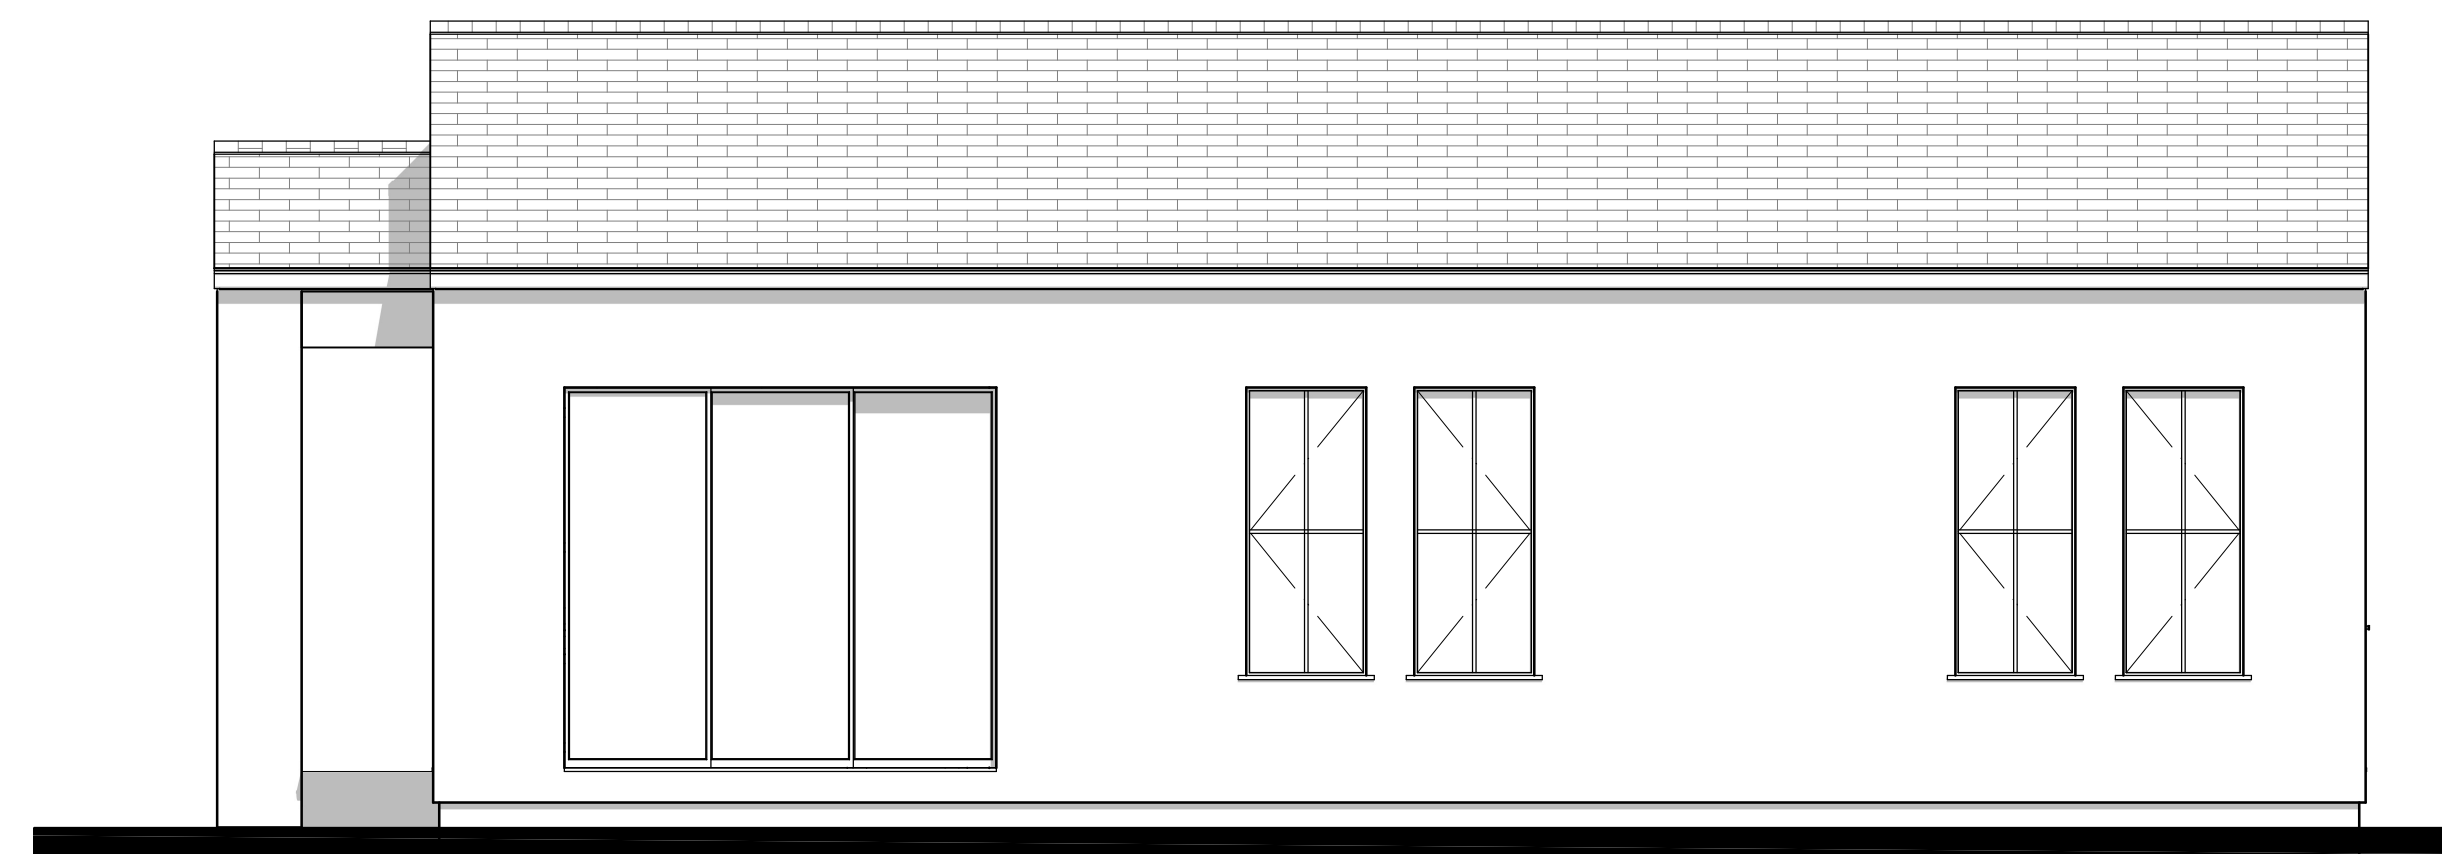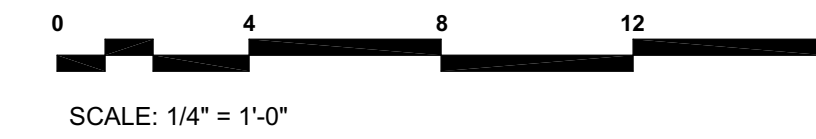

Right Elevation

WARREN DESIGN

579 E. CAMPBELL AVE. CAMPBELL, CA 95008 P. 650.469.3780

DW

These drawings and the design incorporated herein are the property of Warren Design and are not to be used for any other project without the written consent of Warren Design.

SAN JUAN RESIDENCE - LOT C

NEW RESIDENCE

1907 SAN JUAN ROAD

CALIFORNIA

AROMAS

Date: 08/18/2025

Drawn By: DW

Revisions:



**PROPOSED
DETACHED ADU
FLOOR PLAN**

**EXTERIOR
ELEVATIONS**

Project No:

2549

Sheet No:

A-7